

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 

Machine Id

# 62 REDUCTION (S/N NO OTHER INFO GIVEN)

Gearbox

**PETRO CANADA ENDURATEX EP 150 (15** 

### DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

GAL)			Jul2024			
SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0116769		
Sample Date		Client Info		08 Jul 2024		
	nrs	Client Info		0		
	nrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIC	N	method	limit/base	current	history1	history2
Water		WC Method	>0.2	NEG		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		31		
ron k	opm	ASTM D5185m	>200	30		
	opm	ASTM D5185m	>15	0		
Nickel p	opm	ASTM D5185m	>15	0		
Γitanium κ	opm	ASTM D5185m		<1		
Silver	opm	ASTM D5185m		0		
Aluminum p	opm	ASTM D5185m	>25	0		
_ead p	opm	ASTM D5185m	>100	0		
Copper	opm	ASTM D5185m	>200	0		
Γin μ	opm	ASTM D5185m	>25	0		
√anadium p	opm	ASTM D5185m		0		
Cadmium p	opm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron p	opm	ASTM D5185m	55	32		
Barium p	opm	ASTM D5185m	0	0		
Molybdenum p	opm	ASTM D5185m	0	0		
Manganese p	opm	ASTM D5185m	0	0		
Magnesium p	opm	ASTM D5185m	2	2		
Calcium	opm	ASTM D5185m	6	<1		
Phosphorus	opm	ASTM D5185m	250	443		
Zinc	opm	ASTM D5185m	3	0		
Sulfur p	opm	ASTM D5185m	7500	6535		
CONTAMINANT	S	method	limit/base	current	history1	history2
Silicon p	opm	ASTM D5185m	>50	7		
Sodium p	opm	ASTM D5185m		1		
Potassium p	opm	ASTM D5185m	>20	0		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2


1.52

Acid Number (AN)

mg KOH/g ASTM D8045 0.5



## **OIL ANALYSIS REPORT**

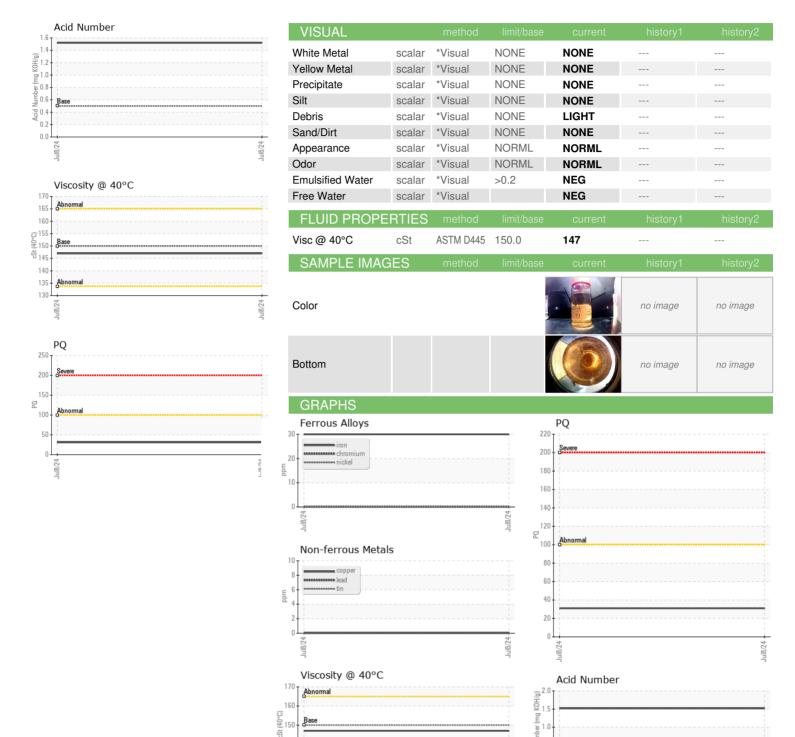





Certificate 12367

Laboratory

Sample No. **Lab Number** : 06236202 Unique Number : 11125036

130

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : PCA0116769

Received : 15 Jul 2024 **Tested** : 16 Jul 2024

Diagnosed : 17 Jul 2024 - Don Baldridge

Test Package : PLANT To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CERTAINTEED VINYL PLANT** 

2651 PENNY RD CLAREMONT, NC US 28613

Contact: BRUCE JAMES bruce.a.james@saint-gobain.com

T: (828)459-3320

F: (828)459-3329 Contact/Location: BRUCE JAMES - CERCLA