


# OIL ANALYSIS REPORT

Sample Rating Trend



VIS DEBRIS

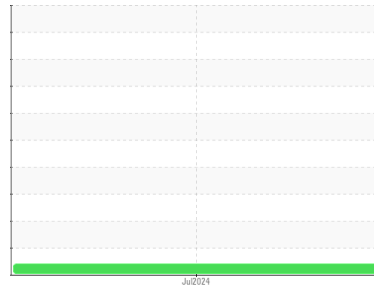

Machine Id  
**62 REDUCTION (S/N NO OTHER INFO GIVEN)**  
 Component  
**Gearbox**  
 Fluid  
**PETRO CANADA ENDURATEX EP 150 (15 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0116773</b>	---	---
Sample Date	Client Info			<b>08 Jul 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	<b>NEG</b>	---	---




WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		<b>23</b>	---	---
Iron	ppm	ASTM D5185m	>200	<b>29</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>2</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	55	<b>26</b>	---	---
Barium	ppm	ASTM D5185m	0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	2	<b>2</b>	---	---
Calcium	ppm	ASTM D5185m	6	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	250	<b>428</b>	---	---
Zinc	ppm	ASTM D5185m	3	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	7500	<b>6395</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m		<b>2</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	<b>1.29</b>	---	---


# OIL ANALYSIS REPORT

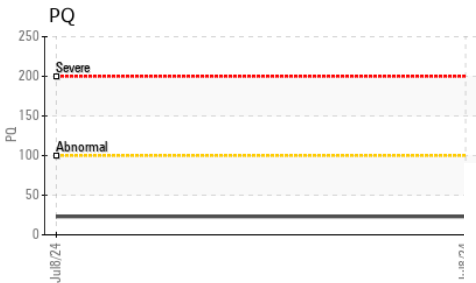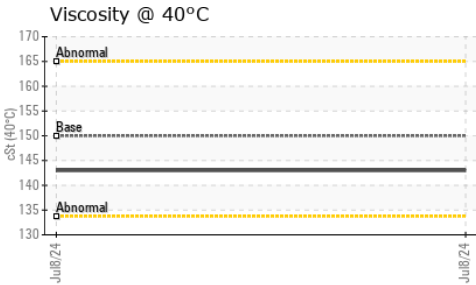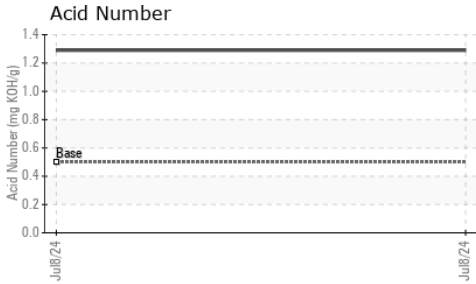






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150.0	<b>143</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

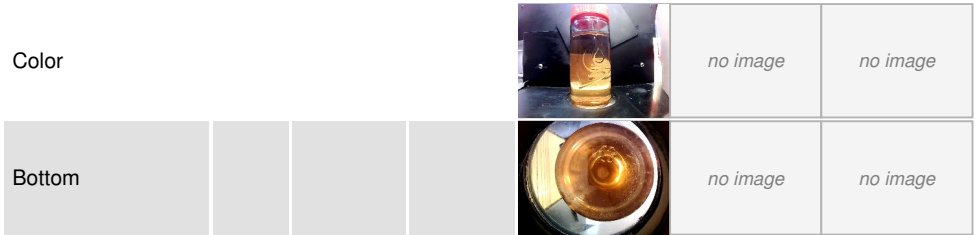

## GRAPHS

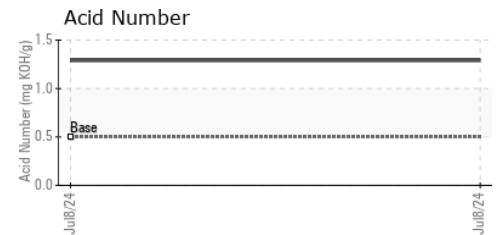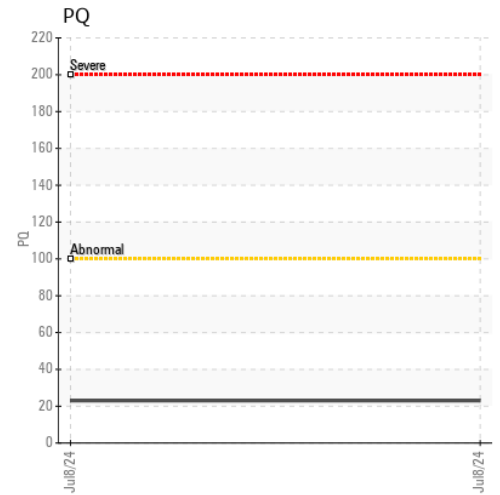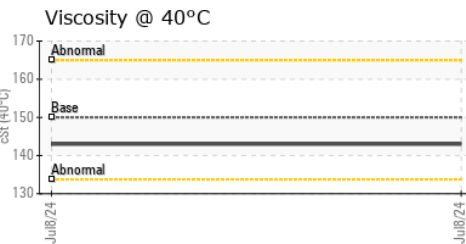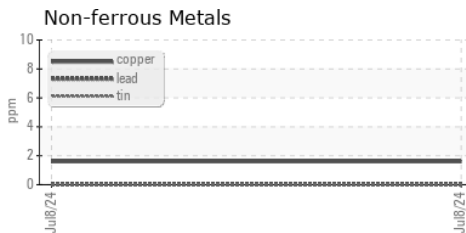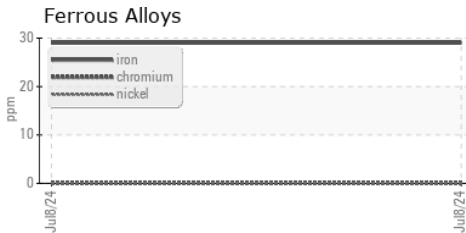

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0116773      **Received** : 15 Jul 2024  
**Lab Number** : 06236209      **Tested** : 16 Jul 2024  
**Unique Number** : 11125043      **Diagnosed** : 17 Jul 2024 - Don Baldrige  
**Test Package** : PLANT

**CERTAINTED VINYL PLANT**  
 2651 PENNY RD  
 CLAREMONT, NC  
 US 28613  
 Contact: BRUCE JAMES  
 bruce.a.james@saint-gobain.com  
 T: (828)459-3320  
 F: (828)459-3329

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)