

# **OIL ANALYSIS REPORT**

[910178895] [] TANK 203 TANK 203

Gearbox

{not provided} (--- GAL)

# Sample Rating Trend DIRT

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

## Contamination

Elemental level of silicon (Si) above normal indicating ingress of dirt/seal material.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
		Client Info		PCA0093723		
Sample Number		Client Info		10 Jul 2024		
Sample Date	lawa	Client Info				
Machine Age	hrs			0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
CONTAMINAT	ION	method	limit/base	current	history1	history2
Water		WC Method	>0.2	NEG		
WEAR METAL	.S	method	limit/base	current	history1	history2
PQ		ASTM D8184		16		
ron	ppm	ASTM D5185m	>200	10		
Chromium	ppm	ASTM D5185m	>15	0		
Nickel	ppm	ASTM D5185m	>15	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	5		
_ead	ppm	ASTM D5185m	>100	0		
Copper	ppm	ASTM D5185m	>200	0		
Γin	ppm	ASTM D5185m	>25	0		
√anadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		2		
Calcium	ppm	ASTM D5185m		64		
Phosphorus	ppm	ASTM D5185m		169		
Zinc	ppm	ASTM D5185m		33		
Sulfur	ppm	ASTM D5185m		1072		
CONTAMINAN	ITS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<u> </u>		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRA	DATION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

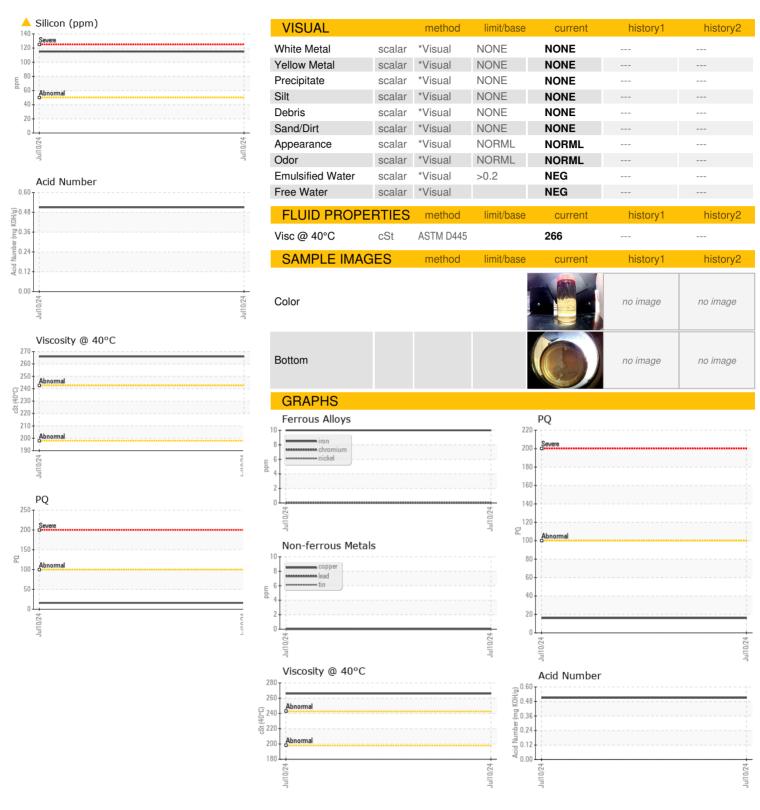





Laboratory Sample No.

: PCA0093723 Lab Number : 06236212 Unique Number : 11125046

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested** 

: 15 Jul 2024 : 16 Jul 2024 Diagnosed : 17 Jul 2024 - Don Baldridge

WEST HERSHEY - TECHNICAL ASSURANCE, 1033 OLDE WEST CHOCOLATE HERSHEY, PA US 17033 Contact: BILL GEZIK

THE HERSHEY COMPANY

bgezik@hersheys.com

Test Package : IND 2 ( Additional Tests: PQ ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (717)374-4594 Contact/Location: BILL GEZIK - HERHER

T: