


# OIL ANALYSIS REPORT

Sample Rating Trend



**WEAR**

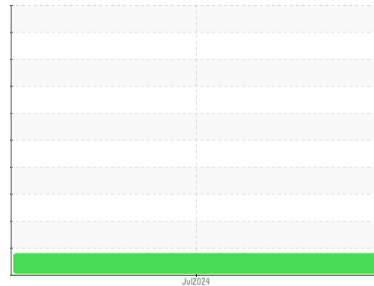

Machine Id  
**NG PCA06236224 NOT GIVEN PCA06236224**  
 Component  
**Gearbox**  
 Fluid  
**{not provided} (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

The aluminum level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA06236224</b>	---	---
Sample Date	Client Info			<b>14 Jul 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	<b>NEG</b>	---	---





WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		<b>44</b>	---	---
Iron	ppm	ASTM D5185m	>200	<b>51</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>▲ 222</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>3</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>14</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>8</b>	---	---
Calcium	ppm	ASTM D5185m		<b>2985</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>583</b>	---	---
Zinc	ppm	ASTM D5185m		<b>1249</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>1452</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>27</b>	---	---
Sodium	ppm	ASTM D5185m		<b>4</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.18</b>	---	---

# OIL ANALYSIS REPORT

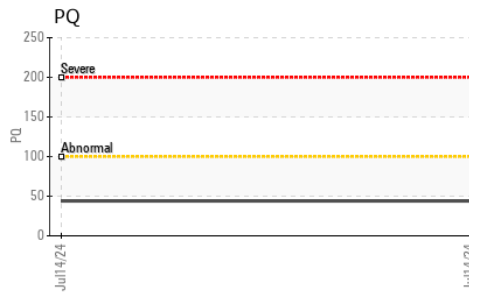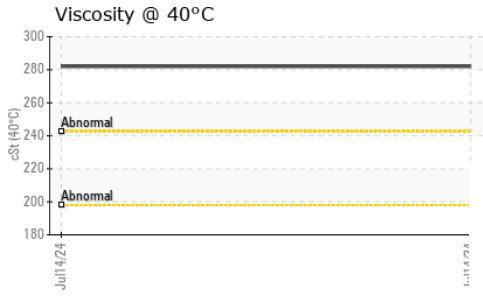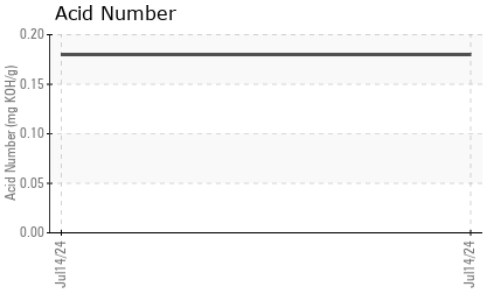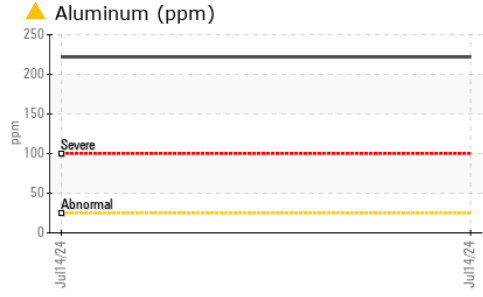





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	282	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

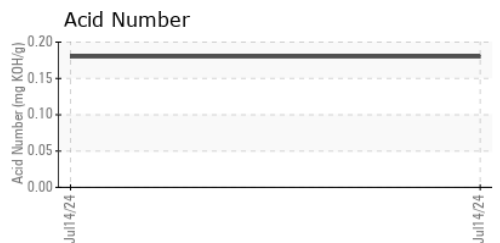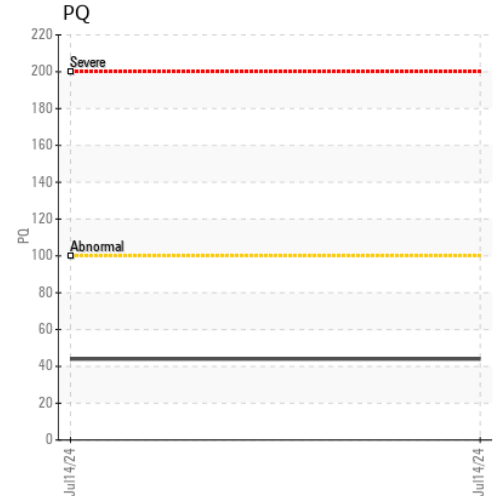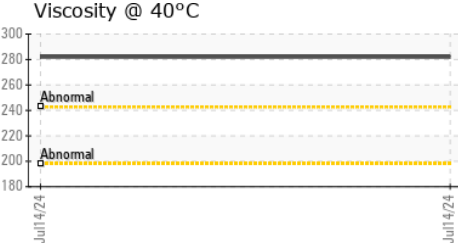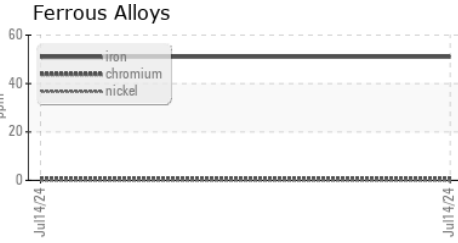

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA06236224      **Received** : 15 Jul 2024  
**Lab Number** : 06236224      **Tested** : 16 Jul 2024  
**Unique Number** : 11125058      **Diagnosed** : 17 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PQ )

**THE HERSHEY COMPANY**  
 WEST HERSHEY - TECHNICAL ASSURANCE, 1033 OLDE WEST CHOCOLATE  
 HERSHEY, PA  
 US 17033  
 Contact: CLINTON ZOHNER  
 clintzohner@hersheys.com  
 T: (717)374-4846  
 F: (717)374-4594