




# OIL ANALYSIS REPORT

Sample Rating Trend

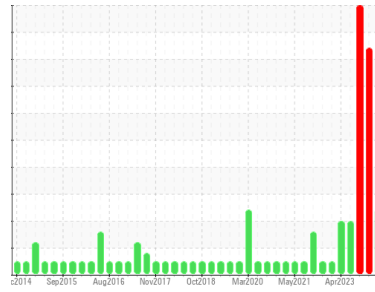

COOL CHEMICALS



Area  
**(YA163155)**

Machine Id  
**10416C**

Component  
**Natural Gas Engine**

Fluid  
**PETRO CANADA DURON GEO LD 15W40 (30 GAL)**

## DIAGNOSIS

### Recommendation

We advise that you check for the source of the coolant leak. Check for low coolant level. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

Sodium and/or potassium levels remain high.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GFL0123361</b>	GFL0123388	GFL0082490
Sample Date	Client Info		<b>02 Jul 2024</b>	20 Jun 2024	14 Nov 2023
Machine Age	hrs	Client Info	<b>98203</b>	98203	98203
Oil Age	hrs	Client Info	<b>98203</b>	98203	98203
Oil Changed	Client Info		<b>Changed</b>	N/A	Changed
Sample Status			<b>ABNORMAL</b>	SEVERE	SEVERE

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>11</b>	21	▲ 78
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	1	3
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >9	<b>&lt;1</b>	2	2
Lead	ppm	ASTM D5185m >30	<b>0</b>	3	2
Copper	ppm	ASTM D5185m >35	<b>19</b>	9	▲ 53
Tin	ppm	ASTM D5185m >4	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	<b>31</b>	8	15
Barium	ppm	ASTM D5185m 5	<b>0</b>	<1	<1
Molybdenum	ppm	ASTM D5185m 50	<b>47</b>	55	59
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	1
Magnesium	ppm	ASTM D5185m 560	<b>553</b>	603	572
Calcium	ppm	ASTM D5185m 1510	<b>1554</b>	1706	1736
Phosphorus	ppm	ASTM D5185m 780	<b>798</b>	828	755
Zinc	ppm	ASTM D5185m 870	<b>928</b>	1087	1016
Sulfur	ppm	ASTM D5185m 2040	<b>2883</b>	3106	2527

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	<b>6</b>	7	14
Sodium	ppm	ASTM D5185m	▲ <b>45</b>	▲ 96	▲ 65
Potassium	ppm	ASTM D5185m >20	▲ <b>192</b>	▲ 816	▲ 398
Glycol	%	*ASTM D2982	---	▲ 0.12	▲ 0.10

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>6.2</b>	10.5	10.4
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>18.7</b>	21.0	22.2


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>15.0</b>	17.0	17.3
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	<b>9.4</b>	7.2	5.9




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

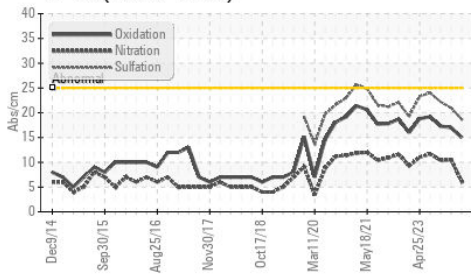


Glycol Contamination

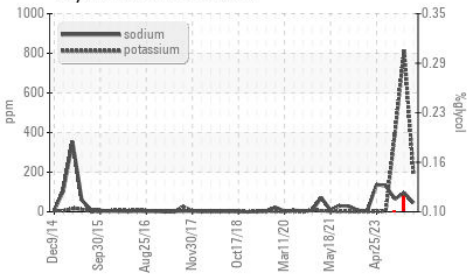

Viscosity @ 100°C

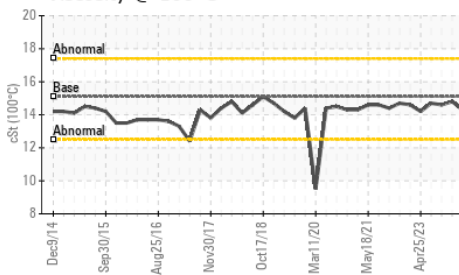

Glycol Contamination

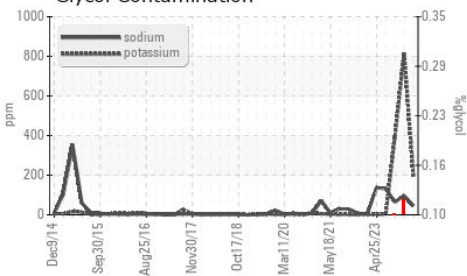


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.3	14.8

## GRAPHS


Ferrous Alloys

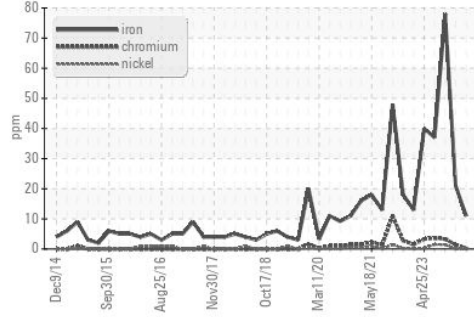


Non-ferrous Metals

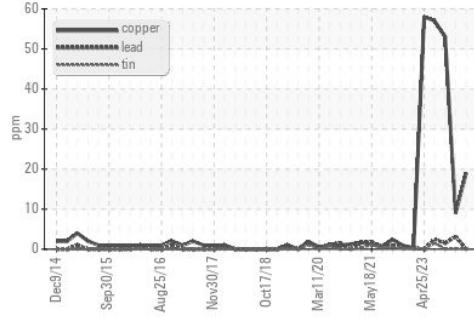

Viscosity @ 100°C

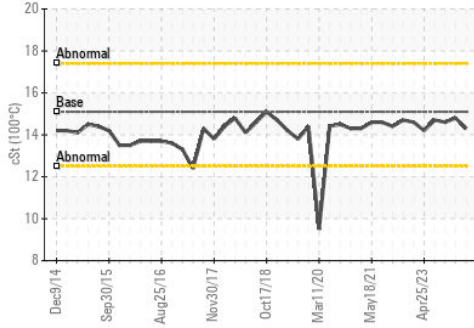

Base Number

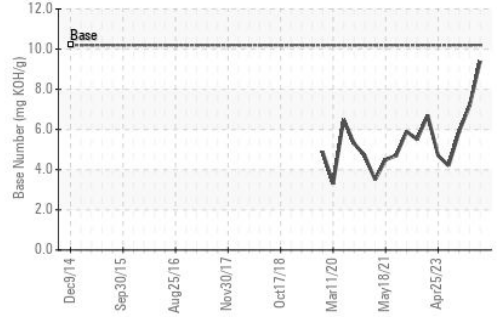

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0123361  
**Lab Number** : 06237534  
**Unique Number** : 11126368  
**Test Package** : FLEET

**GFL Environmental - 007 - Brunswick**  
 2809 Galloway Road  
 Bolivia, NC  
 US 28422  
 Contact: DONALD CRAVEN  
 dcraven@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (910)253-4179