


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

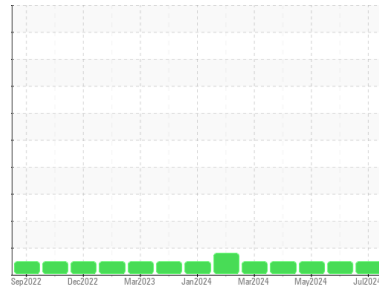

Machine Id
Liberty 1
 Component
Natural Gas Engine
 Fluid
PETRO CANADA SENTRON LD 3000 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Tests indicate that there is no fuel present in the oil. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0117257	PCA0112023	PCA0112019
Sample Date	Client Info		10 Jul 2024	03 Jun 2024	01 May 2024
Machine Age	hrs	Client Info	73287	72428	71644
Oil Age	hrs	Client Info	15077	14218	13434
Oil Changed	Client Info		Not Changed	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	3	2
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m >2	0	0	<1
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	2	3	<1
Lead	ppm	ASTM D5185m >30	0	4	1
Copper	ppm	ASTM D5185m >35	<1	4	<1
Tin	ppm	ASTM D5185m >4	0	1	1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<1	0	0
Barium	ppm	ASTM D5185m 1	0	0	0
Molybdenum	ppm	ASTM D5185m 2	1	4	2
Manganese	ppm	ASTM D5185m 1	0	2	<1
Magnesium	ppm	ASTM D5185m 5	7	8	8
Calcium	ppm	ASTM D5185m 1220	1251	1355	1241
Phosphorus	ppm	ASTM D5185m 298	276	300	288
Zinc	ppm	ASTM D5185m 350	344	367	343
Sulfur	ppm	ASTM D5185m 1995	2221	2848	2616

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	2	3	2
Sodium	ppm	ASTM D5185m	0	2	0
Potassium	ppm	ASTM D5185m >20	5	4	3
Fuel	%	ASTM D3524 >4.0	0.0	0.5	0.0

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624 >20	3.8	3.6	3.5
Sulfation	Abs/.1mm	*ASTM D7415 >30	14.0	13.6	13.6

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	7.6	7.4	7.5
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	0.14	0.35	0.815
Base Number (BN)	mg KOH/g	ASTM D2896 3.9	4.85	3.98	3.73

OIL ANALYSIS REPORT


Fuel Dilution

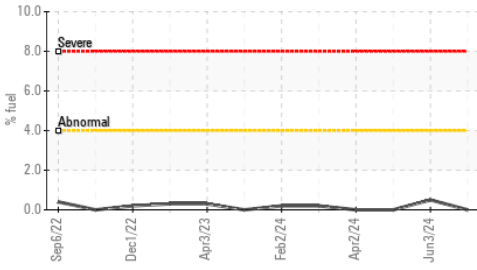


FT-IR (Direct Trend)

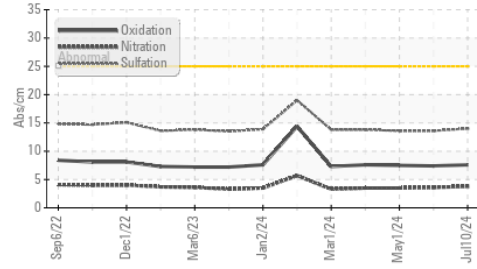


Acid Number

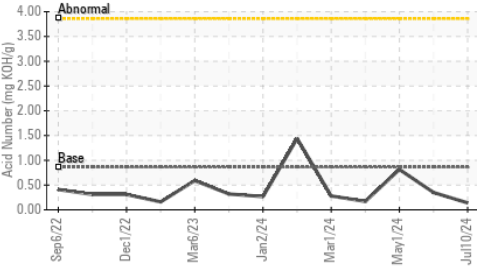

Base Number

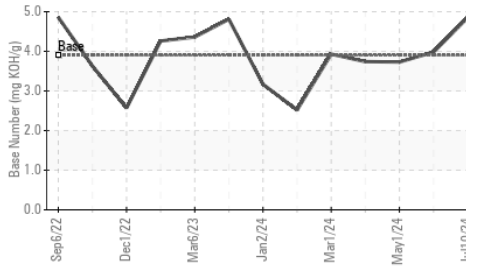

Viscosity @ 100°C

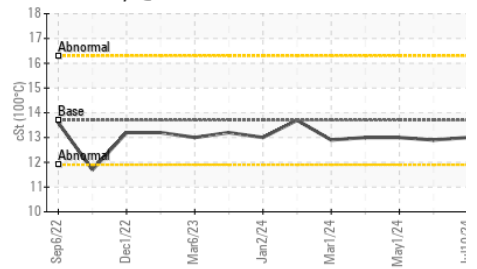


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.7	13.0	12.9

GRAPHS


Iron (ppm)

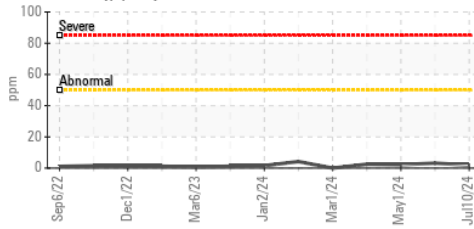


Lead (ppm)

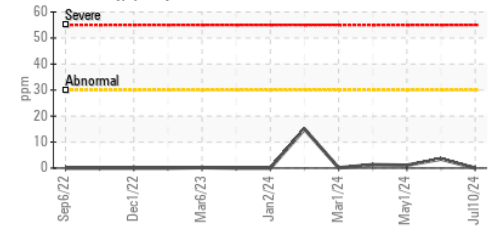


Aluminum (ppm)

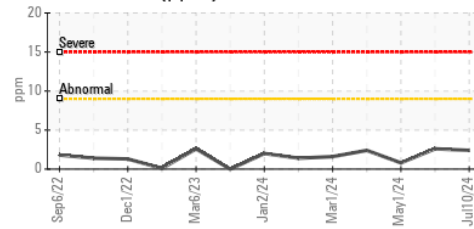


Chromium (ppm)

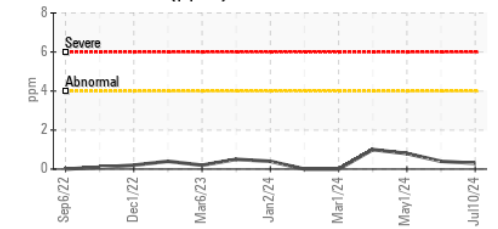


Copper (ppm)

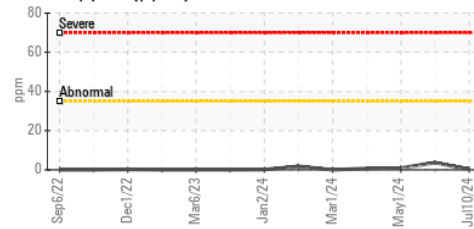


Silicon (ppm)

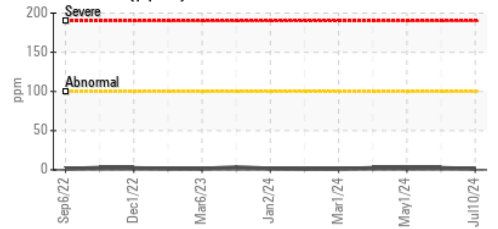

Viscosity @ 100°C

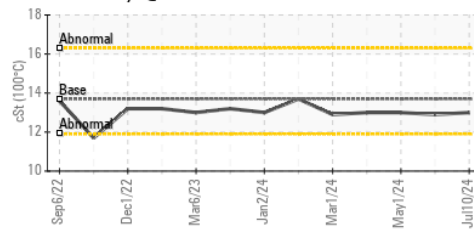

Base Number

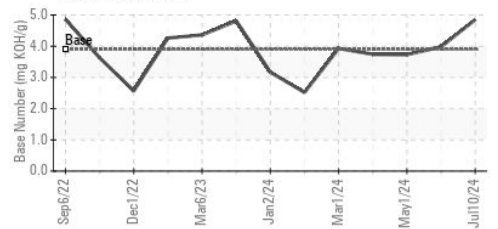

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : PCA0117257

Lab Number : 06238561

Unique Number : 11127395

Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Received : 16 Jul 2024

Tested : 17 Jul 2024

Diagnosed : 17 Jul 2024 - Wes Davis

ENERVEST OPERATING - LIBERTY

318 SINGLETON ROAD

NORA, VA

US 24272

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: