




# OIL ANALYSIS REPORT

Sample Rating Trend

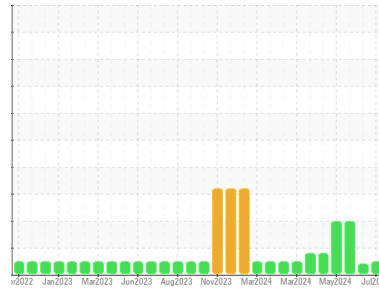

**NORMAL**



Machine Id

**731116**

Component

**Natural Gas Engine**

Fluid

**PETRO CANADA DURON GEO LD 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GFL0124104</b>	GFL0120201	GFL0120164
Sample Date	Client Info		<b>12 Jul 2024</b>	13 Jun 2024	23 May 2024
Machine Age	hrs	Client Info	<b>7393</b>	7189	7051
Oil Age	hrs	Client Info	<b>0</b>	0	1200
Oil Changed	Client Info		<b>Not Changed</b>	Not Changd	Not Changed
Sample Status			<b>NORMAL</b>	ATTENTION	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>19</b>	4	▲ 53
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	4
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	2
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m >9	<b>4</b>	4	8
Lead	ppm	ASTM D5185m >30	<b>0</b>	0	10
Copper	ppm	ASTM D5185m >35	<b>&lt;1</b>	1	2
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	<b>14</b>	44	4
Barium	ppm	ASTM D5185m 5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 50	<b>51</b>	1	58
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	2
Magnesium	ppm	ASTM D5185m 560	<b>556</b>	862	522
Calcium	ppm	ASTM D5185m 1510	<b>1548</b>	1284	1760
Phosphorus	ppm	ASTM D5185m 780	<b>792</b>	745	736
Zinc	ppm	ASTM D5185m 870	<b>964</b>	870	966
Sulfur	ppm	ASTM D5185m 2040	<b>2387</b>	2711	3466

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	<b>7</b>	2	19
Sodium	ppm	ASTM D5185m	<b>3</b>	2	15
Potassium	ppm	ASTM D5185m >20	<b>2</b>	3	3

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>9.9</b>	7.4	12.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>19.5</b>	21.5	28.4


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>16.7</b>	18.3	23.9
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	<b>6.2</b>	9.0	▲ 2.7




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

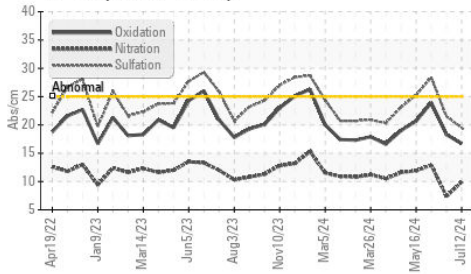

Base Number

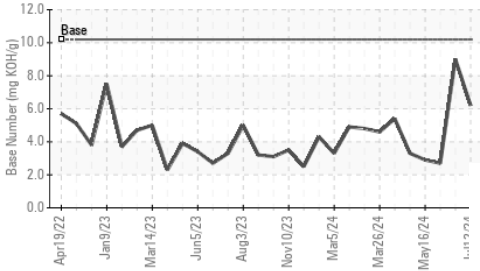

Viscosity @ 100°C

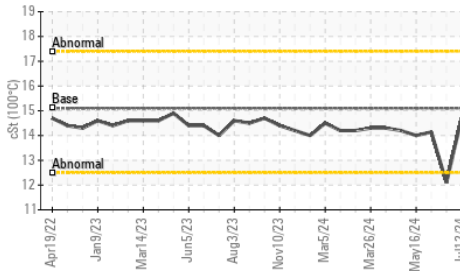


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.7	12.1

## GRAPHS


Ferrous Alloys

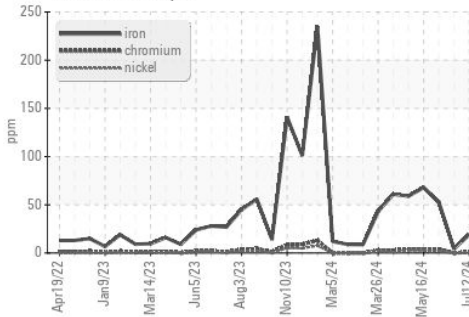


Non-ferrous Metals

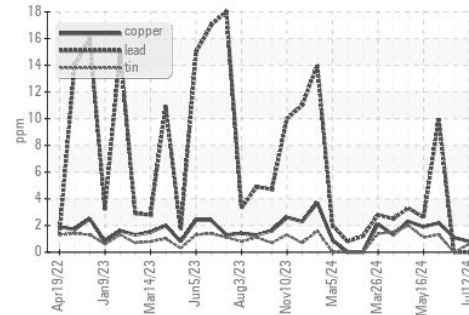

Viscosity @ 100°C

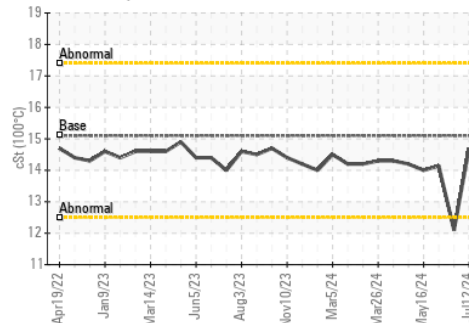

Base Number

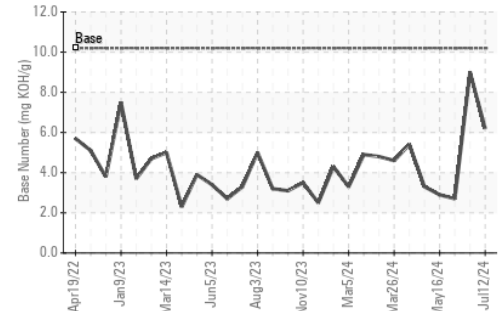

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : GFL0124104  
 Lab Number : 06239847  
 Unique Number : 11128681  
 Test Package : FLEET

GFL Environmental - 836 - Kansas City Hauling  
 7801 East Truman Road  
 Kansas City, MO  
 US 64126  
 Contact: Loyce Stewart  
 loyce.stewart@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: