




OIL ANALYSIS REPORT

Sample Rating Trend

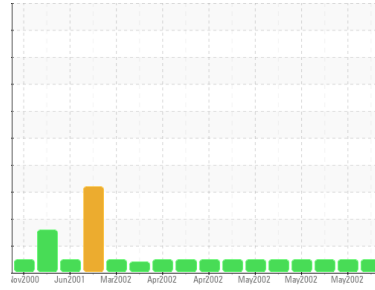

NORMAL



Machine Id
RBK-G1-UGBR/THBR
 Component
Bearing
 Fluid

DIAGNOSIS

- Recommendation**
Resample at the next service interval to monitor.
- Wear**
All component wear rates are normal.
- Contamination**
There is no indication of any contamination in the component.
- Fluid Condition**
The condition of oil is suitable for further service.

SAMPLE INFORMATION



	method	limit/base	current	history1	history2
Sample Number	Client Info		WC549952	WC549899	WC549951
Sample Date	Client Info		07 Jun 2002	29 May 2002	24 May 2002
Machine Age	mths	Client Info	0	0	0
Oil Age	mths	Client Info	18	17	17
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image




OIL ANALYSIS REPORT

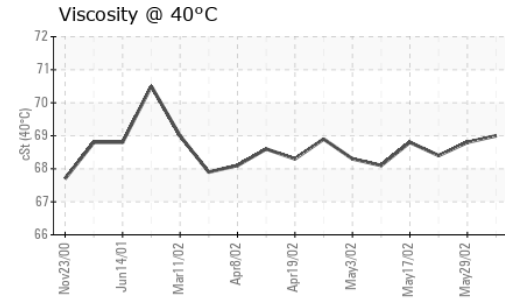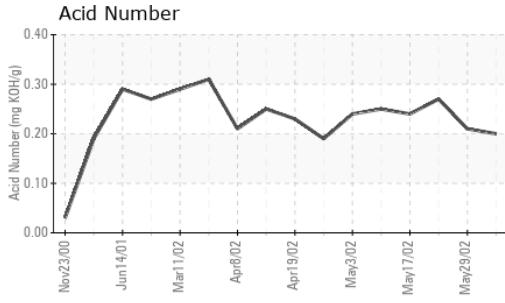


GRAPHS


Ferrous Alloys

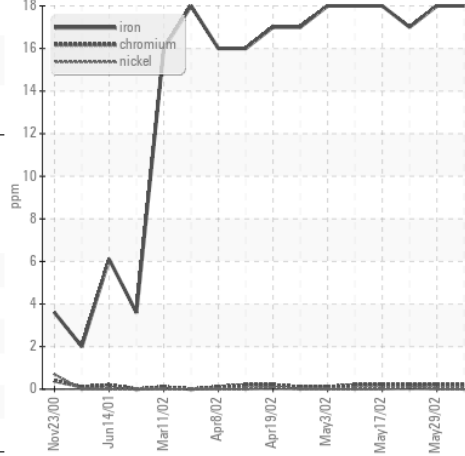


Non-ferrous Metals

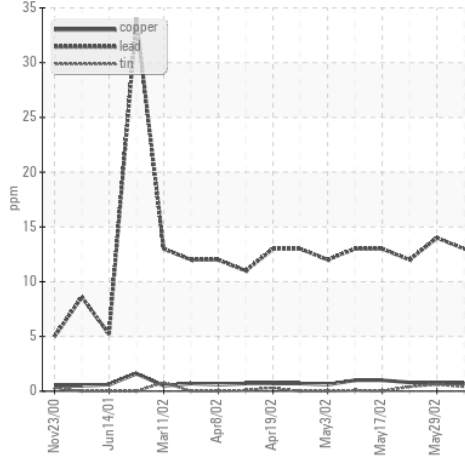

Viscosity @ 40°C

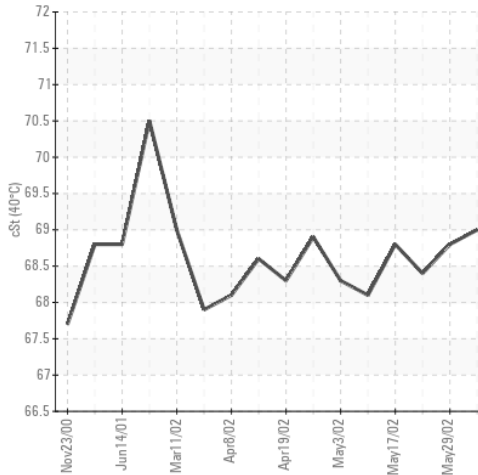

Acid Number

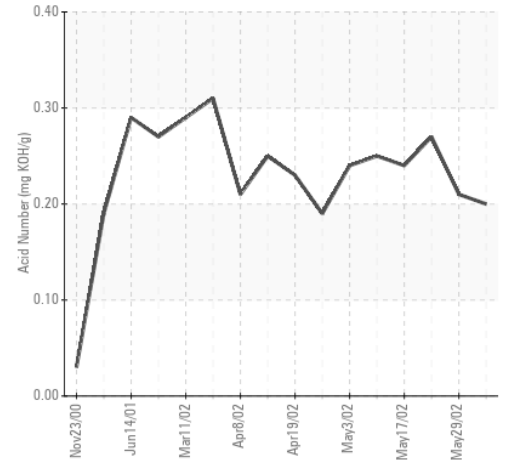

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC549952 **Received** : 12 Jun 2002
Lab Number : 00954099 **Diagnosed** : 13 Jun 2002
Unique Number : 1259693 **Diagnostician** :
Test Package : IND 2

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Shane Reid
 sreid@newfoundlandpower.com
 T: (709)737-5209
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.