




# OIL ANALYSIS REPORT

Sample Rating Trend

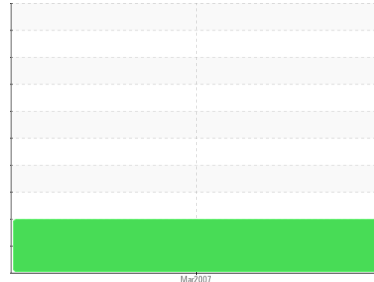

**INSOLUBLES**



Area  
**New Oil**  
 Machine Id  
**NEW OIL #2**  
 Component  
**New (Unused) Oil**  
 Fluid  
**{not provided} (--- LTR)**

## DIAGNOSIS

### ▲ Recommendation

This is a baseline read-out on the submitted sample. We advise that you use electrostatic filtration on this fluid before use.

### ▲ Contamination

There is a high amount of particulates (2 to 15 microns in size) present in the oil.

### Fluid Condition

The viscosity index is 114. The Varnish Potential Rating (VPT) is very high at 90-100.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC727775</b>	---	---
Sample Date	Client Info	<b>01 Mar 2007</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	<b>NEG</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m)	<b>5</b>	---	---
Chromium	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---
Nickel	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---
Titanium	ppm ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---
Aluminum	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---
Lead	ppm ASTM D5185(m)	<b>3</b>	---	---
Copper	ppm ASTM D5185(m)	<b>15</b>	---	---
Tin	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---
Vanadium	ppm ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<b>0</b>	---	---
Barium	ppm ASTM D5185(m)	<b>2</b>	---	---
Molybdenum	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---
Manganese	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---
Magnesium	ppm ASTM D5185(m)	<b>72</b>	---	---
Calcium	ppm ASTM D5185(m)	<b>87</b>	---	---
Phosphorus	ppm ASTM D5185(m)	<b>725</b>	---	---
Zinc	ppm ASTM D5185(m)	<b>693</b>	---	---
Sulfur	ppm ASTM D5185(m)	<b>2787</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	<b>5</b>	---	---
Sodium	ppm ASTM D5185(m)	<b>2</b>	---	---
Potassium	ppm ASTM D5185(m)	<b>0</b>	---	---

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>▲ 53150</b>	---	---
Particles >6µm	ASTM D7647	<b>▲ 7111</b>	---	---
Particles >14µm	ASTM D7647	<b>27</b>	---	---
Particles >21µm	ASTM D7647	<b>7</b>	---	---
Particles >38µm	ASTM D7647	<b>1</b>	---	---
Particles >71µm	ASTM D7647	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	<b>▲ 23/20/12</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	<b>0.727</b>	---	---
MPC Varnish Potential	Scale ASTM D7843(m)*	<b>▲ 57</b>	---	---



# OIL ANALYSIS REPORT

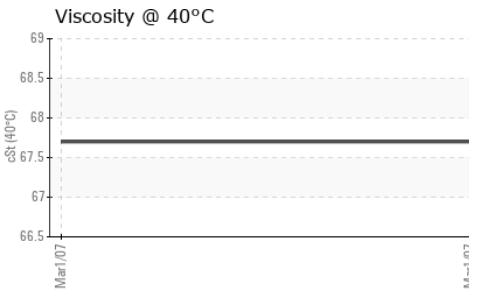
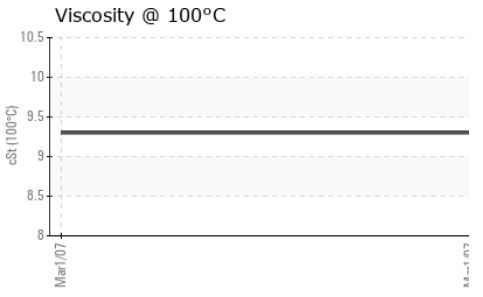
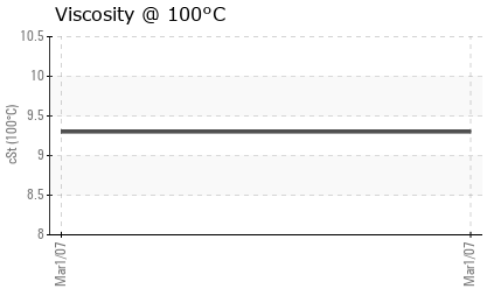
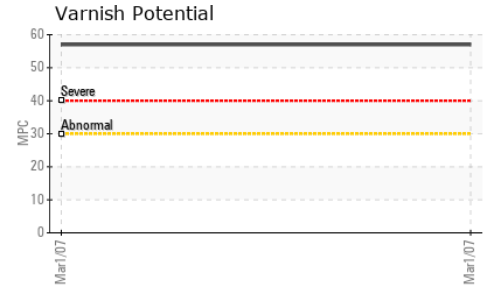
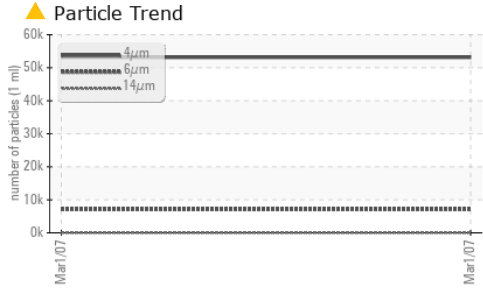


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	NEG	---	---	
Free Water	scalar	Visual*	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	67.7	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	9.3	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	114	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			no image	no image	no image
Bottom			no image	no image	no image
MPC			no image	no image	no image

## GRAPHS

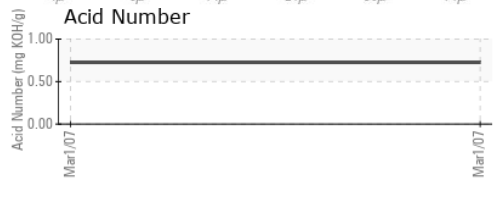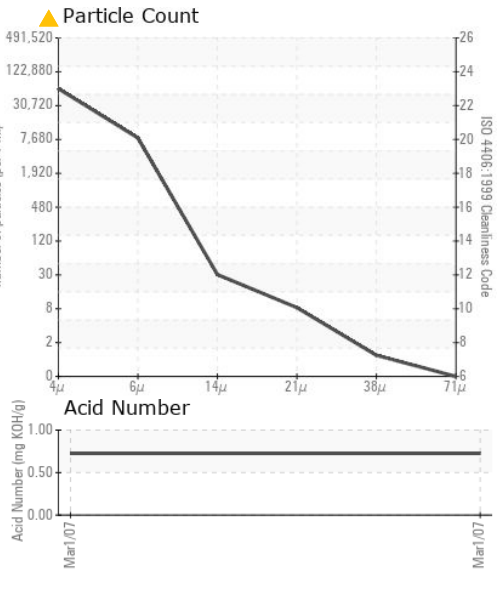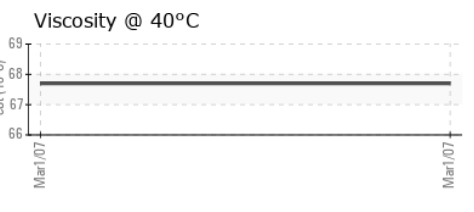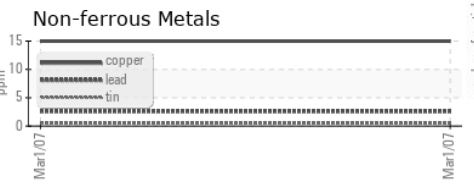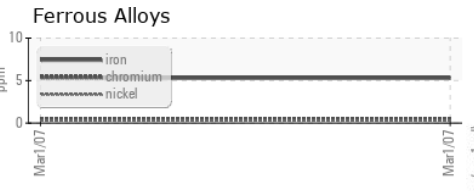

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC727775 **Received** : 01 Mar 2007  
**Lab Number** : **01365485** **Tested** : 06 Mar 2007  
**Unique Number** : 2399890 **Diagnosed** :  
**Test Package** : IND 2 ( Additional Tests: KV100, MPC, PrtCount, TAN Man, VI )  
 To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**ABC Manufacturing**  
 555 NORTH SERVICE ROAD EAST  
 Detroit,  
 US 76100  
 Contact: Jim Smith  
 jim.smith@abcmanufacturing.com  
 T: (311)555-1212  
 F: (311)555-1313

---

Sample Color & Clarity

*This page left intentionally blank*