




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

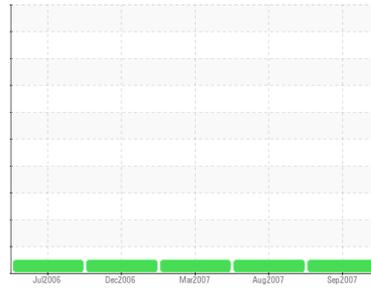

Machine Id
JAX-COMP01, WW-1
 Component
Compressor
 Fluid
MOBIL DTE OIL LIGHT (20 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.

Fluid Condition

The condition of oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			RP47283	RP035134	RP035909
Sample Date	Client Info			17 Sep 2007	02 Aug 2007	21 Mar 2007
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m		<1	<1	<1
Chromium	ppm	ASTM D5185m		0	0	0
Nickel	ppm	ASTM D5185m		0	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m		<1	<1	<1
Lead	ppm	ASTM D5185m		0	0	<1
Copper	ppm	ASTM D5185m		0	<1	<1
Tin	ppm	ASTM D5185m		0	0	0
Antimony	ppm	ASTM D5185m		0	0	5
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	<1	<1
Barium	ppm	ASTM D5185m		0	2	<1
Molybdenum	ppm	ASTM D5185m		0	0	2
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		86	82	90
Calcium	ppm	ASTM D5185m		0	3	<1
Phosphorus	ppm	ASTM D5185m		8	7	15
Zinc	ppm	ASTM D5185m		2	6	7

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m		<1	<1	<1
Sodium	ppm	ASTM D5185m		<1	1	2
Potassium	ppm	ASTM D5185m		1	12	0
Water	%	ASTM D6304		0.006	0.010	0.019

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.409	0.393	0.374

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual		NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG





OIL ANALYSIS REPORT

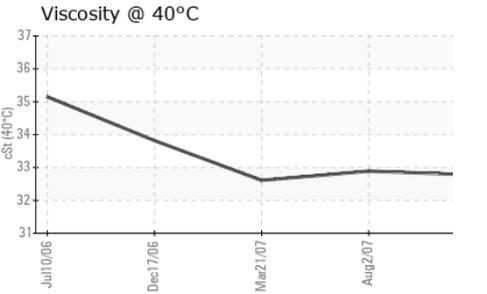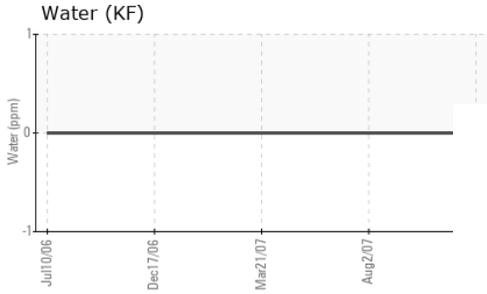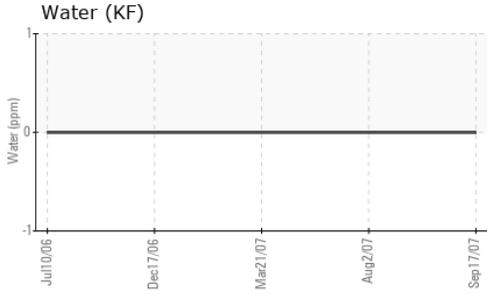

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.77	32.89	32.61

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

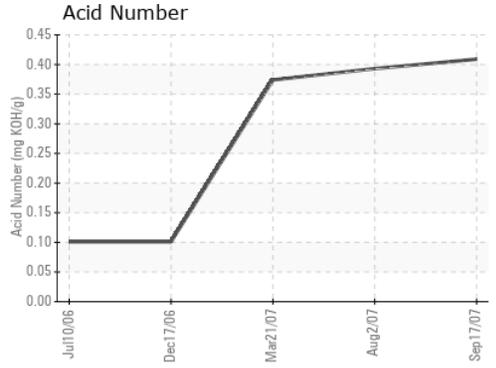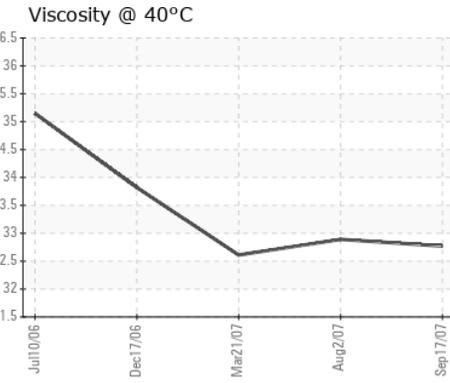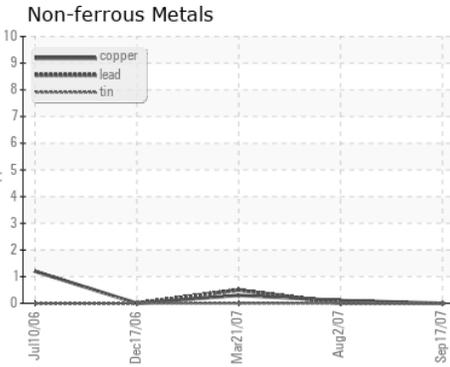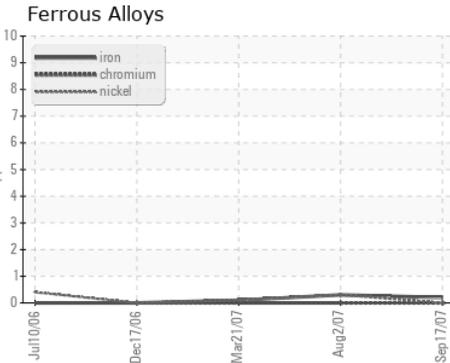

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP47283 **Received** : 18 Sep 2007
Lab Number : 02028843 **Diagnosed** : 20 Sep 2007
Unique Number : 4217604 **Diagnostician** : Doug Bogart
Test Package : IND 2

SYMRISE
 601 CRESTWOOD ST
 JACKSONVILLE, FL
 US 32208
 Contact: ADAM BOVITCH
 ADAM.BOVITCH@SYMRISE.COM
 T: (904)924-2765
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)