




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

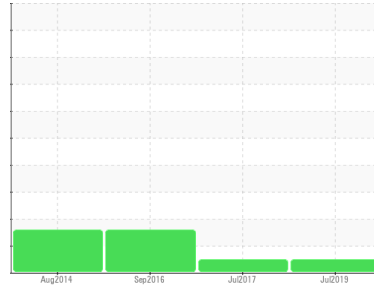

Machine Id
CLARENVILLE

Component
Circulating Diesel Engine

Fluid
CUMMINS CUMMINS BLUE 2000 15W40 (27 LTR)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC985110	WC925437	WC933677
Sample Date	Client Info		05 Jul 2019	05 Jul 2017	15 Sep 2016
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	MARGINAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	0.0

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>100	6	6	5
Chromium	ppm	ASTM D5185(m)	>20	0	<1	<1
Nickel	ppm	ASTM D5185(m)	>2	0	0	0
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	1	1	<1
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>40	<1	<1	1
Copper	ppm	ASTM D5185(m)	>330	3	2	6
Tin	ppm	ASTM D5185(m)	>15	<1	<1	<1
Antimony	ppm	ASTM D5185(m)		0	1	1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	1.7	1	2	1
Barium	ppm	ASTM D5185(m)	0.1	0	<1	<1
Molybdenum	ppm	ASTM D5185(m)	0.0	43	44	39
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)	12	771	865	809
Calcium	ppm	ASTM D5185(m)	2946	1236	1281	1194
Phosphorus	ppm	ASTM D5185(m)	1002	1001	1089	960
Zinc	ppm	ASTM D5185(m)	1288	1211	1259	1201
Sulfur	ppm	ASTM D5185(m)	5265	3123	3205	2924
Lithium	ppm	ASTM D5185(m)		0	<1	<1

CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	4	4	3
Sodium	ppm	ASTM D5185(m)		4	4	4
Potassium	ppm	ASTM D5185(m)	>20	<1	1	1

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	7.0	7.6	7.1
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.3	20.5	20.7




OIL ANALYSIS REPORT

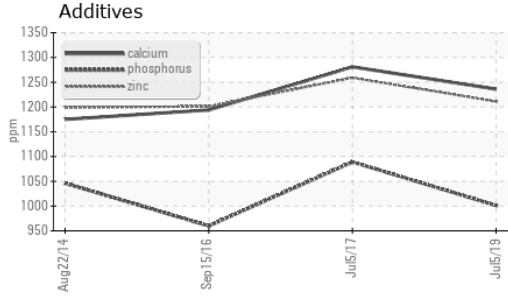










FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.4	13.4	15.7
Base Number (BN)	mg KOH/g	ASTM D2896*	11.0	8.00	8.14	8.83

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	▲ .2%
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	15.3	13.1	13.1	13.2

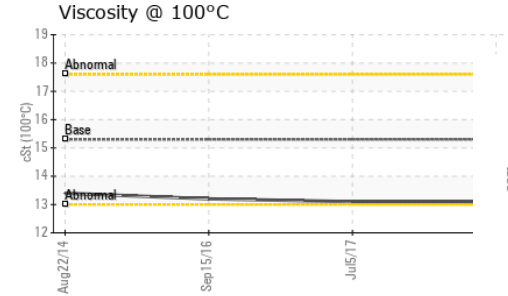

GRAPHS

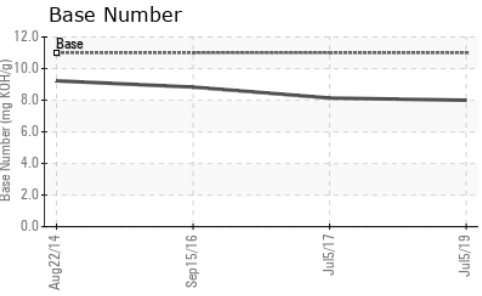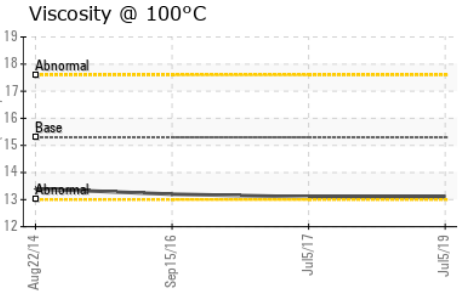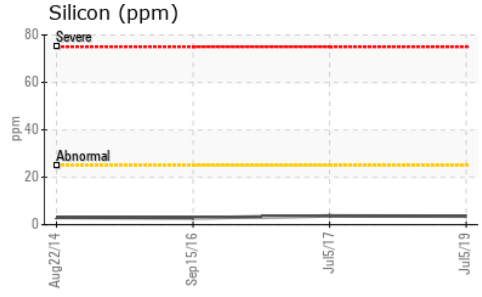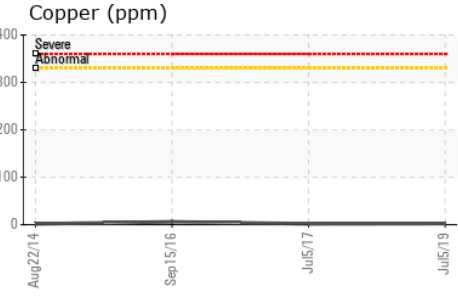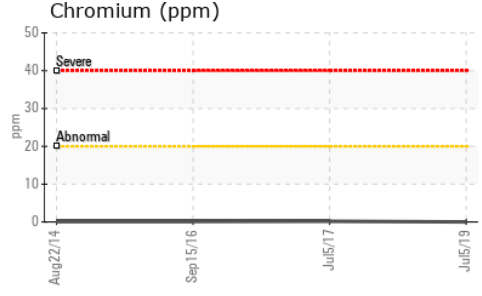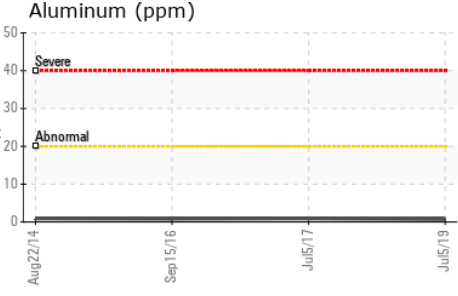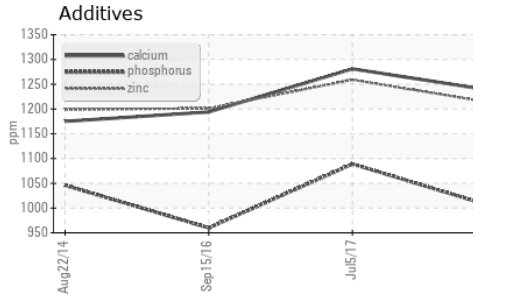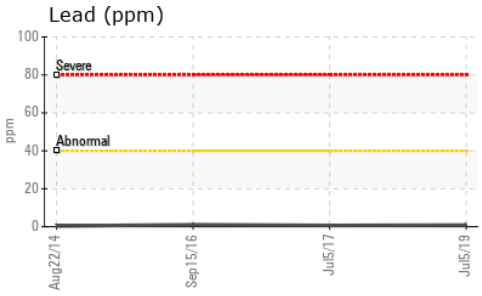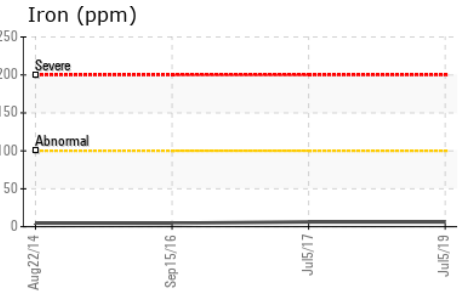

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC985110 **Received** : 12 Jul 2019
Lab Number : **02296597** **Diagnosed** : 12 Jul 2019
Unique Number : 4899870 **Diagnostician** : Bill Quesnel
Test Package : MOB 2

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Paul Martin
 pmartin@newfoundlandpower.com
 T:
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.