




OIL ANALYSIS REPORT

Sample Rating Trend

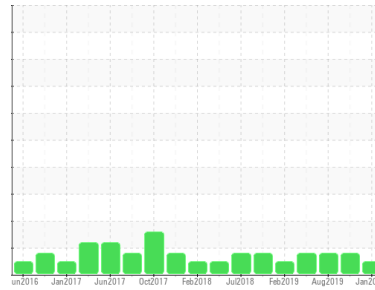

NORMAL



Machine Id
Emergency Generator (S/N 40601268)
 Component
Diesel Engine
 Fluid
PETRO CANADA DURON HP 15W40 (30 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

Contaminants

There is no indication of any contamination in the oil.

Oil Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0380406 | WC0380417 | WC0380396 |
| Sample Date | Client Info | | 08 Jan 2020 | 14 Nov 2019 | 13 Aug 2019 |
| Machine Age | hrs | Client Info | 1339 | 1336 | 1306 |
| Oil Age | hrs | Client Info | 5 | 28 | 226 |
| Oil Changed | Client Info | | Not Chngd | Not Chngd | Changed |
| Sample Status | | | NORMAL | MARGINAL | MARGINAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >5 | <1.0 | ▲ 3.8 | ▲ 2.2 |
| Water | WC Method | >0.2 | NEG | NEG | NEG |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|-----------|-------------|--------------------|--------------|----------|----------|
| PQ | ASTM D8184* | | 0 | 6 | 9 |
| Iron | ppm | ASTM D5185(m) >80 | <1 | 2 | 13 |
| Chromium | ppm | ASTM D5185(m) >4 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185(m) >4 | 0 | 0 | <1 |
| Titanium | ppm | ASTM D5185(m) | <1 | <1 | <1 |
| Silver | ppm | ASTM D5185(m) | 1 | 0 | 0 |
| Aluminum | ppm | ASTM D5185(m) >10 | <1 | <1 | <1 |
| Lead | ppm | ASTM D5185(m) >15 | 0 | <1 | <1 |
| Copper | ppm | ASTM D5185(m) >230 | <1 | <1 | 3 |
| Tin | ppm | ASTM D5185(m) >4 | 0 | 0 | <1 |
| Antimony | ppm | ASTM D5185(m) | <1 | <1 | <1 |
| Vanadium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|--------------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185(m) 0 | 1 | 2 | 16 |
| Barium | ppm | ASTM D5185(m) 0 | 0 | <1 | <1 |
| Molybdenum | ppm | ASTM D5185(m) 60 | 58 | 56 | 52 |
| Manganese | ppm | ASTM D5185(m) 0 | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185(m) 1010 | 954 | 915 | 761 |
| Calcium | ppm | ASTM D5185(m) 1070 | 1022 | 998 | 1319 |
| Phosphorus | ppm | ASTM D5185(m) 1150 | 1013 | 989 | 994 |
| Zinc | ppm | ASTM D5185(m) 1270 | 1185 | 1156 | 1171 |
| Sulfur | ppm | ASTM D5185(m) 2060 | 2619 | 2555 | 2451 |
| Lithium | ppm | ASTM D5185(m) | <1 | <1 | <1 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|-------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185(m) >25 | 3 | 2 | 2 |
| Sodium | ppm | ASTM D5185(m) | <1 | <1 | <1 |
| Potassium | ppm | ASTM D5185(m) >20 | 0 | 0 | <1 |


INFRA-RED

| | method | limit/base | current | history1 | history2 |
|-----------|----------|-----------------|-------------|----------|----------|
| Soot % | % | ASTM D7844* >3 | 0 | 0 | 0 |
| Nitration | Abs/cm | ASTM D7624* >20 | 5.2 | 5.3 | 8.1 |
| Sulfation | Abs./1mm | ASTM D7415* >30 | 21.5 | 20.9 | 23.1 |




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

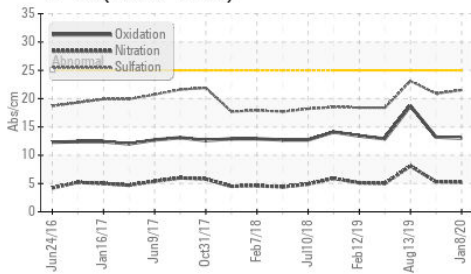


Base Number

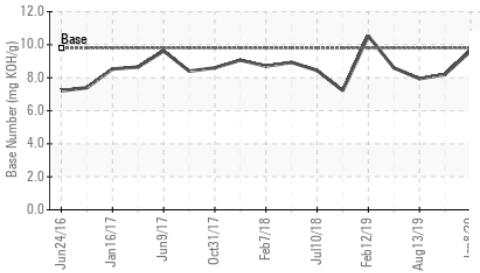

Viscosity @ 100°C

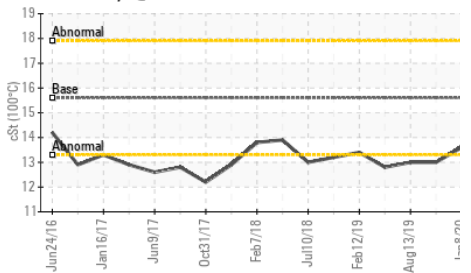

PQ

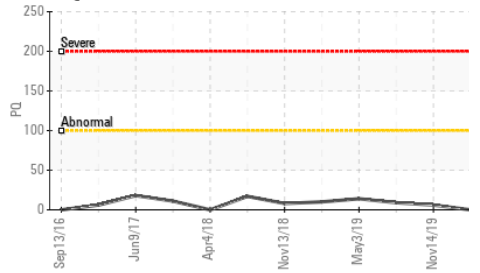


| FLUID DEGRADATION | method | limit/base | current | history1 | history2 | |
|-------------------|----------|-------------|---------|-------------|----------|------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 13.0 | 13.2 | 18.7 |
| Base Number (BN) | mg KOH/g | ASTM D2896* | 9.8 | 9.62 | 8.20 | 7.94 |

| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|------------|----------|-----|
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|---------------|---------|-------------|----------|------|
| Visc @ 100°C | cSt | ASTM D7279(m) | 15.6 | 13.6 | 13.0 | 13.0 |

GRAPHS


Ferrous Alloys

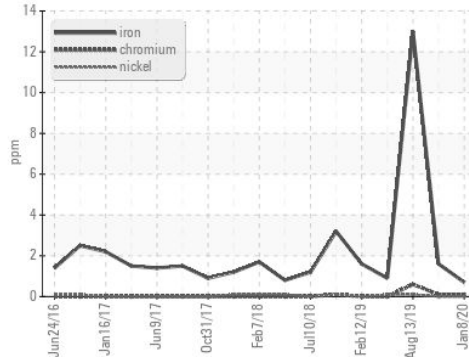


Non-ferrous Metals

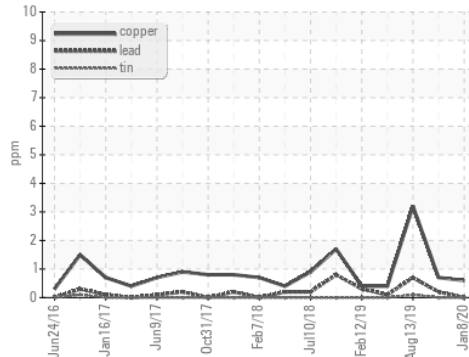


Viscosity @ 100°C

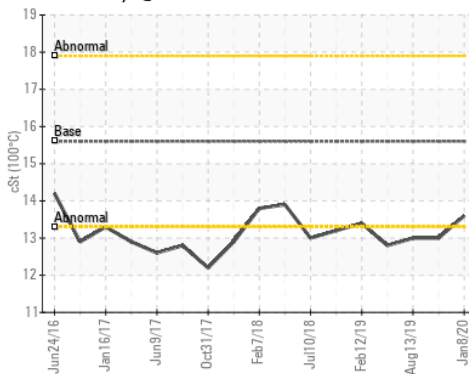

PQ

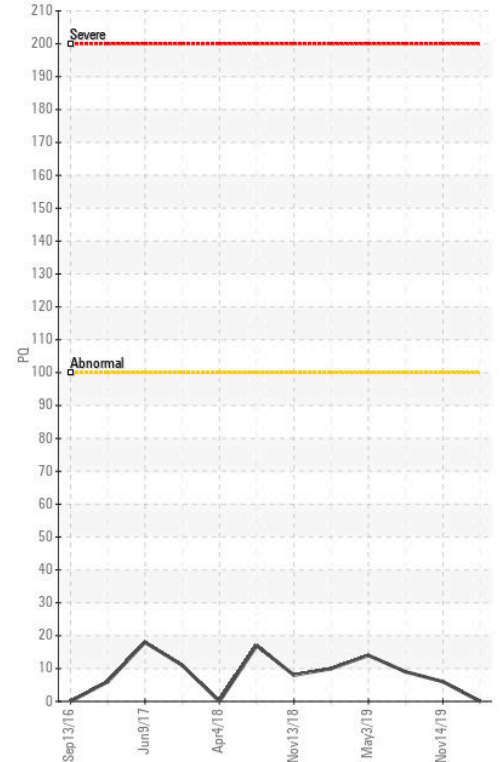

Base Number

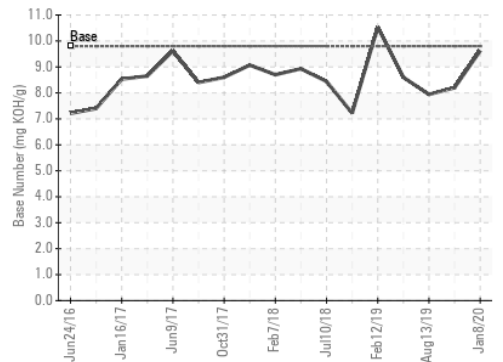

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0380406
Lab Number : 02331377
Unique Number : 4990683
Test Package : MAR 3




CANADIAN COAST GUARD
 CCGS GRIFFON, PO BOX 1000, 401 KING ST.W
 Prescott, ON
 CA K6V 5T3
 Contact: Laurie Bosley
 Laurie.Bosley@dfo-mpo.gc.ca

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
 F: (519)383-1994

FERROGRAPHY REPORT

Machine Id
Emergency Generator (S/N 40601268)
 Component
Diesel Engine
 Fluid
PETRO CANADA DURON HP 15W40 (30 LTR)

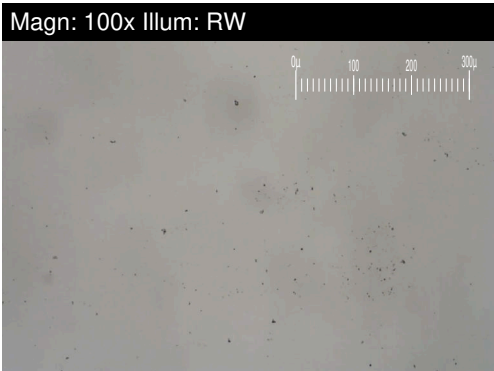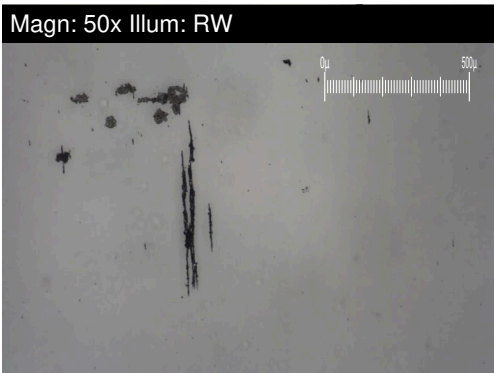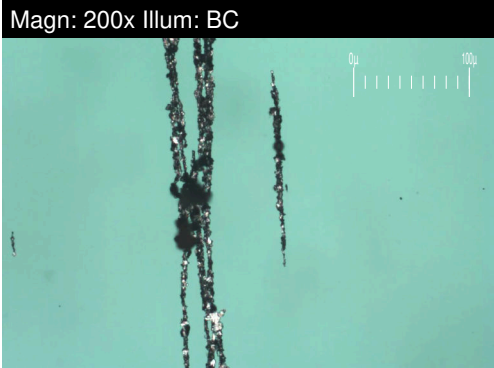


| DR-FERROGRAPHY | | method | limit/base | current | history1 | history2 |
|----------------------------|---|----------|------------|-------------|----------|----------|
| Large Particles | | DR-Ferr* | | 13.1 | 7.8 | 8.9 |
| Small Particles | | DR-Ferr* | | 8.1 | 4.6 | 6.9 |
| Total Particles | | DR-Ferr* | >--- | 21.2 | 12.4 | 15.8 |
| Large Particles Percentage | % | DR-Ferr* | | 23.6 | 25.8 | 12.7 |
| Severity Index | | DR-Ferr* | | 6550 | 25 | 17.8 |

| FERROGRAPHY | | method | limit/base | current | history1 | history2 |
|-----------------------|------------|-------------|------------|----------|----------|----------|
| Ferrous Rubbing | Scale 0-10 | ASTM D7684* | | 2 | 2 | 2 |
| Ferrous Sliding | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Cutting | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Rolling | Scale 0-10 | ASTM D7684* | | 1 | 1 | 1 |
| Ferrous Break-in | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Spheres | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Black Oxides | Scale 0-10 | ASTM D7684* | | 1 | | |
| Ferrous Red Oxides | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Corrosive | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Other | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Rubbing | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Sliding | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Cutting | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Rolling | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Other | Scale 0-10 | ASTM D7684* | | | | |
| Carbonaceous Material | Scale 0-10 | ASTM D7684* | | 1 | | |
| Lubricant Degradation | Scale 0-10 | ASTM D7684* | | | | |
| Sand/Dirt | Scale 0-10 | ASTM D7684* | | 1 | 1 | 1 |
| Fibres | Scale 0-10 | ASTM D7684* | | | | |
| Spheres | Scale 0-10 | ASTM D7684* | | | | |
| Other | Scale 0-10 | ASTM D7684* | | 2 | 1 | 1 |

WEAR

All component wear rates are normal.
 The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

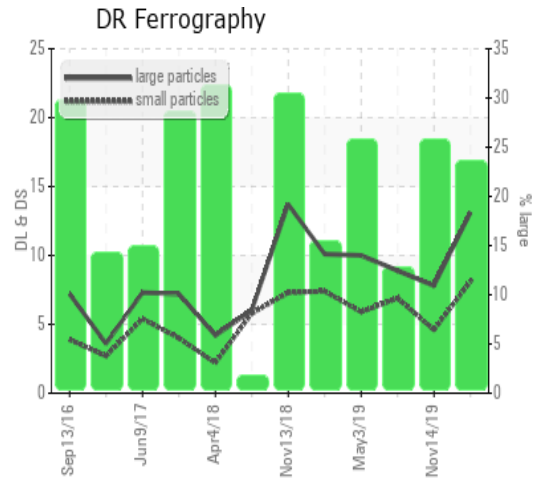

This page left intentionally blank