


OIL ANALYSIS REPORT

Sample Rating Trend





PHR G2 GOV

Component

Governor System

MOBIL DTE OIL HVY MEDIUM (--- GAL)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.


Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


n2002 Jan2005 Jan2008 Jan2010 Jan2012 Jan2014 Mar2016 Jan2016 Jan20									
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2			
Sample Number		Client Info		WC0316828	WC0299327	WC985150			
Sample Date		Client Info		13 Jan 2020	29 Aug 2019	09 Jan 2019			
Machine Age	hrs	Client Info		0	0	0			
Oil Age	hrs	Client Info		0	0	0			
Oil Changed		Client Info		N/A	N/A	N/A			
Sample Status				NORMAL	NORMAL	NORMAL			
CONTAMINATION		method	limit/base	current	history1	history2			
Water		WC Method	>0.1	NEG	NEG	NEG			
WEAR METALS		method	limit/base	current	history1	history2			
PQ		ASTM D8184*		6	6	13			
Iron	ppm	ASTM D5185(m)	>50	<1	<1	<1			
Chromium	ppm	ASTM D5185(m)		0	0	0			
Nickel	ppm	ASTM D5185(m)		0	0	0			
Titanium	ppm	ASTM D5185(m)		0	0	0			
Silver	ppm	ASTM D5185(m)		0	0	0			
Aluminum	ppm	ASTM D5185(m)	>3	<1	0	0			
Lead	ppm	ASTM D5185(m)	>75	<1	0	<1			
Copper	ppm	ASTM D5185(m)	>15	<1	<1	0			
Tin	ppm	ASTM D5185(m)	>55	0	0	0			
Antimony	ppm	ASTM D5185(m)		<1	<1	0			
Vanadium	ppm	ASTM D5185(m)		0	0	0			
Beryllium	ppm	ASTM D5185(m)		0	0	0			
Cadmium	ppm	ASTM D5185(m)		<1	<1	<1			
ADDITIVES		method	limit/base	current	history1	history2			
Boron	ppm	ASTM D5185(m)		<1	0	0			
Barium	ppm	ASTM D5185(m)		<1	<1	0			
Molybdenum	ppm	ASTM D5185(m)		0	0	0			
Manganese	ppm	ASTM D5185(m)		0	0	<1			
Magnesium	ppm	ASTM D5185(m)		<1	0	0			
Calcium	ppm	ASTM D5185(m)		<1	<1	<1			
Phosphorus	ppm	ASTM D5185(m)		8	2	4			
Zinc	ppm	ASTM D5185(m)		4	1	1			
Sulfur	ppm	ASTM D5185(m)		1121	1145	1117			
Lithium	ppm	ASTM D5185(m)		<1	<1	0			
CONTAMINANTS	5	method	limit/base	current	history1	history2			
Silicon	ppm	ASTM D5185(m)	>8	0	0	0			
Sodium	ppm	ASTM D5185(m)		0	0	0			
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	0			



OIL ANALYSIS REPORT

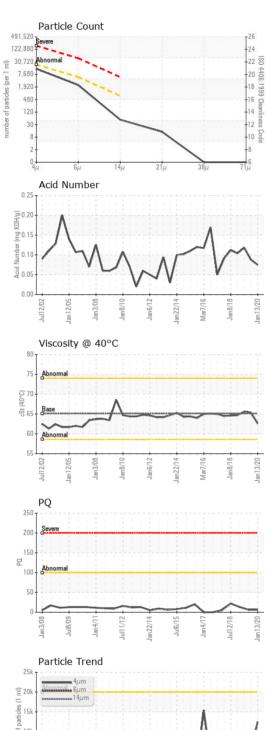

FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>20000	12488	4998	2735
Particles >6µm		ASTM D7647	>5000	2080	731	244
Particles >14μm		ASTM D7647	>640	46	30	28
Particles >21µm		ASTM D7647	>160	12	10	12
Particles >38μm		ASTM D7647	>40	0	0	0
Particles >71μm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	21/18/13	19/17/12	19/15/12
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.075	0.088	0.118
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	65.1	62.6	65.3	65.6
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						
Bottom						



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number Unique Number : 4991867

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : WC0316828 Received : 17 Jan 2020

: 02332561 Diagnosed : 21 Jan 2020 Diagnostician : Kevin Marson Test Package : IND 2 (Additional Tests: PRTCOUNT)

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC. 50 DUFFY PLACE, PO BOX 8910

ST. JOHNS, NL CA A1B 3P6

Contact: Paul Martin pmartin@newfoundlandpower.com

F: (709)737-2926

T: