




# OIL ANALYSIS REPORT

Sample Rating Trend

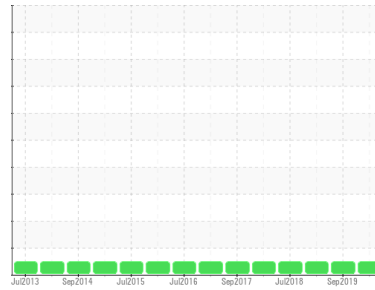

**NORMAL**



Machine Id  
**PHR-G2-GEBR**

Component  
**Bearing**

Fluid  
**MOBIL DTE OIL LIGHT (--- GAL)**

## DIAGNOSIS

### Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0299340</b>	WC0299334	WC982574
Sample Date	Client Info			<b>13 Jan 2020</b>	27 Sep 2019	09 Jan 2019
Machine Age	days	Client Info		<b>0</b>	0	0
Oil Age	days	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	<b>NEG</b>	NEG	NEG






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>5</b>	7	6
Iron	ppm	ASTM D5185(m)	>63	<b>0</b>	0	0
Chromium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185(m)	>161	<b>62</b>	62	57
Copper	ppm	ASTM D5185(m)	>13	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185(m)	>27	<b>1</b>	1	<1
Antimony	ppm	ASTM D5185(m)		<b>2</b>	2	1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>0</b>	0	0
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m)		<b>0</b>	<1	1
Zinc	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Sulfur	ppm	ASTM D5185(m)		<b>1262</b>	1282	1199
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>12	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	0



# OIL ANALYSIS REPORT

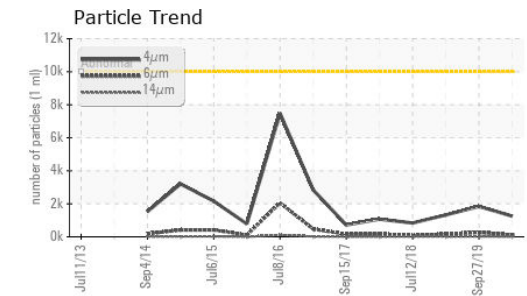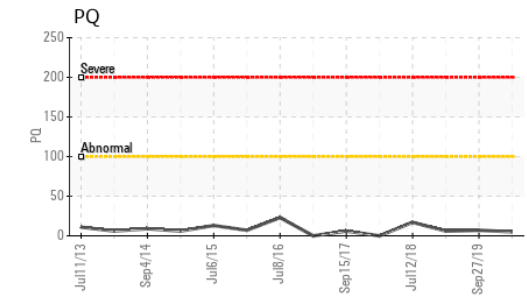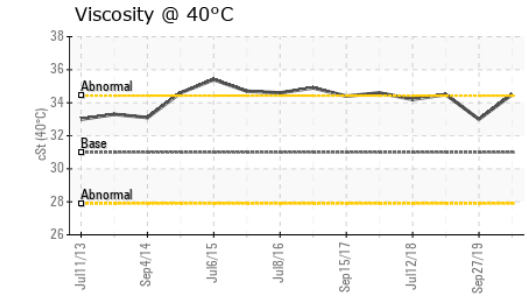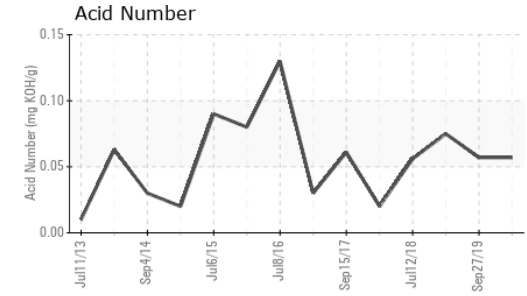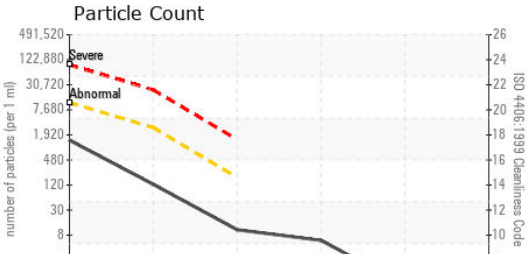


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>1255</b>	1842	1323
Particles >6µm	ASTM D7647	>2500	<b>110</b>	271	164
Particles >14µm	ASTM D7647	>160	<b>9</b>	25	15
Particles >21µm	ASTM D7647	>40	<b>5</b>	6	3
Particles >38µm	ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	<b>17/14/10</b>	18/15/12	18/15/11

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*		<b>0.057</b>	0.057	0.075

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar Visual*	>2	<b>NEG</b>	NEG	NEG
Free Water	scalar Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	31	<b>34.5</b>	33.0	34.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

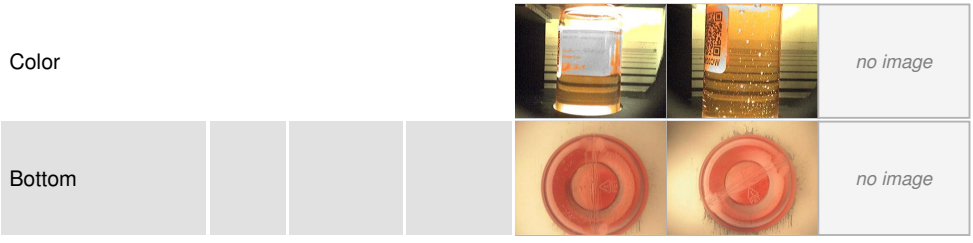

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0299340  
**Lab Number** : **02332585**  
**Unique Number** : 4991891  
**Test Package** : IND 2 ( Additional Tests: PrtCount )  
**Received** : 17 Jan 2020  
**Diagnosed** : 21 Jan 2020  
**Diagnostician** : Kevin Marson

**NEWFOUNDLAND POWER INC.**  
 50 DUFFY PLACE, PO BOX 8910  
 ST. JOHNS, NL  
 CA A1B 3P6  
 Contact: Paul Martin  
 pmartin@newfoundlandpower.com  
 T: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.