




# OIL ANALYSIS REPORT

Sample Rating Trend

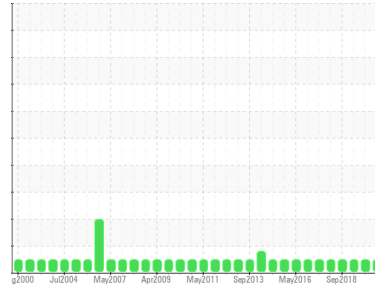

**NORMAL**



Area  
**WQR [58333]**  
 Machine Id  
**CATHGEN5BRGLOW (S/N 211148-1)**  
 Component  
**Lower Bearing**  
 Fluid  
**ESSO TERESSO ISO 68 (11 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0312904</b>	WC970697	WC942164
Sample Date	Client Info		<b>02 Mar 2020</b>	10 Sep 2019	09 Mar 2019
Machine Age	hrs	Client Info	<b>116499</b>	24	24
Oil Age	hrs	Client Info	<b>0</b>	2	1
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>9</b>	10	10
Iron	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >20	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185(m) >20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 4.5	<b>&lt;1</b>	<1	0
Barium	ppm	ASTM D5185(m) 0.4	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m) 0.7	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	1
Sulfur	ppm	ASTM D5185(m) 1315	<b>2554</b>	2594	2574
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	0

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>2</b>	2	2
Sodium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304* >2	<b>0.001</b>	0.001	0.002
ppm Water	ppm	ASTM D6304*	<b>1.1</b>	18.2	21.7

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1418</b>	2347	5677
Particles >6µm	ASTM D7647	>2500	<b>178</b>	423	817
Particles >14µm	ASTM D7647	>160	<b>10</b>	22	50
Particles >21µm	ASTM D7647	>40	<b>5</b>	8	13
Particles >38µm	ASTM D7647	>10	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/14	<b>18/15/10</b>	18/16/12	20/17/13



# OIL ANALYSIS REPORT

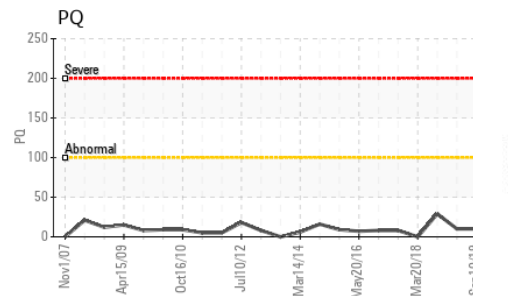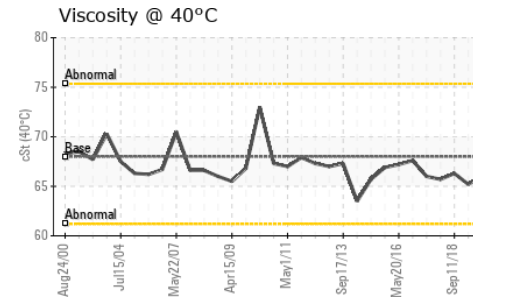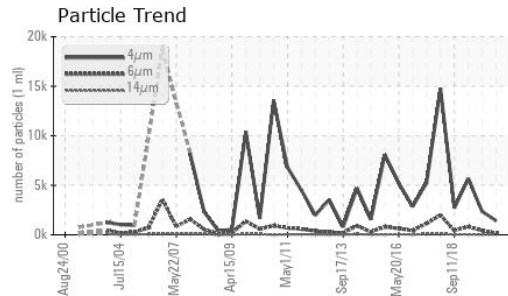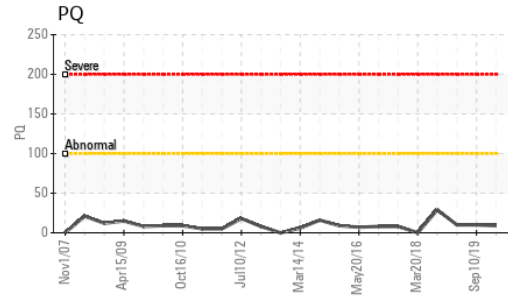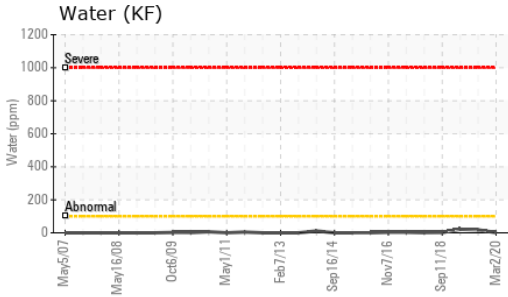


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	<b>0.028</b>	0.031	0.041






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	VLITE	VLITE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	<b>65.9</b>	66.0	65.2

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

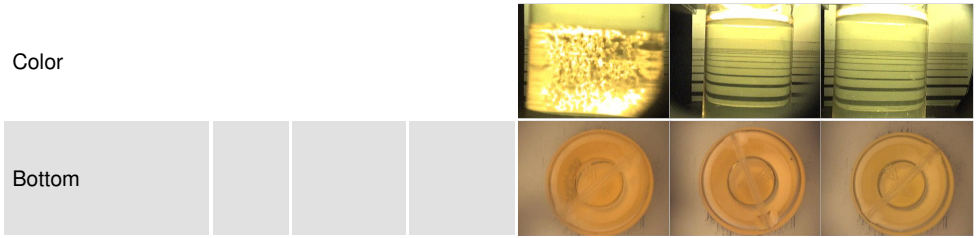

## GRAPHS

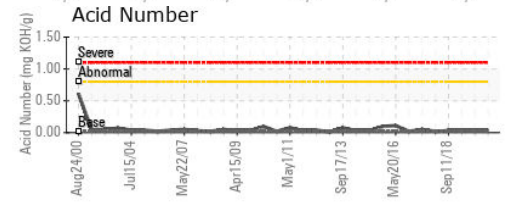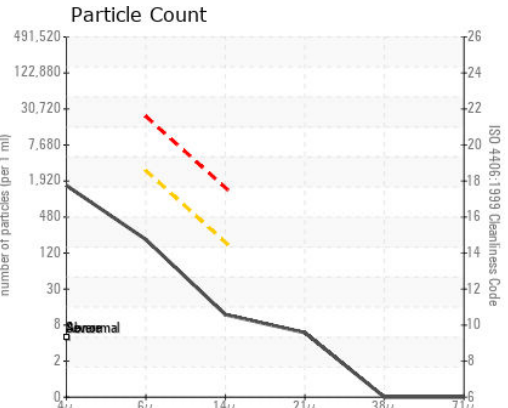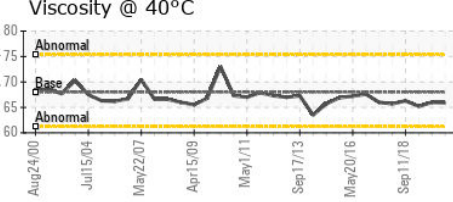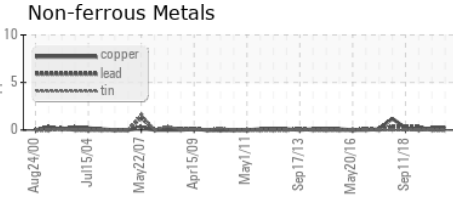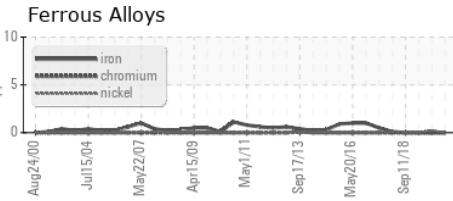

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **ALGONQUIN POWER SYSTEMS INC.**  
**Sample No.** : WC0312904 **Received** : 05 Mar 2020 **354 DAVIS ROAD**  
**Lab Number** : **02341691** **Diagnosed** : 06 Mar 2020 **OAKVILLE, ON**  
**Unique Number** : 5017119 **Diagnostician** : Wes Davis **CA L6J 2X1**  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount ) **Contact: Antonino Champ Fernando**  
 To discuss this sample report, contact Customer Service at 1-800-268-2131. **antoninoChamp.fernando@algonquinpower.com**  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. **T: (905)465-7065**  
 Validity of results and interpretation are based on the sample and information as supplied. **F: x:**