


OIL ANALYSIS REPORT

T



NORMAL



MOBIL & TERESSO MIXED 505

Component

Unknown Component

MOBIL & TERESSO MIXED 50:50 RATIO (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

Viscosity of sample indicates oil is within ISO 68 range, advise investigate. The AN level is acceptable for this fluid. The condition of the sample is suitable for further service.


LTR)							
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2	
Sample Number		Client Info		WC0316868			
Sample Date		Client Info		08 Mar 2020			
Machine Age	hrs	Client Info		0			
Oil Age	hrs	Client Info		0			
Oil Changed		Client Info		N/A			
Sample Status				NORMAL			
WEAR METALS		method	limit/base	current	history1	history2	
PQ		ASTM D8184*		5			
Iron	ppm	ASTM D5185(m)		0			
Chromium	ppm	ASTM D5185(m)		0			
Nickel	ppm	ASTM D5185(m)		0			
Titanium	ppm	ASTM D5185(m)		0			
Silver	ppm	ASTM D5185(m)		0			
Aluminum	ppm	ASTM D5185(m)		<1			
Lead	ppm	ASTM D5185(m)		0			
Copper	ppm	ASTM D5185(m)		<1			
Tin	ppm	ASTM D5185(m)		0			
Antimony	ppm	ASTM D5185(m)		<1			
Vanadium	ppm	ASTM D5185(m)		0			
Beryllium	ppm	ASTM D5185(m)		0			
Cadmium	mag	ASTM D5185(m)		0			

Cadmium	ppm	A91IVI D3103(III)		U		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		0		
Barium	ppm	ASTM D5185(m)		<1		
Molybdenum	ppm	ASTM D5185(m)		0		
Manganese	ppm	ASTM D5185(m)		0		
Magnesium	ppm	ASTM D5185(m)		0		
Calcium	ppm	ASTM D5185(m)		<1		
Phosphorus	ppm	ASTM D5185(m)		73		
Zinc	ppm	ASTM D5185(m)		44		
Sulfur	ppm	ASTM D5185(m)		2041		
Lithium	ppm	ASTM D5185(m)		<1		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)		<1		
Sodium	ppm	ASTM D5185(m)		0		

Potassium	ppm	ASTM D5185(m)	>20	<1		
FLUID CLEANLII	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	1037		
Particles >6µm		ASTM D7647	>1300	180		
Particles >14μm		ASTM D7647	>160	12		
Particles >21µm		ASTM D7647	>40	5		
Particles >38μm		ASTM D7647	>10	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/15/11		



OIL ANALYSIS REPORT

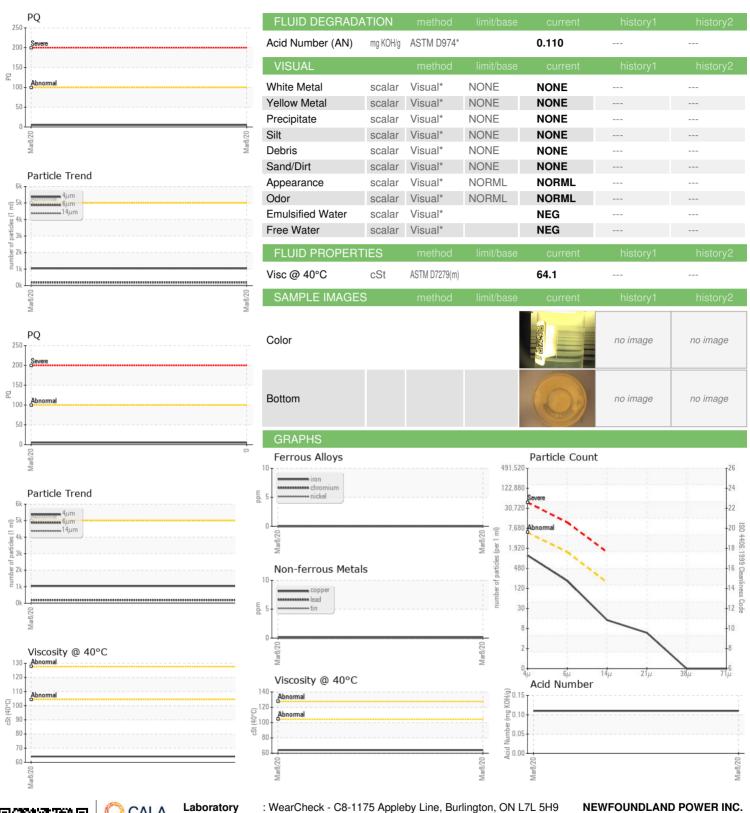



CALA ISO 17025:2017 Accredited

Laboratory

Laboratory Sample No. Lab Number **Unique Number**

: WC0316868

: 02342329

Received : 09 Mar 2020 Diagnosed : 11 Mar 2020 : Kevin Marson Diagnostician

: 5017757 Test Package : IND 2 (Additional Tests: PrtCount) To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC.

50 DUFFY PLACE, PO BOX 8910 ST. JOHNS, NL CA A1B 3P6

Contact: Paul Martin pmartin@newfoundlandpower.com

F: (709)737-2926

T: