




OIL ANALYSIS REPORT

Sample Rating Trend

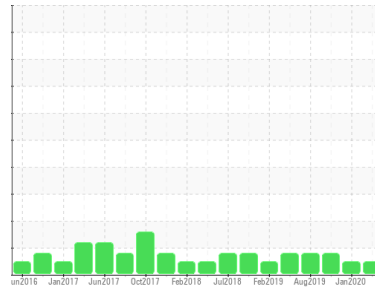

NORMAL



Machine Id
Emergency Generator (S/N 40601268)
 Component
Diesel Engine
 Fluid
PETRO CANADA DURON HP 15W40 (30 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0380433 | WC0380406 | WC0380417 |
| Sample Date | Client Info | | 08 Mar 2020 | 08 Jan 2020 | 14 Nov 2019 |
| Machine Age | hrs | Client Info | 1362 | 1339 | 1336 |
| Oil Age | hrs | Client Info | 4 | 5 | 28 |
| Oil Changed | Client Info | | Not Changed | Not Changed | Not Changed |
| Sample Status | | | NORMAL | NORMAL | MARGINAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >5 | <1.0 | <1.0 | ▲ 3.8 |
| Water | WC Method | >0.2 | NEG | NEG | NEG |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|--------------|----------|----|
| Iron | ppm | ASTM D5185(m) | >80 | <1 | <1 | 2 |
| Chromium | ppm | ASTM D5185(m) | >4 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185(m) | >4 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Silver | ppm | ASTM D5185(m) | | 0 | 1 | 0 |
| Aluminum | ppm | ASTM D5185(m) | >10 | <1 | <1 | <1 |
| Lead | ppm | ASTM D5185(m) | >15 | 0 | 0 | <1 |
| Copper | ppm | ASTM D5185(m) | >230 | <1 | <1 | <1 |
| Tin | ppm | ASTM D5185(m) | >4 | 0 | 0 | 0 |
| Antimony | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 | |
|------------|--------|---------------|---------|--------------|----------|------|
| Boron | ppm | ASTM D5185(m) | 0 | 2 | 1 | 2 |
| Barium | ppm | ASTM D5185(m) | 0 | 0 | 0 | <1 |
| Molybdenum | ppm | ASTM D5185(m) | 60 | 57 | 58 | 56 |
| Manganese | ppm | ASTM D5185(m) | 0 | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185(m) | 1010 | 925 | 954 | 915 |
| Calcium | ppm | ASTM D5185(m) | 1070 | 1031 | 1022 | 998 |
| Phosphorus | ppm | ASTM D5185(m) | 1150 | 1018 | 1013 | 989 |
| Zinc | ppm | ASTM D5185(m) | 1270 | 1182 | 1185 | 1156 |
| Sulfur | ppm | ASTM D5185(m) | 2060 | 2631 | 2619 | 2555 |
| Lithium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|--------------|----------|----|
| Silicon | ppm | ASTM D5185(m) | >25 | 3 | 3 | 2 |
| Sodium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Potassium | ppm | ASTM D5185(m) | >20 | <1 | 0 | 0 |


INFRA-RED

| | method | limit/base | current | history1 | history2 | |
|-----------|----------|-------------|---------|-------------|----------|------|
| Soot % | % | ASTM D7844* | >3 | 0 | 0 | 0 |
| Nitration | Abs/cm | ASTM D7624* | >20 | 5.3 | 5.2 | 5.3 |
| Sulfation | Abs./1mm | ASTM D7415* | >30 | 21.4 | 21.5 | 20.9 |




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

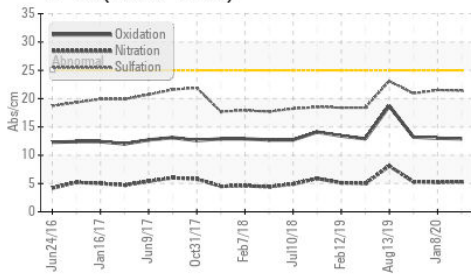

Base Number

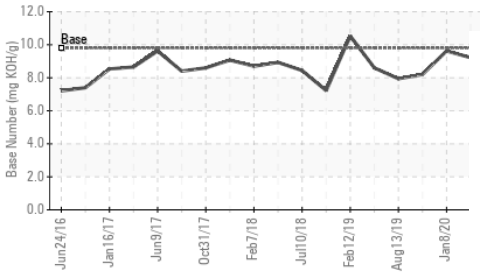

Viscosity @ 100°C

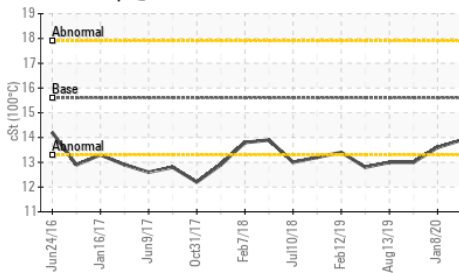


| FLUID DEGRADATION | method | limit/base | current | history1 | history2 |
|-------------------|----------|-------------|---------|----------|----------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 12.9 | 13.0 |
| Base Number (BN) | mg KOH/g | ASTM D2896* | 9.8 | 9.22 | 8.20 |

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG |
| Free Water | scalar | Visual* | NEG | NEG | NEG |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|---------------|---------|----------|----------|
| Visc @ 100°C | cSt | ASTM D7279(m) | 15.6 | 13.9 | 13.6 |

GRAPHS


Ferrous Alloys

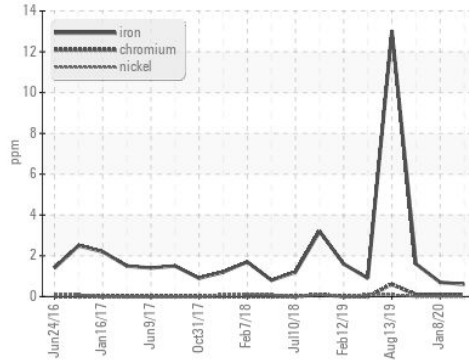


Non-ferrous Metals

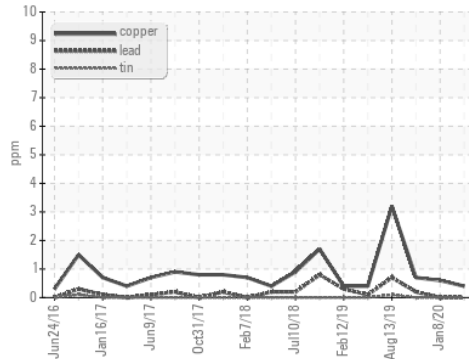

Viscosity @ 100°C

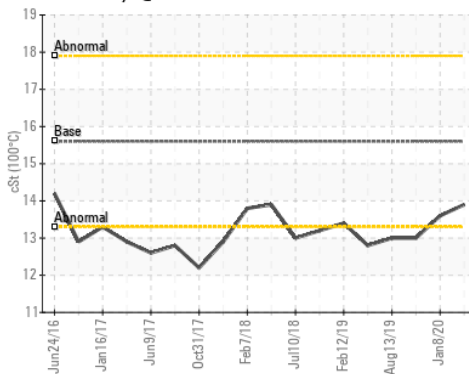

Base Number

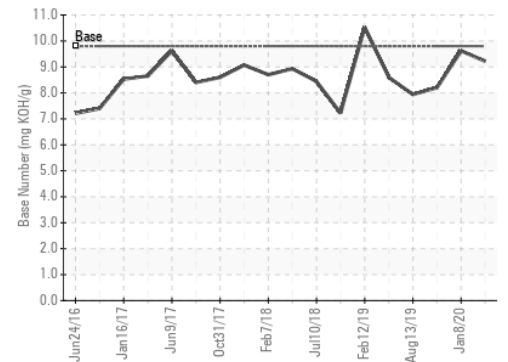

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0380433
Lab Number : 02342598
Unique Number : 5018026
Test Package : MAR 2
Received : 10 Mar 2020
Tested : 10 Mar 2020
Diagnosed : 10 Mar 2020 - Wes Davis

CANADIAN COAST GUARD
 CCGS GRIFFON, PO BOX 1000, 401 KING ST.W
 Prescott, ON
 CA K6V 5T3
 Contact: Laurie Bosley
 Laurie.Bosley@dfo-mpo.gc.ca

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

F: (519)383-1994