




OIL ANALYSIS REPORT

Sample Rating Trend

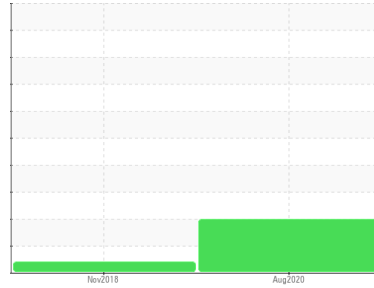

DEGRADATION



Machine Id
LSGS SLUICE GATE 2

Component
Pump Hydraulic System
Fluid
BIOFLO AWS 2 (80 GAL)

DIAGNOSIS

Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

Nickel ppm levels are abnormal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is above the recommended limit. The oil is no longer serviceable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0373463	WC985026	---
Sample Date	Client Info		12 Aug 2020	14 Nov 2018	---
Machine Age	yrs	Client Info	218	159	---
Oil Age	yrs	Client Info	218	159	---
Oil Changed	Client Info		Not Chngd	Not Chngd	---
Sample Status			ABNORMAL	ATTENTION	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>20	2	<1	---
Chromium	ppm	ASTM D5185(m)	>20	<1	0	---
Nickel	ppm	ASTM D5185(m)	>20	▲ 22	<1	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	0	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	---
Lead	ppm	ASTM D5185(m)	>20	2	1	---
Copper	ppm	ASTM D5185(m)	>20	17	3	---
Tin	ppm	ASTM D5185(m)	>20	0	0	---
Antimony	ppm	ASTM D5185(m)		<1	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
Beryllium	ppm	ASTM D5185(m)		0	0	---
Cadmium	ppm	ASTM D5185(m)		0	0	---

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		2	<1	---
Barium	ppm	ASTM D5185(m)		<1	0	---
Molybdenum	ppm	ASTM D5185(m)		<1	<1	---
Manganese	ppm	ASTM D5185(m)		0	<1	---
Magnesium	ppm	ASTM D5185(m)		<1	<1	---
Calcium	ppm	ASTM D5185(m)		16	24	---
Phosphorus	ppm	ASTM D5185(m)		250	242	---
Zinc	ppm	ASTM D5185(m)		28	35	---
Sulfur	ppm	ASTM D5185(m)		1146	1172	---
Lithium	ppm	ASTM D5185(m)		<1	0	---

CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>15	<1	<1	---
Sodium	ppm	ASTM D5185(m)		0	1	---
Potassium	ppm	ASTM D5185(m)	>20	<1	2	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	3947	▲ 7808	---
Particles >6µm	ASTM D7647	>1300	1156	1244	---
Particles >14µm	ASTM D7647	>160	68	63	---
Particles >21µm	ASTM D7647	>40	16	19	---
Particles >38µm	ASTM D7647	>10	1	0	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	19/17/13	▲ 20/17/13	---



OIL ANALYSIS REPORT

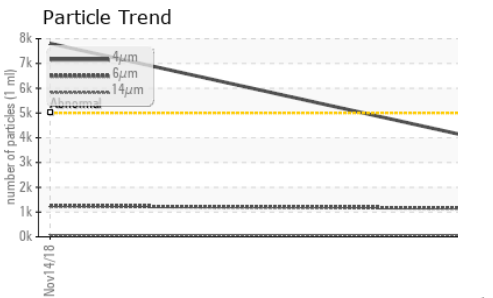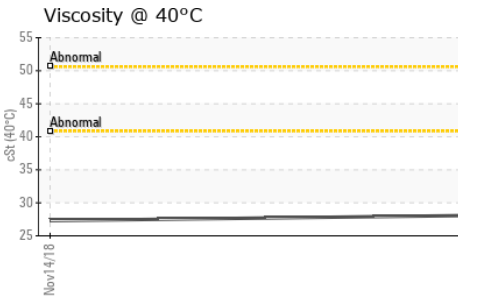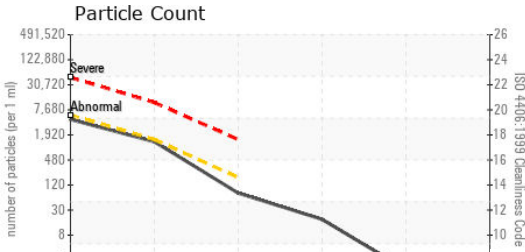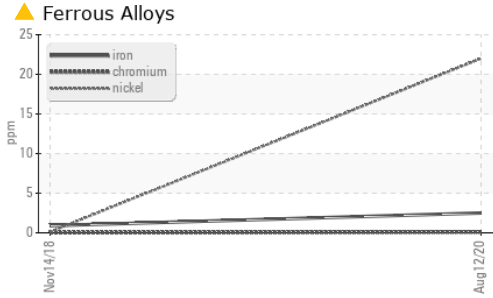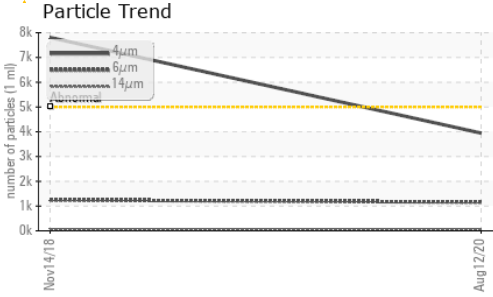


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	▲ 2.49	1.26	---






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.05	NEG	---
Free Water	scalar	Visual*	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	28.1	27.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

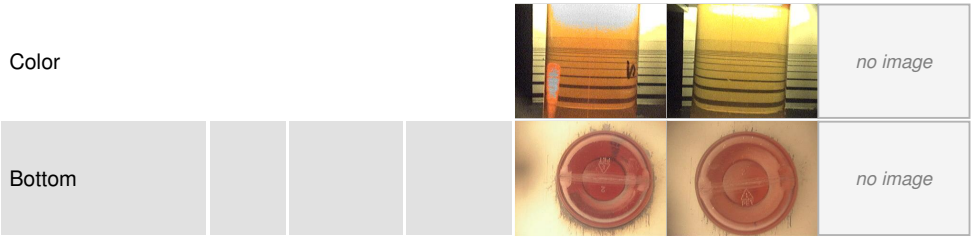

GRAPHS

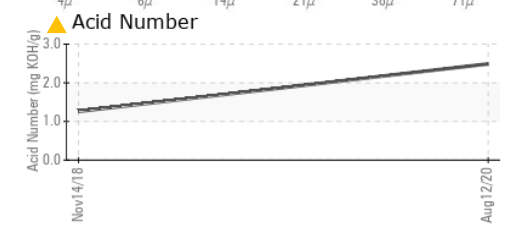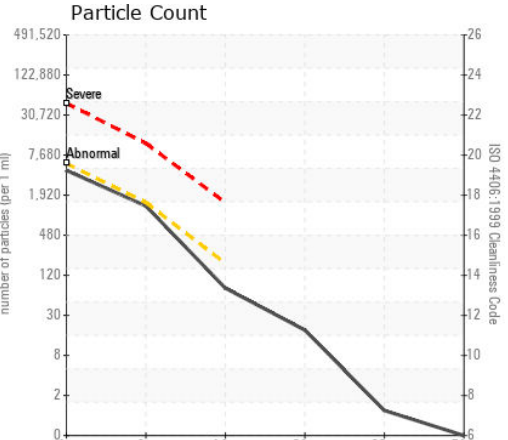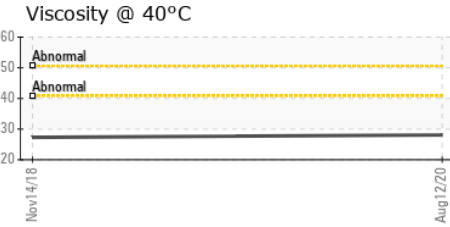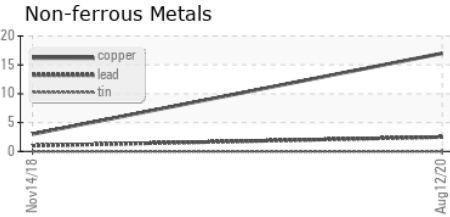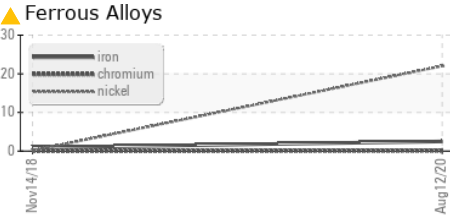

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 Sample No. : WC0373463
 Lab Number : 02373505
 Unique Number : 5096953
 Test Package : IND 2

PETERBOROUGH UTILITIES INC
 1867 ASHBURNHAM DRIVE
 PETERBOROUGH, ON
 CA K9L 1P8
 Contact: Nelson Ross
 nross@pui.ca
 T: (705)760-6119
 F: (705)748-3138

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.