


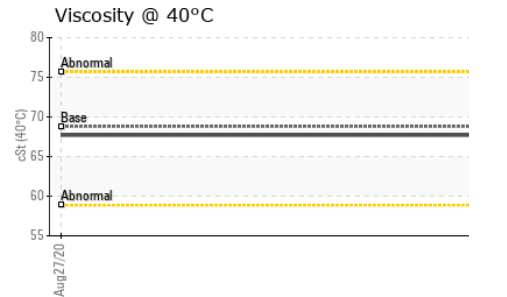


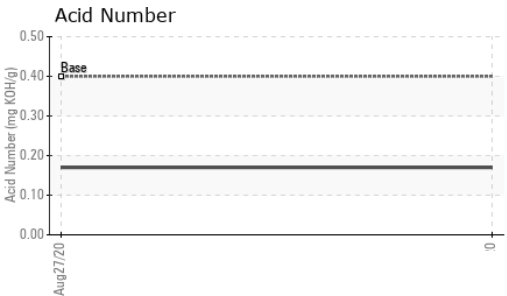

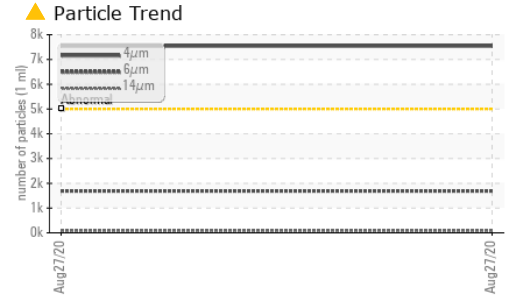

# OIL ANALYSIS REPORT

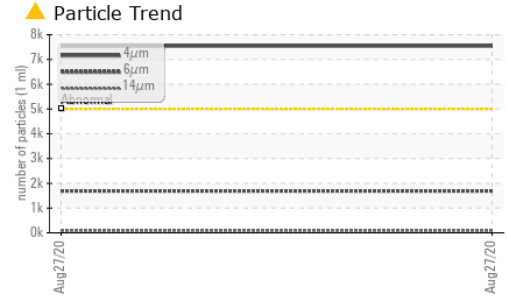





FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	.40	<b>0.17</b>	---	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	Visual*	>0.05	<b>NEG</b>	---	---
Free Water	scalar	Visual*		<b>NEG</b>	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68.8	<b>67.7</b>	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

### GRAPHS

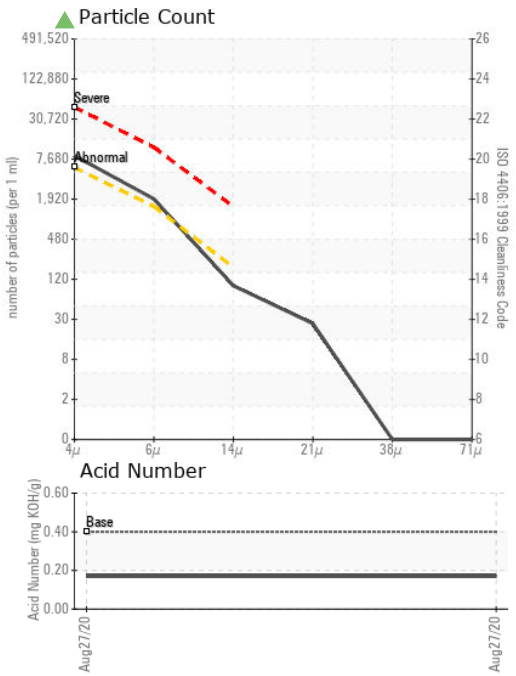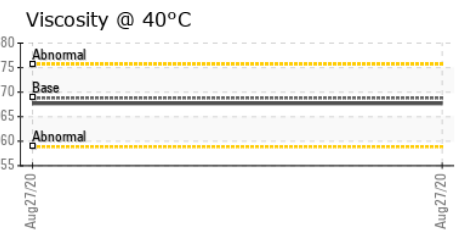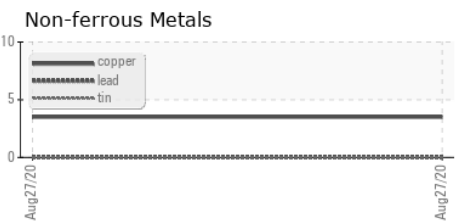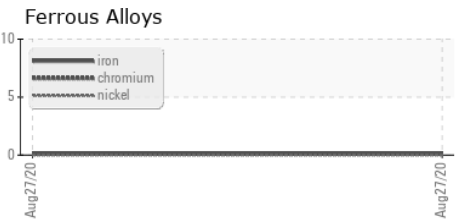

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0488631 **Received** : 01 Sep 2020  
**Lab Number** : **02373510** **Diagnosed** : 02 Sep 2020  
**Unique Number** : 5096958 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**PETERBOROUGH UTILITIES INC**  
 1867 ASHBURNHAM DRIVE  
 PETERBOROUGH, ON  
 CA K9L 1P8  
 Contact: Nelson Ross  
 nross@pui.ca  
 T: (705)760-6119  
 F: (705)748-3138

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.