




# PROBLEM SUMMARY

Sample Rating Trend

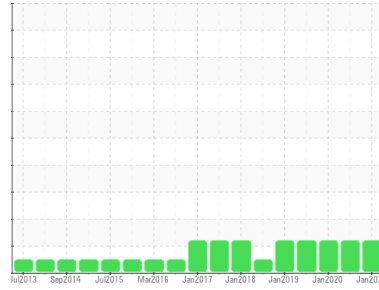


Machine Id  
**PHR-G2-EXBR**

Component  
**Bearing**


Fluid  
**MOBIL DTE OIL LIGHT (13 LTR)**

## COMPONENT CONDITION SUMMARY

### ▲ Non-ferrous Metals

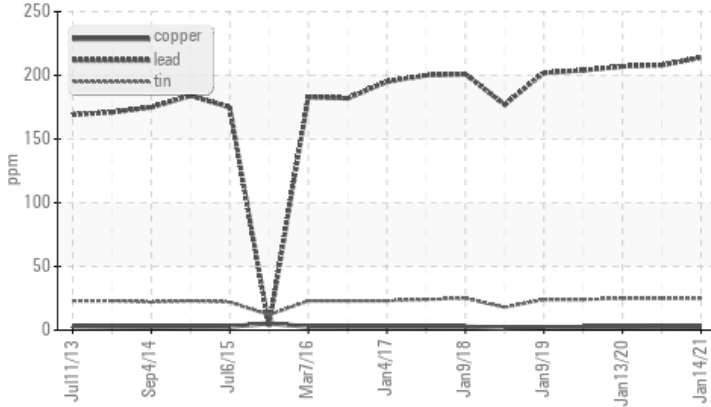

### Additives

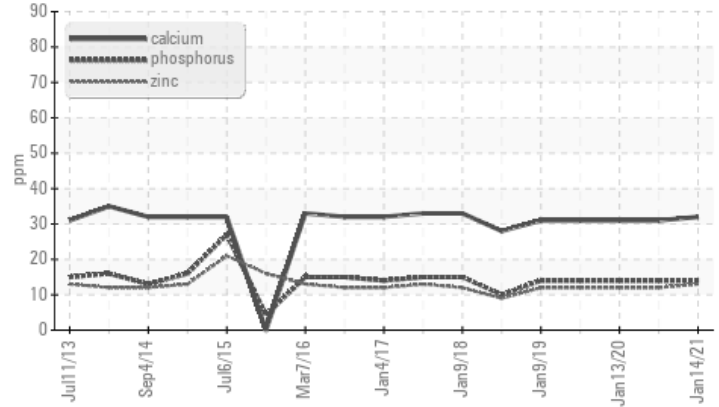

## RECOMMENDATION

We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	ABNORMAL
Lead	ppm ASTM D5185(m)	>161	▲ 214	▲ 208
Antimony	ppm ASTM D5185(m)		▲ 34	▲ 33

Customer Id: NEWSTJ  
 Sample No.: WC0316856  
 Lab Number: 02404904  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Fluid Source	---	---	?	Confirm the source of the lubricant being utilized for top-up/fill.

## HISTORICAL DIAGNOSIS

### 17 Jul 2020 Diag: Kevin Marson

#### WEAR



We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. Lead and antimony ppm levels are abnormal. Bearing wear is indicated. There is no indication of any contamination in the oil. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report



### 13 Jan 2020 Diag: Kevin Marson

#### WEAR



We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. Lead ppm levels are abnormal. Antimony ppm levels are noted. Bearing wear is indicated. There is no indication of any contamination in the oil. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report



### 27 Sep 2019 Diag: Kevin Marson

#### WEAR



We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. Lead ppm levels are abnormal. Antimony ppm levels are noted. Bearing wear is indicated. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

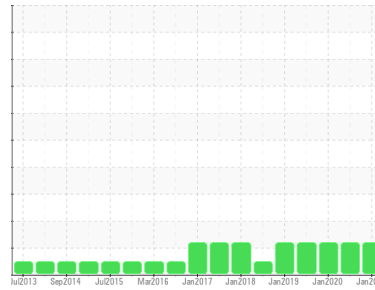

**WEAR**



Machine Id  
**PHR-G2-EXBR**  
 Component  
**Bearing**  
 Fluid  
**MOBIL DTE OIL LIGHT (13 LTR)**

## DIAGNOSIS

### Recommendation

We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition.

### Wear

Lead and antimony ppm levels are abnormal. Bearing wear is indicated.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0316856</b>	WC0328000	WC0316830
Sample Date	Client Info	<b>14 Jan 2021</b>	17 Jul 2020	13 Jan 2020
Machine Age	days	<b>0</b>	0	0
Oil Age	days	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	<b>0</b>	0	6
Iron	ppm ASTM D5185(m) >63	<b>&lt;1</b>	<1	0
Chromium	ppm ASTM D5185(m)	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Titanium	ppm ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Aluminum	ppm ASTM D5185(m) >2	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D5185(m) >161	<b>▲ 214</b>	▲ 208	▲ 207
Copper	ppm ASTM D5185(m) >13	<b>2</b>	2	2
Tin	ppm ASTM D5185(m) >27	<b>25</b>	25	25
Antimony	ppm ASTM D5185(m)	<b>▲ 34</b>	▲ 34	▲ 33
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>3</b>	3	3

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	0
Barium	ppm ASTM D5185(m)	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm ASTM D5185(m)	<b>4</b>	4	4
Calcium	ppm ASTM D5185(m)	<b>32</b>	31	31
Phosphorus	ppm ASTM D5185(m)	<b>14</b>	14	14
Zinc	ppm ASTM D5185(m)	<b>13</b>	12	12
Sulfur	ppm ASTM D5185(m)	<b>1754</b>	1741	1727
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS






method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >12	<b>&lt;1</b>	<1	0
Sodium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	0
Potassium	ppm ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	<b>0.08</b>	0.06	0.018




# OIL ANALYSIS REPORT

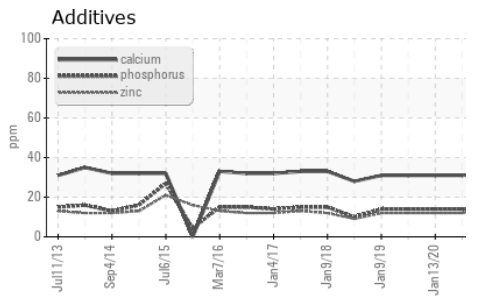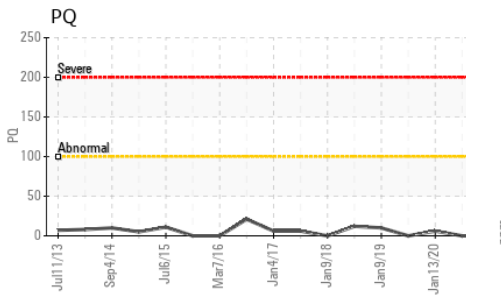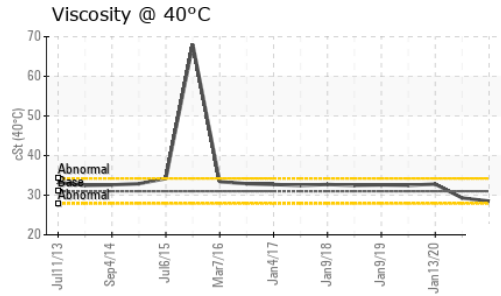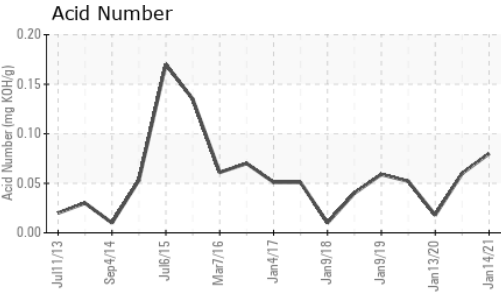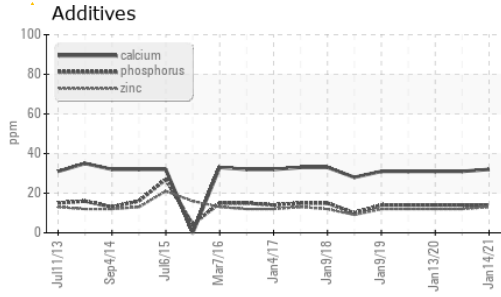






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	31	28.5	29.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

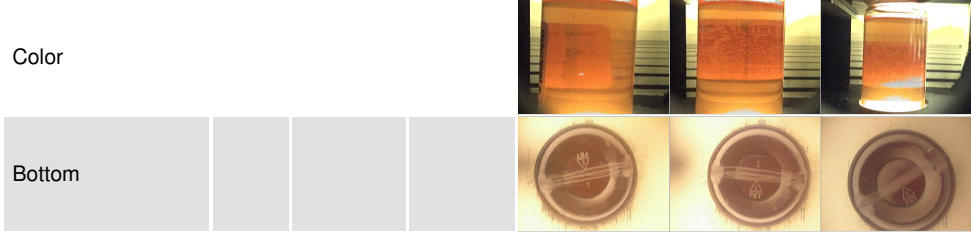

## GRAPHS

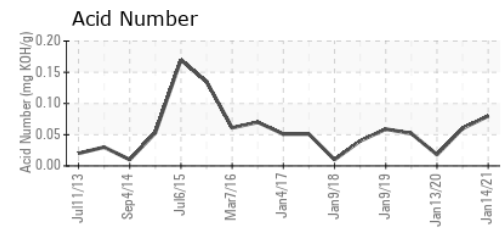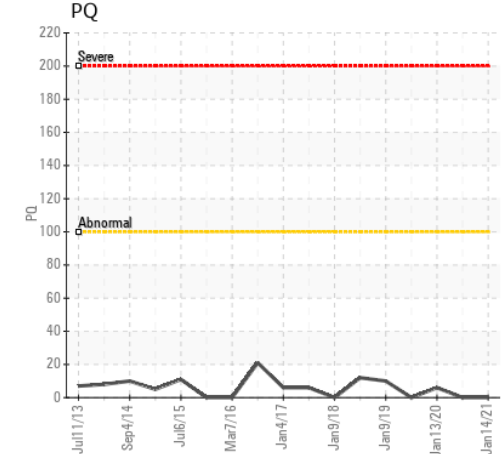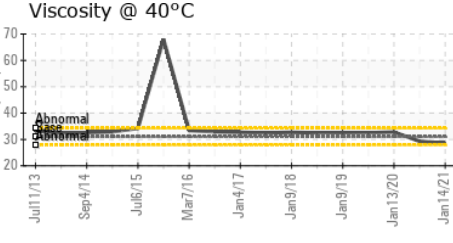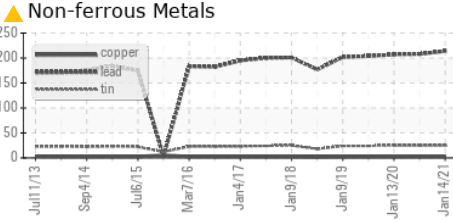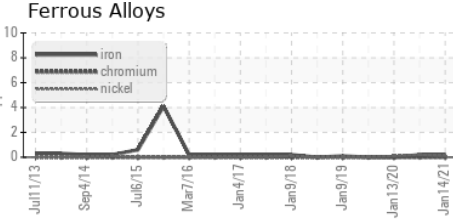

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0316856 **Received** : 19 Feb 2021  
**Lab Number** : 02404904 **Diagnosed** : 22 Feb 2021  
**Unique Number** : 5176376 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**NEWFOUNDLAND POWER INC.**  
 50 DUFFY PLACE, PO BOX 8910  
 ST. JOHNS, NL  
 CA A1B 3P6  
 Contact: Paul Martin  
 pmartin@newfoundlandpower.com  
 T:  
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.