




PROBLEM SUMMARY

Sample Rating Trend

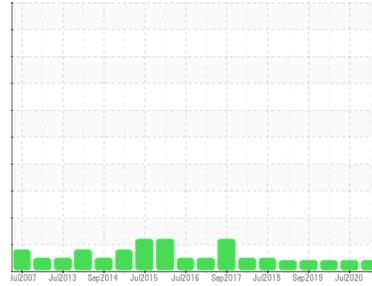


Machine Id
PHR-G2-TUBR

Component
Bearing

Fluid
MOBIL DTE OIL HVY MEDIUM (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

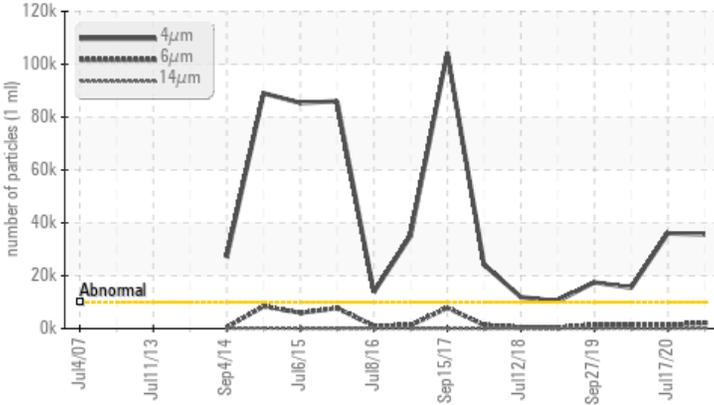

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	ATTENTION
Particles >4µm	ASTM D7647 >10000	▲ 35643	▲ 36034	▲ 15481
Oil Cleanliness	ISO 4406 (c) >20/18/14	▲ 22/18/14	▲ 22/18/11	▲ 21/18/14

Customer Id: NEWSTJ
Sample No.: WC0327913
Lab Number: 02404910
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

HISTORICAL DIAGNOSIS

17 Jul 2020 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. Particles >4µm are abnormally high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



13 Jan 2020 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



27 Sep 2019 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. The fluid was specified as MOBIL DTE OIL HVY MEDIUM, however, a fluid match indicates that this fluid is ISO 68 R&O Hydraulic Oil. Please confirm the oil type and grade on your next sample. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

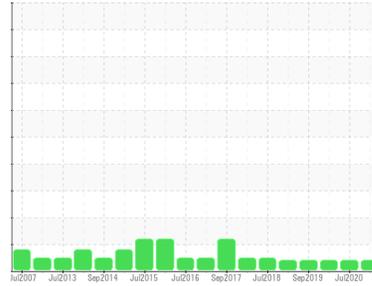

ISO



Machine Id
PHR-G2-TUBR

Component
Bearing

Fluid
MOBIL DTE OIL HVY MEDIUM (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

Particles >4µm are abnormally high.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0327913	WC0327998	WC0316829
Sample Date	Client Info	14 Jan 2021	17 Jul 2020	13 Jan 2020
Machine Age	days	0	0	0
Oil Age	days	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	0	5
Iron	ppm ASTM D5185(m) >63	3	4	2
Chromium	ppm ASTM D5185(m)	0	0	0
Nickel	ppm ASTM D5185(m)	0	<1	<1
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	0	<1	0
Aluminum	ppm ASTM D5185(m) >2	<1	<1	<1
Lead	ppm ASTM D5185(m) >161	<1	<1	<1
Copper	ppm ASTM D5185(m) >13	1	1	<1
Tin	ppm ASTM D5185(m) >27	9	10	5
Antimony	ppm ASTM D5185(m)	<1	<1	<1
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES






method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<1	<1	0
Barium	ppm ASTM D5185(m)	<1	<1	<1
Molybdenum	ppm ASTM D5185(m)	0	0	0
Manganese	ppm ASTM D5185(m)	0	0	0
Magnesium	ppm ASTM D5185(m)	<1	0	<1
Calcium	ppm ASTM D5185(m)	<1	<1	<1
Phosphorus	ppm ASTM D5185(m)	2	2	2
Zinc	ppm ASTM D5185(m)	3	3	3
Sulfur	ppm ASTM D5185(m)	2022	2024	1992
Lithium	ppm ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >12	<1	<1	0
Sodium	ppm ASTM D5185(m)	<1	<1	0
Potassium	ppm ASTM D5185(m) >20	<1	<1	0



OIL ANALYSIS REPORT

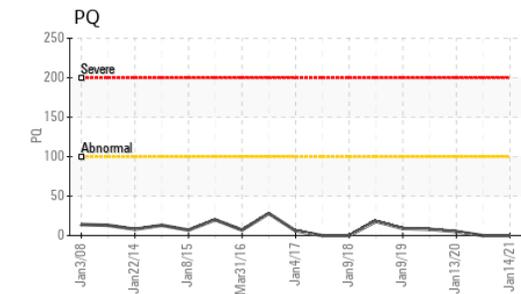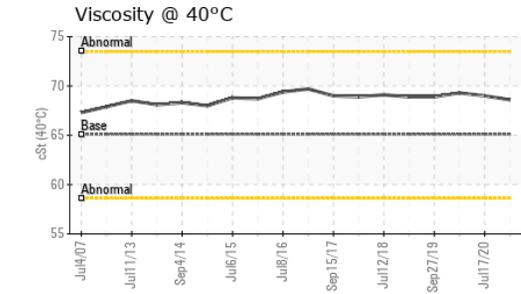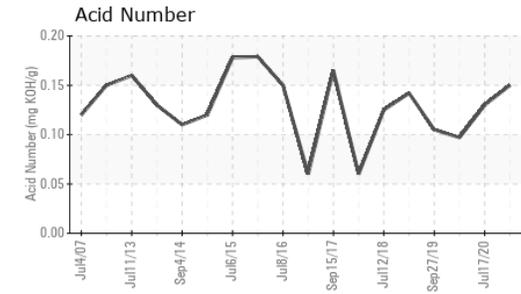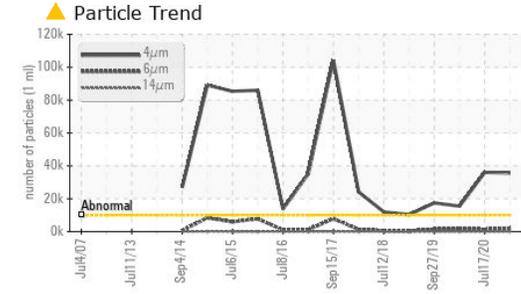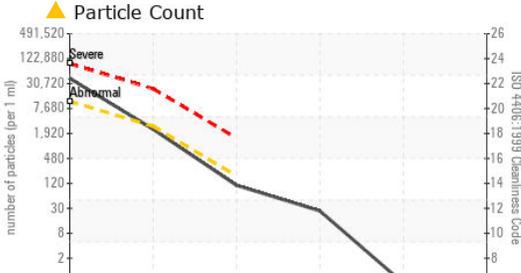

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0327913 **Received** : 19 Feb 2021
Lab Number : 02404910 **Diagnosed** : 23 Feb 2021
Unique Number : 5176382 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: PRTCOUNT, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 35643	▲ 36034	▲ 15481
Particles >6µm	ASTM D7647	>2500	2127	1394	1606
Particles >14µm	ASTM D7647	>160	95	19	101
Particles >21µm	ASTM D7647	>40	23	3	32
Particles >38µm	ASTM D7647	>10	0	0	2
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 22/18/14	▲ 22/18/11	▲ 21/18/14

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*		0.15	0.13	0.097

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>2	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	65.1	68.6	69.0	69.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

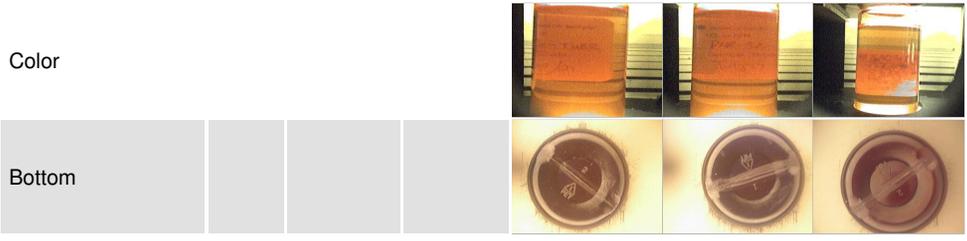

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Paul Martin
 pmartin@newfoundlandpower.com
 T: (709)737-2926