


OIL ANALYSIS REPORT

Sample Rating Trend







PHR G2 GOV

Component

Governor System

MOBIL DTE OIL HVY MEDIUM (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

62002 Jan2015 Jan2008 Jan2010 Jan2012 Jan2014 Mar2015 Jan2018 Jan2020						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0316852	WC0327999	WC0316828
Sample Date		Client Info		12 Jan 2021	17 Jul 2020	13 Jan 2020
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	6
Iron	ppm	ASTM D5185(m)	>50	2	1	<1
Chromium	ppm	ASTM D5185(m)		0	0	0
Nickel	ppm	ASTM D5185(m)		0	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	<1	0
Aluminum	ppm	ASTM D5185(m)	>3	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>75	<1	<1	<1
Copper	ppm	ASTM D5185(m)	>15	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>55	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		<1	<1	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		<1	0	<1
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	0	<1
Calcium	ppm	ASTM D5185(m)		<1	<1	<1
Phosphorus	ppm	ASTM D5185(m)		8	8	8
Zinc	ppm	ASTM D5185(m)		2	3	4
Sulfur	ppm	ASTM D5185(m)		1122	1120	1121
Lithium	ppm	ASTM D5185(m)		<1	<1	<1
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>8	<1	<1	0
Sodium	ppm	ASTM D5185(m)		<1	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	<1	<1



OIL ANALYSIS REPORT

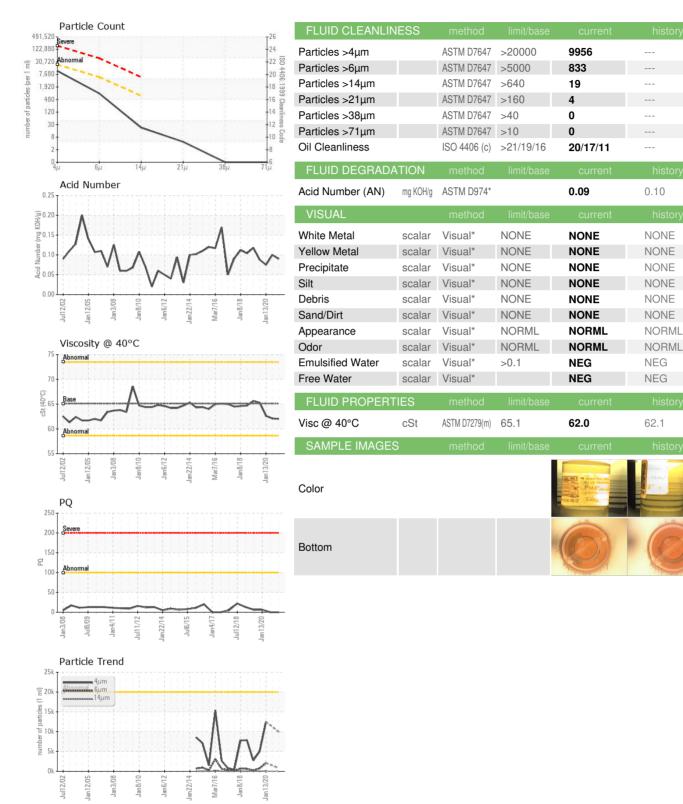



CALA ISO 17025:2017 Accredited

Laboratory

Laboratory Sample No. Lab Number **Unique Number**

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : WC0316852 : 02404922

: 5176394

Diagnostician : Kevin Marson Test Package : IND 2 (Additional Tests: PRTCOUNT, TAN Man)

Received

Diagnosed

: 19 Feb 2021

: 23 Feb 2021

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC.

50 DUFFY PLACE, PO BOX 8910 ST. JOHNS, NL CA A1B 3P6

Contact: Paul Martin

pmartin@newfoundlandpower.com T:

F: (709)737-2926

Contact/Location: Paul Martin - NEWSTJ

12488

2080

46

12

0

0

21/18/13

0.075

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NEG NEG

62.6

NORML