




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

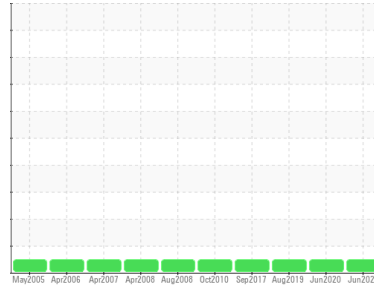

Area  
**[186342-1]**  
 Machine Id  
**CARDIESEL (S/N T06359T21361T)**  
 Component  
**Diesel Engine**  
 Fluid  
**SAE 10W40 (34)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0328023</b>	WC0327967	WC0299351
Sample Date	Client Info		<b>02 Jun 2021</b>	18 Jun 2020	22 Aug 2019
Machine Age	hrs	Client Info	<b>87</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>2.1	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.21	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>51	<b>3</b>	3
Chromium	ppm	ASTM D5185(m)	>11	<b>0</b>	<1
Nickel	ppm	ASTM D5185(m)	>5	<b>0</b>	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	<1
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1
Aluminum	ppm	ASTM D5185(m)	>31	<b>3</b>	2
Lead	ppm	ASTM D5185(m)	>26	<b>&lt;1</b>	0
Copper	ppm	ASTM D5185(m)	>26	<b>1</b>	1
Tin	ppm	ASTM D5185(m)	>4	<b>0</b>	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	<1
Vanadium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>177</b>	176
Barium	ppm	ASTM D5185(m)		<b>0</b>	<1
Molybdenum	ppm	ASTM D5185(m)		<b>188</b>	185
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1
Magnesium	ppm	ASTM D5185(m)		<b>833</b>	808
Calcium	ppm	ASTM D5185(m)		<b>1331</b>	1331
Phosphorus	ppm	ASTM D5185(m)		<b>965</b>	925
Zinc	ppm	ASTM D5185(m)		<b>1068</b>	1062
Sulfur	ppm	ASTM D5185(m)		<b>2694</b>	2698
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>22	<b>6</b>	5
Sodium	ppm	ASTM D5185(m)	>401	<b>2</b>	1
Potassium	ppm	ASTM D5185(m)	>20	<b>2</b>	1

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.6</b>	6.4
Sulfation	Abs./1mm	ASTM D7415*	>30	<b>19.0</b>	23.8



# OIL ANALYSIS REPORT







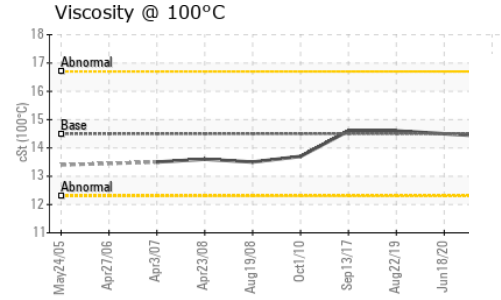
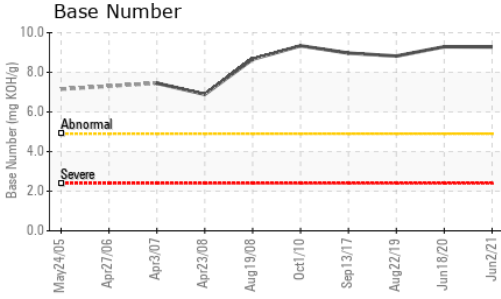


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>14.8</b>	14.1	14.5
Base Number (BN)	mg KOH/g	ASTM D2896*		<b>9.28</b>	9.29	8.82

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.21	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.5	<b>14.4</b>	14.5	14.6

## GRAPHS

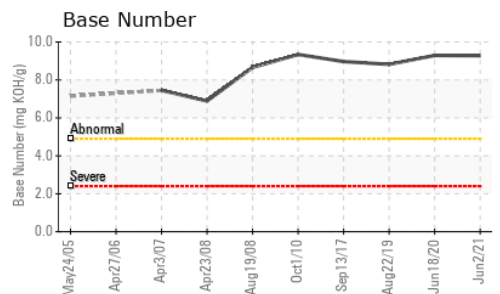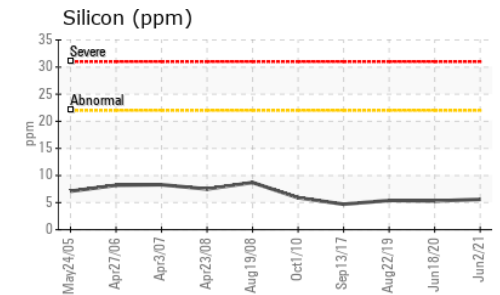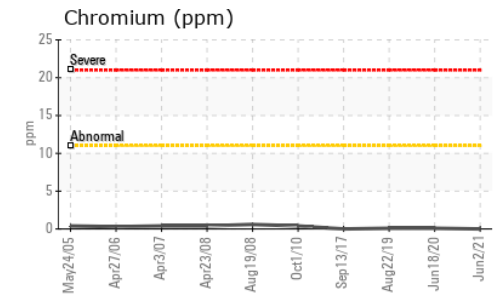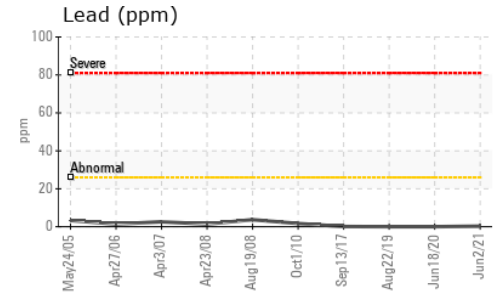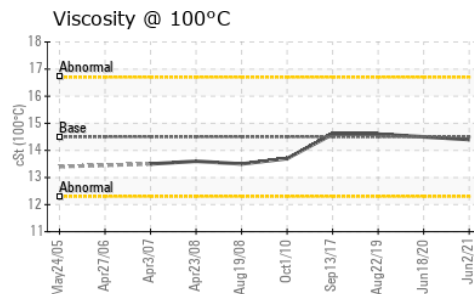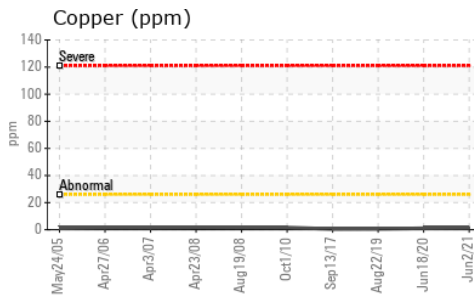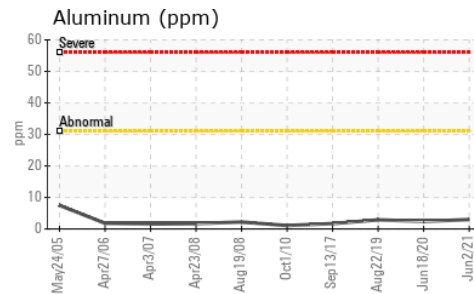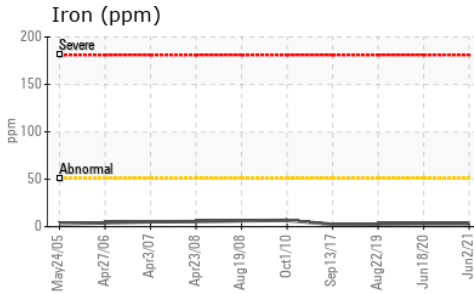

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0328023  
**Lab Number** : 02436671  
**Unique Number** : 5264202  
**Test Package** : MOB 2

**NEWFOUNDLAND POWER INC.**  
 50 DUFFY PLACE, PO BOX 8910  
 ST. JOHNS, NL  
 CA A1B 3P6  
 Contact: Paul Martin  
 pmartin@newfoundlandpower.com  
 T:  
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.