




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

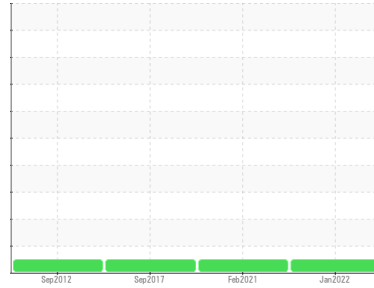

Machine Id
GRT-APU

Component
Auxiliary Power Unit Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 15W40 (19 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0328072	WC0327929	WC925457
Sample Date	Client Info		19 Jan 2022	18 Feb 2021	14 Sep 2017
Machine Age	hrs	Client Info	52	0	0
Oil Age	hrs	Client Info	52	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	0.0	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>90	10	9	7
Chromium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Nickel	ppm	ASTM D5185(m)	>2	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	>2	0	<1	0
Silver	ppm	ASTM D5185(m)	>2	<1	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	1	1	1
Lead	ppm	ASTM D5185(m)	>40	17	17	9
Copper	ppm	ASTM D5185(m)	>330	472	406	170
Tin	ppm	ASTM D5185(m)	>15	<1	<1	<1
Antimony	ppm	ASTM D5185(m)		1	<1	2
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	250	8	7	12
Barium	ppm	ASTM D5185(m)	10	<1	<1	<1
Molybdenum	ppm	ASTM D5185(m)	100	46	42	43
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	827	774	815
Calcium	ppm	ASTM D5185(m)	3000	1413	1316	1403
Phosphorus	ppm	ASTM D5185(m)	1150	1065	988	1062
Zinc	ppm	ASTM D5185(m)	1350	1272	1254	1290
Sulfur	ppm	ASTM D5185(m)	4250	2958	2964	3079
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS



	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	6	6	7
Sodium	ppm	ASTM D5185(m)	>158	3	4	2
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.6	6.5	7.5
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.0	18.2	21.1



OIL ANALYSIS REPORT







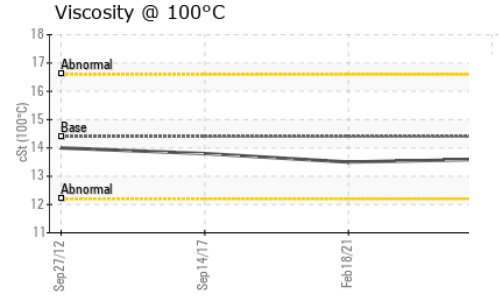
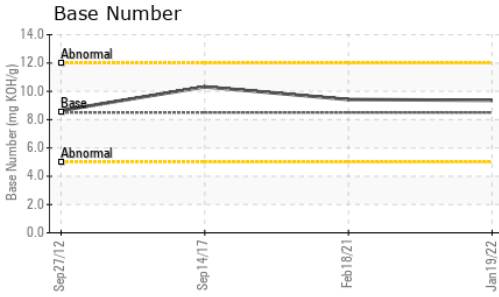


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.9	14.5	13.0
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	9.36	9.42	10.32

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.6	13.5	13.8

GRAPHS

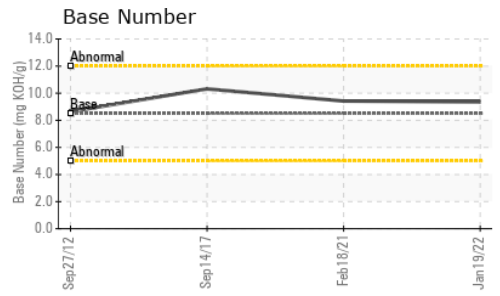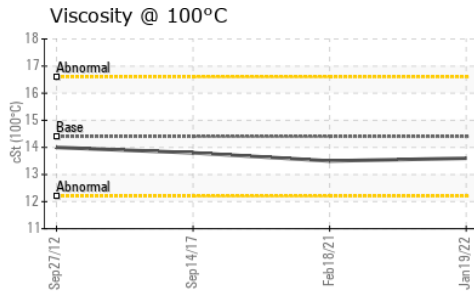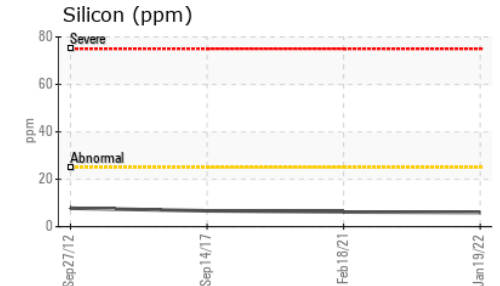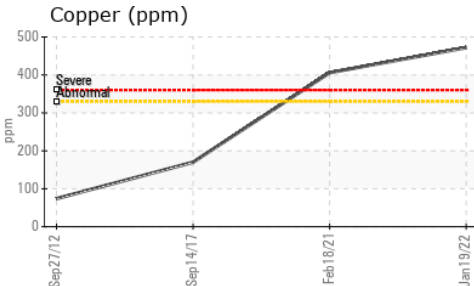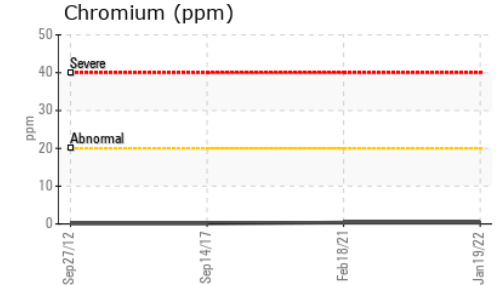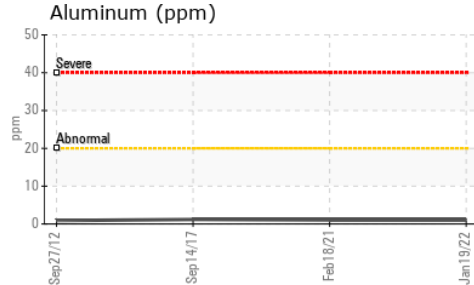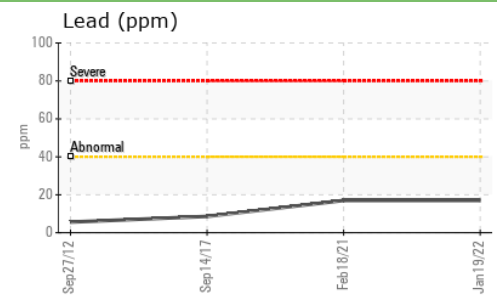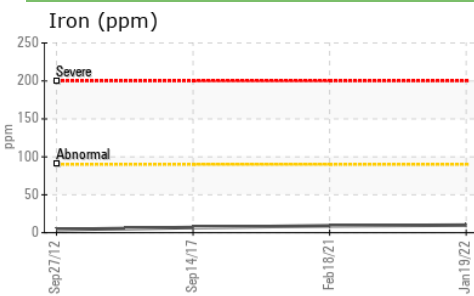

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0328072 **Received** : 20 Jan 2022
Lab Number : **02467152** **Diagnosed** : 21 Jan 2022
Unique Number : 5344070 **Diagnostician** : Wes Davis
Test Package : MOB 2

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Paul Martin
 pmartin@newfoundlandpower.com
 T:
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.