




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

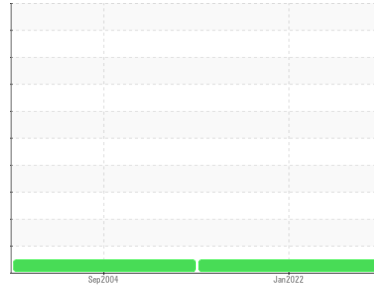

Machine Id
RBH G1 COMMON SUMP
 Component
Bearing
 Fluid
Hydro Safe HYDRO SAFE ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

The component was not specified so we have determined that this is a bearing based on the fluid type in use. Please specify the correct component type on your next sample. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0328035	WC635042	---
Sample Date	Client Info			19 Jan 2022	23 Sep 2004	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	20	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>63	1	<1	---
Chromium	ppm	ASTM D5185(m)		0	<1	---
Nickel	ppm	ASTM D5185(m)		<1	0	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	<1	---
Aluminum	ppm	ASTM D5185(m)	>2	0	<1	---
Lead	ppm	ASTM D5185(m)	>161	1	0	---
Copper	ppm	ASTM D5185(m)	>13	<1	<1	---
Tin	ppm	ASTM D5185(m)	>27	1	10	---
Antimony	ppm	ASTM D5185(m)		<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	<1	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	6	---
Barium	ppm	ASTM D5185(m)		0	0	---
Molybdenum	ppm	ASTM D5185(m)		0	0	---
Manganese	ppm	ASTM D5185(m)		0	<1	---
Magnesium	ppm	ASTM D5185(m)		<1	0	---
Calcium	ppm	ASTM D5185(m)		3	0	---
Phosphorus	ppm	ASTM D5185(m)		13	228	---
Zinc	ppm	ASTM D5185(m)		10	<1	---
Sulfur	ppm	ASTM D5185(m)		2123	505	---
Lithium	ppm	ASTM D5185(m)		<1	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>12	<1	8	---
Sodium	ppm	ASTM D5185(m)		<1	0	---
Potassium	ppm	ASTM D5185(m)	>20	<1	1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	227	---	---
Particles >6µm		ASTM D7647	>2500	43	---	---
Particles >14µm		ASTM D7647	>160	3	---	---
Particles >21µm		ASTM D7647	>40	1	---	---
Particles >38µm		ASTM D7647	>10	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/14	15/13/9	---	---



OIL ANALYSIS REPORT

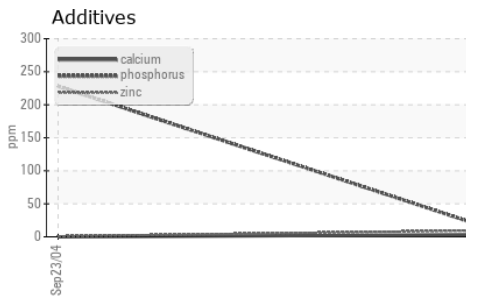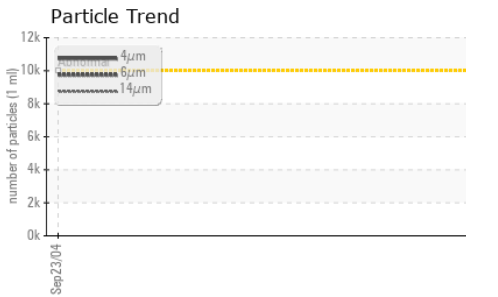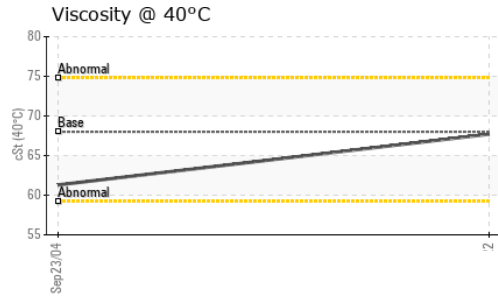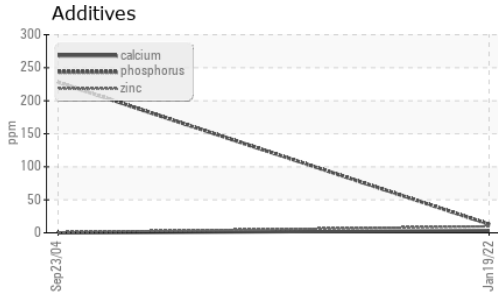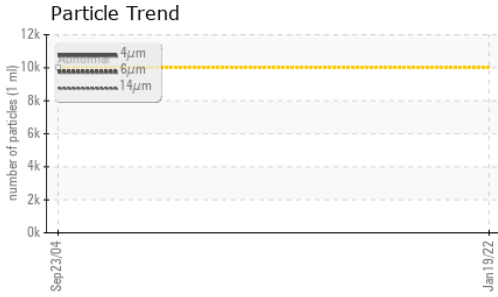


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.8	0.15	0.686	---



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>2	NEG	NEG	---
Free Water	scalar	Visual*		NEG	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	67.7	61.3	---

SAMPLE IMAGES

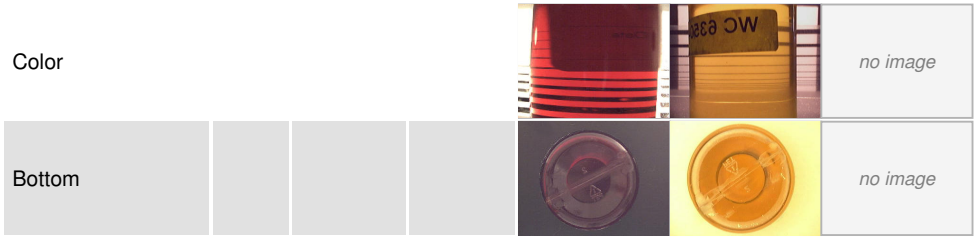

GRAPHS

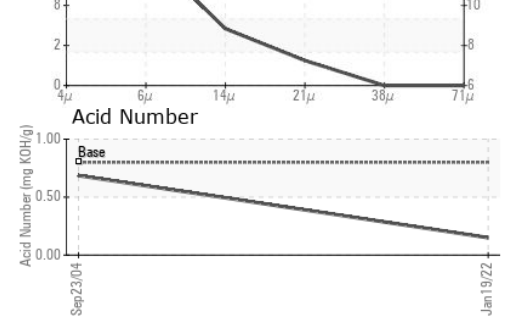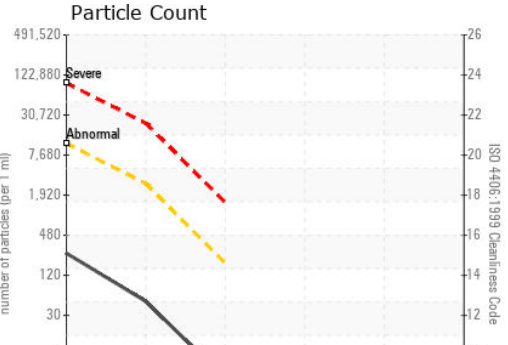

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 Sample No. : WC0328035 Received : 20 Jan 2022
 Lab Number : 02467323 Diagnosed : 21 Jan 2022
 Unique Number : 5344241 Diagnostician : Kevin Marson
 Test Package : IND 2 (Additional Tests: PrtCount)

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Shane Reid
 sreid@newfoundlandpower.com
 T: (709)737-5209
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.