




# OIL ANALYSIS REPORT

Sample Rating Trend

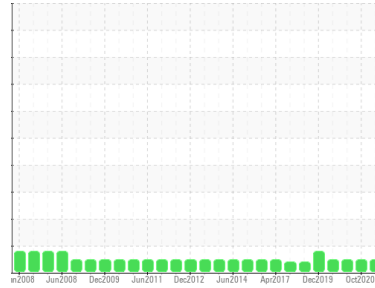

**NORMAL**



Area  
**[188530]**  
 Machine Id  
**TCV-G3-BRG**

Component  
**Bearing**  
 Fluid  
**MOBIL DTE OIL HVY MEDIUM (305 LTR)**

## DIAGNOSIS

### Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. The fluid was specified as MOBIL DTE OIL HVY MEDIUM, however, a fluid match indicates that this fluid is ISO 68 R&O Hydraulic Oil. Please confirm the oil type and grade on your next sample.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0327924</b>	WC0327961	WC0316769
Sample Date	Client Info			<b>28 Oct 2021</b>	08 Oct 2020	08 Apr 2020
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>63	<b>&lt;1</b>	<1	0
Chromium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	0
Lead	ppm	ASTM D5185(m)	>161	<b>5</b>	3	3
Copper	ppm	ASTM D5185(m)	>13	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>27	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m)		<b>14</b>	5	5
Zinc	ppm	ASTM D5185(m)		<b>6</b>	1	2
Sulfur	ppm	ASTM D5185(m)		<b>356</b>	267	271
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>12	<b>2</b>	2	1
Sodium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>922</b>	1625	1796
Particles >6µm		ASTM D7647	>2500	<b>208</b>	418	459
Particles >14µm		ASTM D7647	>160	<b>11</b>	26	25
Particles >21µm		ASTM D7647	>40	<b>4</b>	8	8
Particles >38µm		ASTM D7647	>10	<b>0</b>	1	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/14	<b>17/15/11</b>	18/16/12	18/16/12




# OIL ANALYSIS REPORT


### Particle Trend

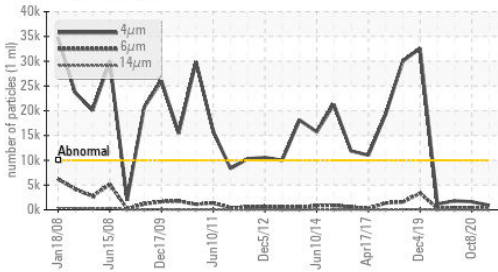


### Additives

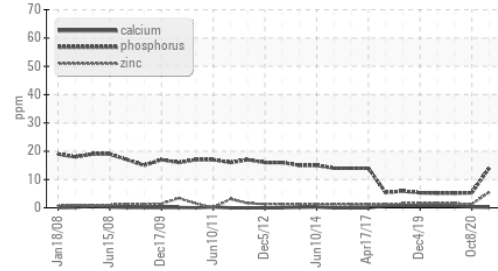


### Viscosity @ 40°C

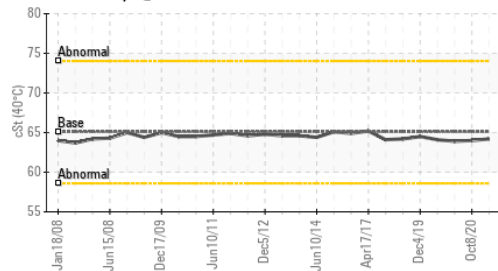

### Particle Trend

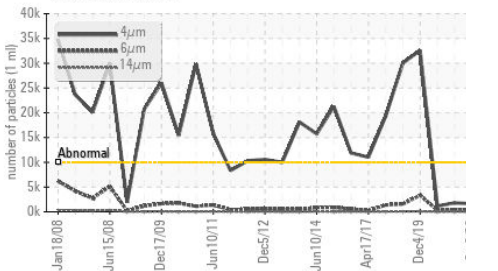

### Additives

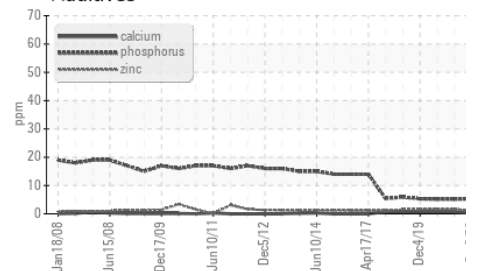


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>0.08</b>	0.08	0.11

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	65.1	<b>64.2</b>	64.0	63.9

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

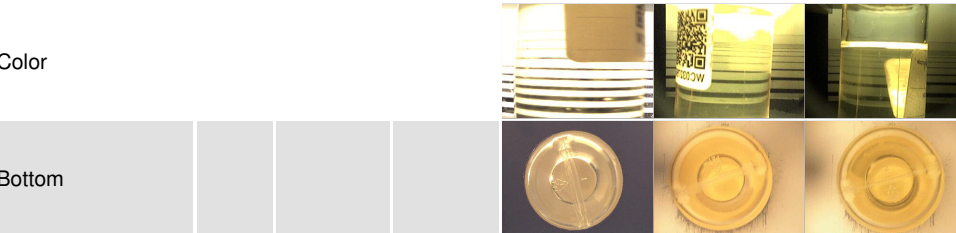


## GRAPHS


### Ferrous Alloys

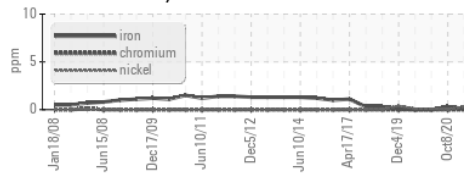


### Non-ferrous Metals

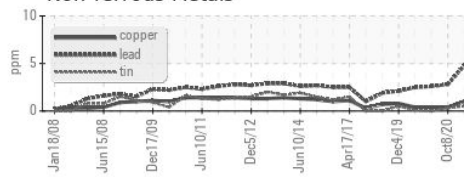


### Viscosity @ 40°C

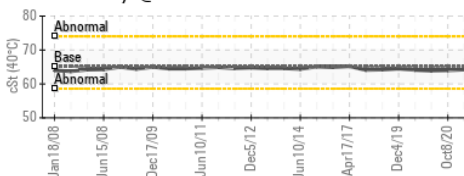

### Particle Count

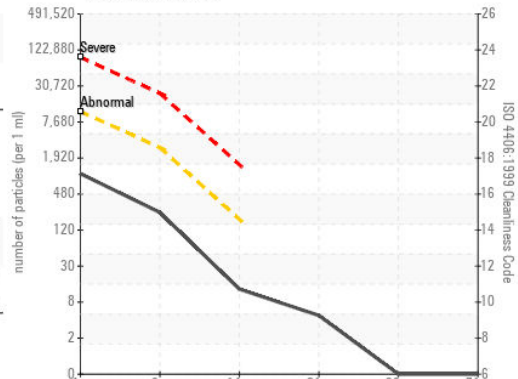

### Acid Number

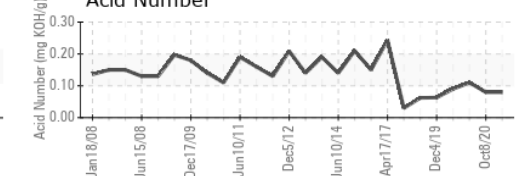

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0327924  
**Lab Number** : 02467378  
**Unique Number** : 5344296  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**Received** : 20 Jan 2022  
**Diagnosed** : 21 Jan 2022  
**Diagnostician** : Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**NEWFOUNDLAND POWER INC.**  
 50 DUFFY PLACE, PO BOX 8910  
 ST. JOHNS, NL  
 CA A1B 3P6  
 Contact: Paul Martin  
 pmartin@newfoundlandpower.com  
 T:  
 F: (709)737-2926