PROBLEM SUMMARY

Sample Rating Trend

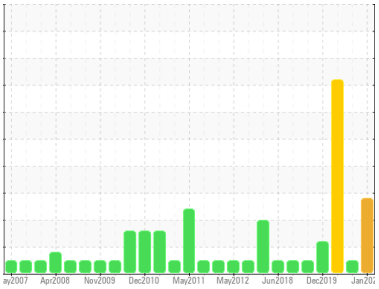

WATER

Machine Id
VIC-G-THBR
Component
Bearing
Fluid
ESSO TERESSO ISO 68 (2 LTR)

COMPONENT CONDITION SUMMARY

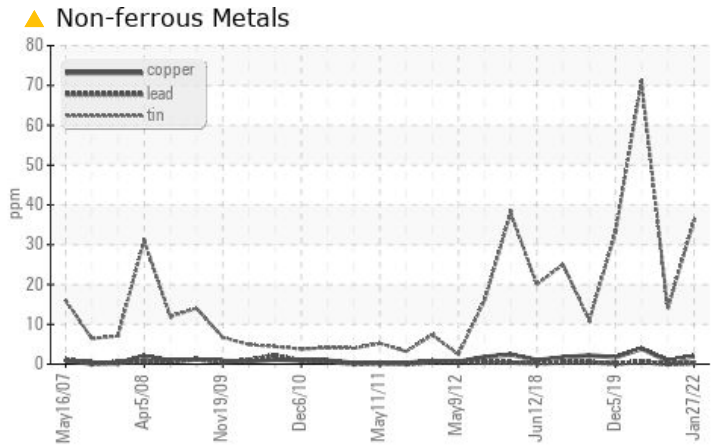

RECOMMENDATION

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	SEVERE
Tin	ppm	ASTM D5185(m)	>27	▲ **36**	14	⬢ 71
Antimony	ppm	ASTM D5185(m)		▲ **2**	1	▲ 6
Emulsified Water	scalar	Visual*	>2	▲ **.5%**	NEG	NEG
Free Water	scalar	Visual*		▲ **1%**	NEG	NEG

Customer Id: NEWSTJ
Sample No.: WC0327870
Lab Number: 02473265
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Water Access	---	---	?	We advise that you check for the source of water entry.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

HISTORICAL DIAGNOSIS

07 Jan 2021 Diag: Kevin Marson

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

---

18 Aug 2020 Diag: Kevin Marson

WEAR

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.Tin ppm levels are severe. Iron and antimony ppm levels are abnormal. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report

---

05 Dec 2019 Diag: Kevin Marson

WEAR

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.Iron and tin ppm levels are abnormal. Antimony ppm levels are noted. A sharp increase in the iron level is noted. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. The water content is negligible. There is no indication of any contamination in the component. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

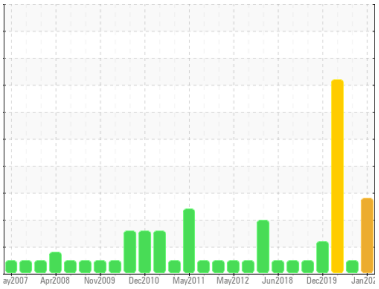

WATER

Machine Id
VIC-G-THBR
Component
Bearing
Fluid
ESSO TERESSO ISO 68 (2 LTR)

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

Tin ppm levels are abnormal. Antimony ppm levels are noted. Bearing wear is indicated.

Contamination

There is a light concentration of water present in the oil. Free water present.

Fluid Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0327870**	WC0328016	WC0327948
Sample Date		Client Info		**27 Jan 2022**	07 Jan 2021	18 Aug 2020
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	NORMAL	SEVERE

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>2	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		**6**	0	32
Iron	ppm	ASTM D5185(m)	>63	**25**	12	▲ 87
Chromium	ppm	ASTM D5185(m)		**0**	0	<1
Nickel	ppm	ASTM D5185(m)		**<1**	<1	<1
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**0**	0	<1
Aluminum	ppm	ASTM D5185(m)	>2	**0**	0	<1
Lead	ppm	ASTM D5185(m)	>161	**<1**	0	<1
Copper	ppm	ASTM D5185(m)	>13	**2**	<1	4
Tin	ppm	ASTM D5185(m)	>27	▲ **36**	14	⬢ 71
Antimony	ppm	ASTM D5185(m)		▲ **2**	1	▲ 6
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	4.5	**<1**	<1	<1
Barium	ppm	ASTM D5185(m)	0.4	**0**	0	0
Molybdenum	ppm	ASTM D5185(m)	0	**0**	0	0
Manganese	ppm	ASTM D5185(m)		**<1**	0	<1
Magnesium	ppm	ASTM D5185(m)	0	**0**	0	<1
Calcium	ppm	ASTM D5185(m)	0	**<1**	<1	<1
Phosphorus	ppm	ASTM D5185(m)	0.7	**4**	4	4
Zinc	ppm	ASTM D5185(m)	0	**4**	<1	6
Sulfur	ppm	ASTM D5185(m)	1315	**221**	215	514
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>12	**<1**	0	<1
Sodium	ppm	ASTM D5185(m)		**0**	0	0
Potassium	ppm	ASTM D5185(m)	>20	**<1**	<1	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	**0.09**	0.14	0.13

OIL ANALYSIS REPORT

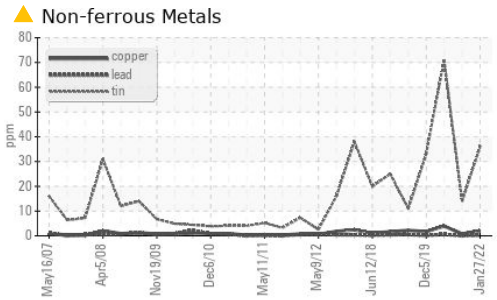

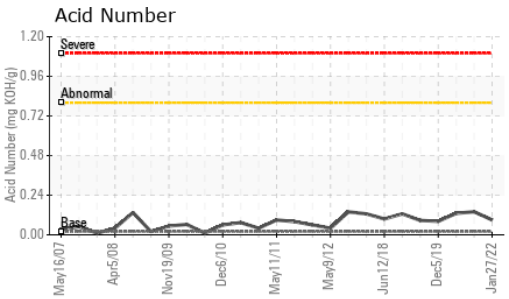

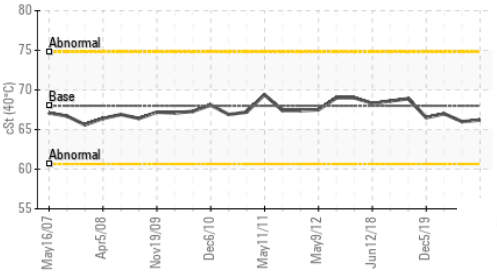

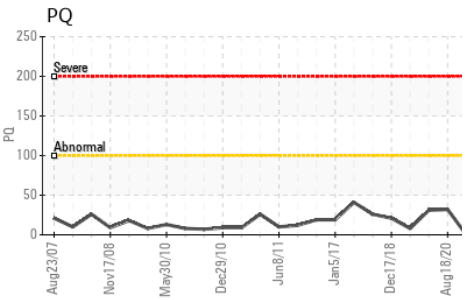

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	VLITE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**VLITE**	NONE	NONE
Silt	scalar	Visual*	NONE	**VLITE**	VLITE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	HAZY	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>2	▲ **.5%**	NEG	NEG
Free Water	scalar	Visual*		▲ **1%**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	**66.2**	66.0	67.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

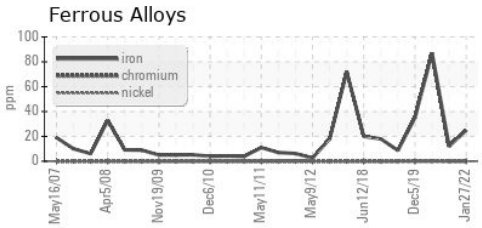

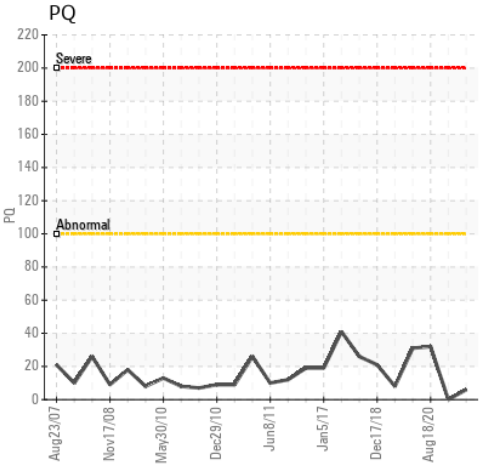

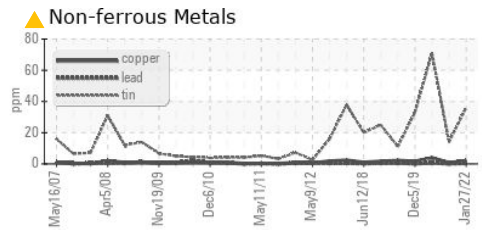

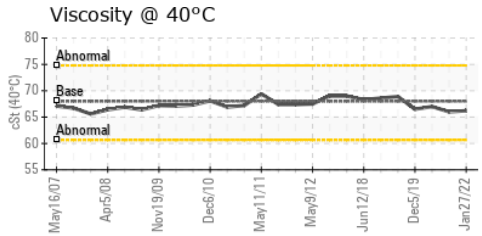

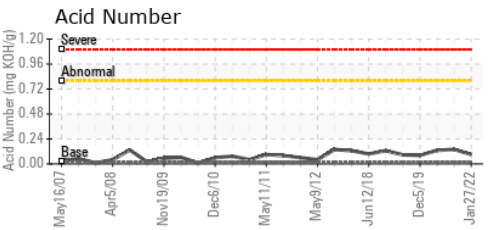

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0327870 **Received** : 22 Feb 2022
Lab Number : 02473265 **Diagnosed** : 22 Feb 2022
Unique Number : 5358188 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC.
50 DUFFY PLACE, PO BOX 8910
ST. JOHNS, NL
CA A1B 3P6
Contact: Paul Martin
pmartin@newfoundlandpower.com
T:
F: (709)737-2926