




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

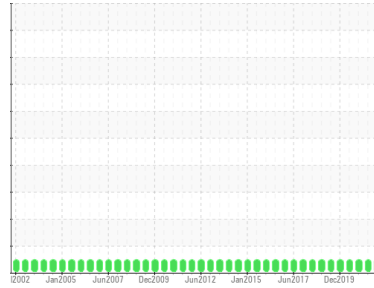

Machine Id  
**PIT-G1-GEBR-02**  
 Component  
**Bearing**  
 Fluid  
**ESSO TERESSO ISO 68 (23 LTR)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0445185</b>	WC0327867	WC0327934
Sample Date	Client Info	<b>19 Jan 2022</b>	14 Jun 2021	06 Jan 2021
Machine Age	yrs Client Info	<b>0</b>	0	0
Oil Age	yrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	<b>0</b>	0	0
Iron	ppm ASTM D5185(m) >63	<b>0</b>	0	0
Chromium	ppm ASTM D5185(m)	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m)	<b>0</b>	<1	<1
Titanium	ppm ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm ASTM D5185(m) >2	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D5185(m) >161	<b>4</b>	3	3
Copper	ppm ASTM D5185(m) >13	<b>0</b>	<1	<1
Tin	ppm ASTM D5185(m) >27	<b>0</b>	<1	<1
Antimony	ppm ASTM D5185(m)	<b>&lt;1</b>	0	<1
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 4.5	<b>&lt;1</b>	<1	<1
Barium	ppm ASTM D5185(m) 0.4	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm ASTM D5185(m) 0	<b>0</b>	0	0
Calcium	ppm ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Phosphorus	ppm ASTM D5185(m) 0.7	<b>&lt;1</b>	0	0
Zinc	ppm ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Sulfur	ppm ASTM D5185(m) 1315	<b>2144</b>	2183	2187
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS




method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >12	<b>0</b>	0	<1
Sodium	ppm ASTM D5185(m)	<b>0</b>	0	0
Potassium	ppm ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974* 0.02	<b>0.12</b>	0.08	0.13



# OIL ANALYSIS REPORT

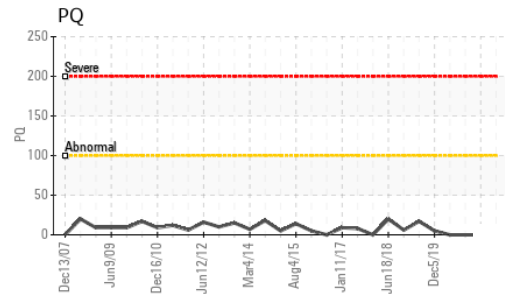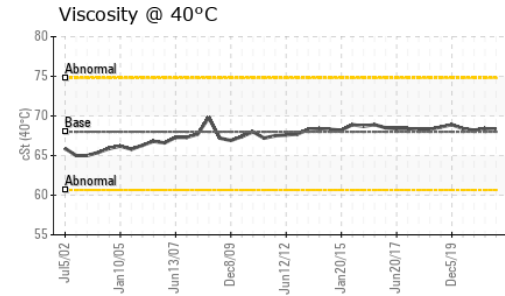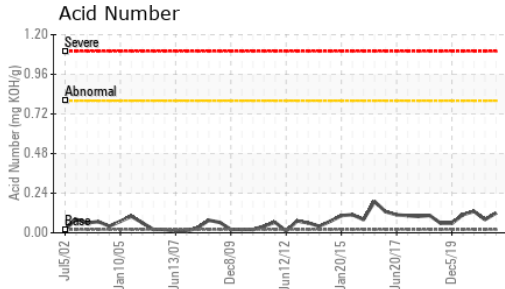


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	68.4	68.2






SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

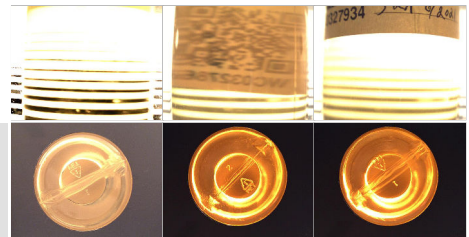

## GRAPHS

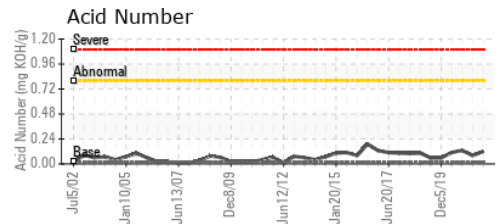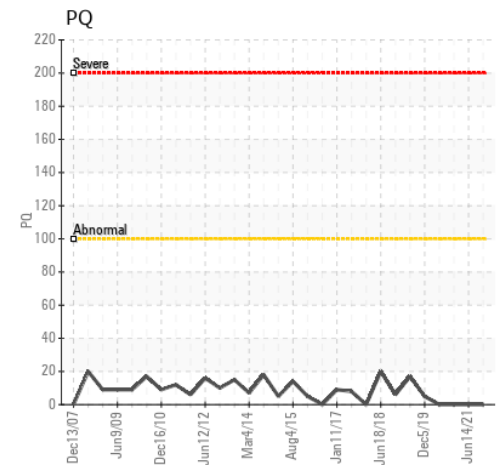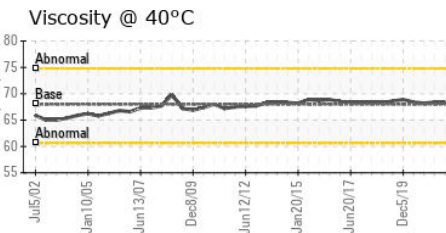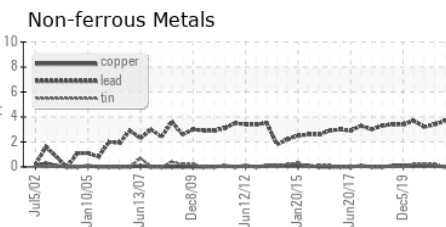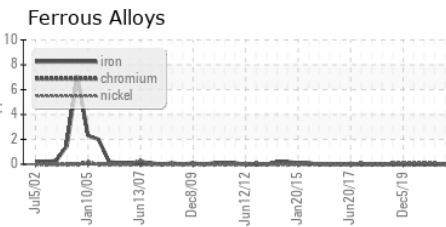

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0445185 **Received** : 22 Feb 2022  
**Lab Number** : 02473268 **Diagnosed** : 22 Feb 2022  
**Unique Number** : 5358191 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**NEWFOUNDLAND POWER INC.**  
 50 DUFFY PLACE, PO BOX 8910  
 ST. JOHNS, NL  
 CA A1B 3P6  
 Contact: Paul Martin  
 pmartin@newfoundlandpower.com  
 T:  
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.