



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL




Area

GARNISON OF MONTREAL [VQ6028]

Machine Id
G12162

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 40 (--- GAL)

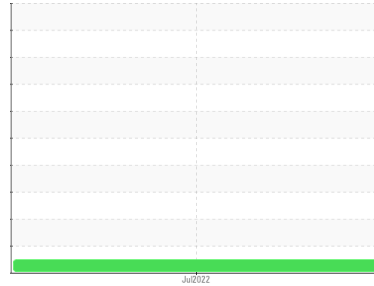

DIAGNOSIS

Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. Le fluide n'était pas spécifié, toutefois, une comparaison avec d'autres fluides indiqua que ce fluide est du (GENERIC) DIESEL ENGINE OIL SAE 40. Veuillez confirmer. Veuillez préciser la marque et le modèle du composant lors du prochain échantillon.

Wear

Les taux de métaux sont typiques pour la période de rodage d'un nouveau composant.

Contamination

Il n'y a aucun indice de contamination dans l'huile.

Fluid Condition

L'état de l'huile est acceptable pour la durée de service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GD0005526	---	---
Sample Date	Client Info		20 Jul 2022	---	---
Machine Age	hrs	Client Info	595	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			NORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	---	---
Water	WC Method	>0.2	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	2	---	---
Chromium	ppm	ASTM D5185(m) >20	0	---	---
Nickel	ppm	ASTM D5185(m) >4	0	---	---
Titanium	ppm	ASTM D5185(m)	<1	---	---
Silver	ppm	ASTM D5185(m) >3	0	---	---
Aluminum	ppm	ASTM D5185(m) >20	<1	---	---
Lead	ppm	ASTM D5185(m) >40	<1	---	---
Copper	ppm	ASTM D5185(m) >330	2	---	---
Tin	ppm	ASTM D5185(m) >15	<1	---	---
Antimony	ppm	ASTM D5185(m)	<1	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 250	2	---	---
Barium	ppm	ASTM D5185(m) 10	0	---	---
Molybdenum	ppm	ASTM D5185(m) 100	57	---	---
Manganese	ppm	ASTM D5185(m)	<1	---	---
Magnesium	ppm	ASTM D5185(m) 450	980	---	---
Calcium	ppm	ASTM D5185(m) 3000	1079	---	---
Phosphorus	ppm	ASTM D5185(m) 1150	1033	---	---
Zinc	ppm	ASTM D5185(m) 1350	1207	---	---
Sulfur	ppm	ASTM D5185(m) 4250	2779	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	8	---	---
Sodium	ppm	ASTM D5185(m) >216	1	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	0	---	---
Nitration	Abs/cm	ASTM D7624* >20	4.7	---	---
Sulfation	Abs./1mm	ASTM D7415* >30	16.9	---	---



OIL ANALYSIS REPORT

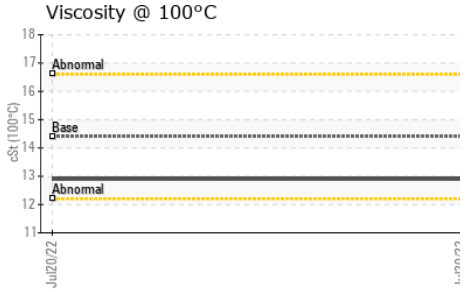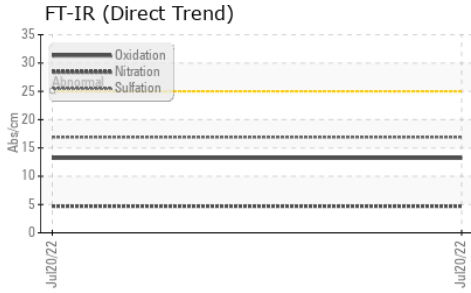

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	13.2	---









VISUAL

	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES

	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	12.9	---

GRAPHS

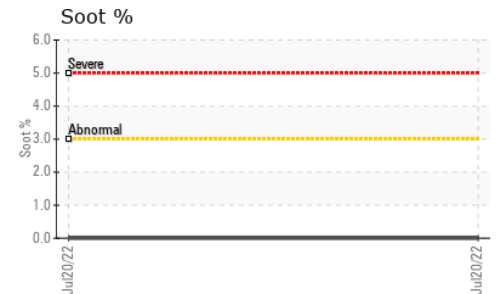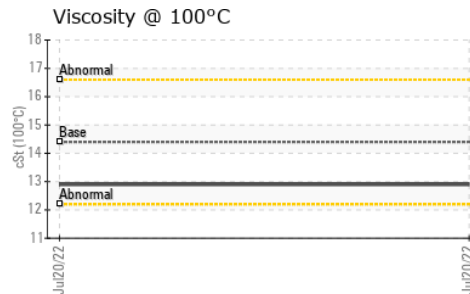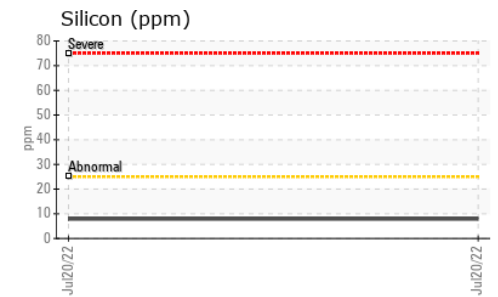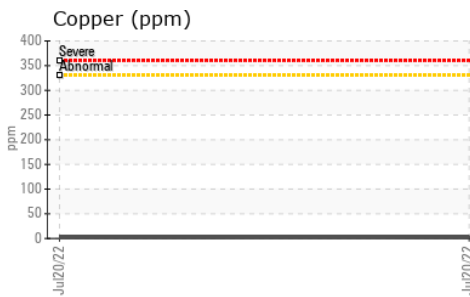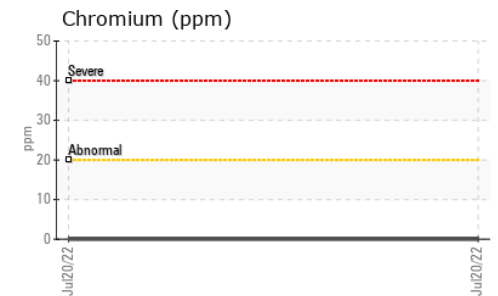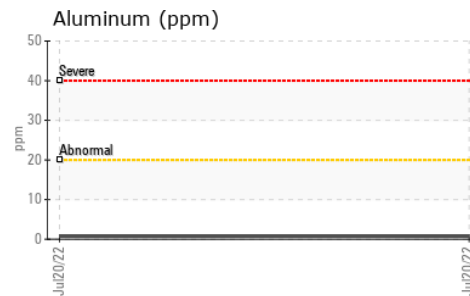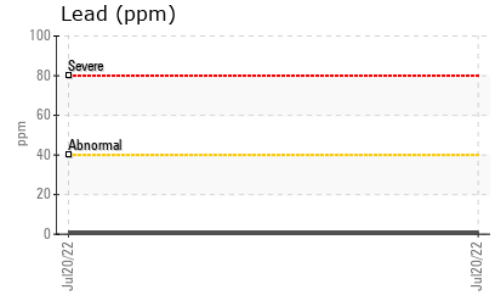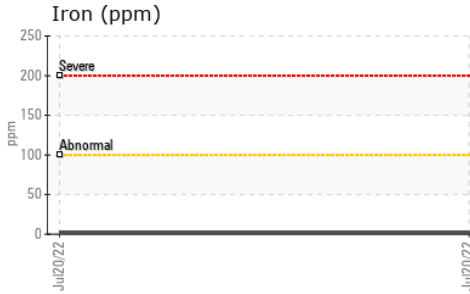

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GD0005526
Lab Number : 02502323
Unique Number : 5435284
Test Package : MOB 1

Generatrice Drummond
 243 rue des ARTISANS
 SAINT-GERMAIN-DE-GRANTHAM, QC
 CA J0C 1K0
 Contact: Valerie Poirier
 poiirivalerie@generatricedrummond.com
 T: (819)398-6811
 F: (819)398-7022

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.