



# FUEL REPORT

Sample Rating Trend

ISO



Area

## GARNISON OF MONTREAL [VQ6011]

Machine Id


### GD12150

Component

#### Diesel Fuel

Fluid

#### No.2 DIESEL FUEL (LOW-SULPHUR) (--- LTR)

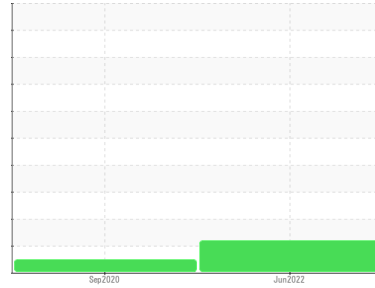

### DIAGNOSIS

#### Recommendation

Les tests de laboratoire indiquent que ce carburant peut être utilisé et qu'il répond à toutes les exigences. Nous vous recommandons de filtrer ce fluide avant de l'utiliser. Nous recommandons le remplacement des filtres de ce composant. Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

#### Contaminants

Il y a une légère quantité de limon (particules de 4 à 14 microns) dans le carburant. La teneur en eau est négligeable.

#### Fuel Condition

le carburant ne peut plus être utilisée en raison de la présence de contaminants. Tous les tests en laboratoire indiquent que cet échantillon répond aux spécifications du diesel n° 2 à basse teneur en soufre (US EPA/CGSB-3.7-3 type B).

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>GD0005717</b>	GD0004543	---
Sample Date	Client Info			<b>28 Jun 2022</b>	24 Sep 2020	---
Machine Age	hrs	Client Info		<b>0</b>	1336	---
Sample Status				<b>ATTENTION</b>	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	<b>0.828</b>	0.828	---
Fuel Color	text	Visual Screen*	Yellow	<b>Pink</b>	Pink	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	<b>2.2</b>	2.2	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	<b>51.8</b>	52.8	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	250	<b>108</b>	14	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	<b>156</b>	156	---
5% Distillation Point	°C	ASTM D2887*		<b>173</b>	175	---
10% Distill Point	°C	ASTM D2887*	201	<b>184</b>	186	---
15% Distillation Point	°C	ASTM D2887*		<b>191</b>	194	---
20% Distill Point	°C	ASTM D2887*	216	<b>200</b>	203	---
30% Distill Point	°C	ASTM D2887*	230	<b>216</b>	220	---
40% Distill Point	°C	ASTM D2887*	243	<b>232</b>	235	---
50% Distill Point	°C	ASTM D2887*	255	<b>248</b>	251	---
60% Distill Point	°C	ASTM D2887*	267	<b>264</b>	266	---
70% Distill Point	°C	ASTM D2887*	280	<b>279</b>	283	---
80% Distill Point	°C	ASTM D2887*	295	<b>298</b>	302	---
85% Distillation Point	°C	ASTM D2887*		<b>309</b>	312	---
90% Distill Point	°C	ASTM D2887*	310	<b>321</b>	324	---
95% Distillation Point	°C	ASTM D2887*		<b>339</b>	341	---
Final Boiling Point	°C	ASTM D2887*	341	<b>352</b>	355	---






IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	<b>39</b>	39	---
Cetane Index		ASTM D4737*	<40.0	<b>49</b>	50	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	<b>0</b>	0	---
Sodium	ppm	ASTM D5185(m)	<0.1	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185(m)	<0.1	<b>0</b>	<1	---
Water	%	ASTM D6304*	<0.05	<b>0.004</b>	0.003	---
ppm Water	ppm	ASTM D6304*	<500	<b>45.9</b>	33.0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	<b>2263</b>	948	---
Particles >6µm		ASTM D7647	>640	<b>780</b>	172	---
Particles >14µm		ASTM D7647	>80	<b>103</b>	11	---
Particles >21µm		ASTM D7647	>20	<b>28</b>	3	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	<b>18/17/14</b>	17/15/11	---






# FUEL REPORT

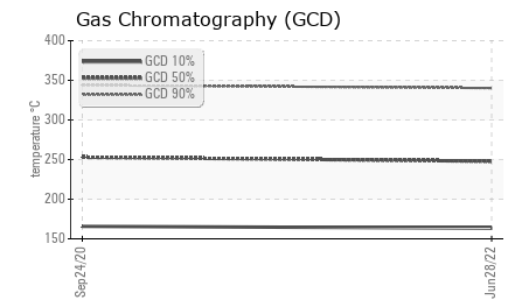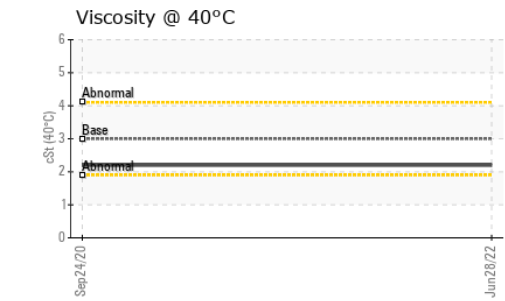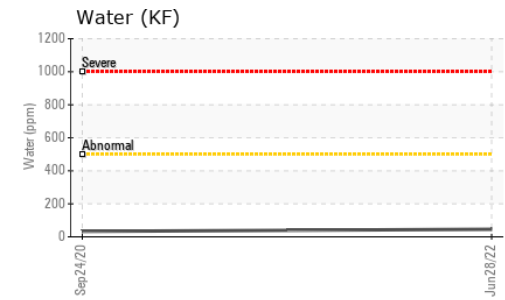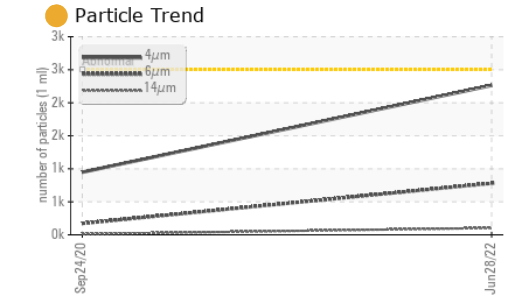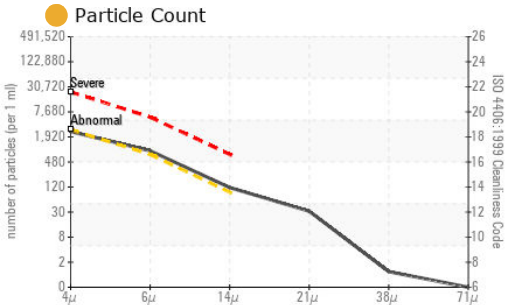

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Iron	ppm	ASTM D5185(m)	<1	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnesium	ppm	ASTM D5185(m)	<1	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	0	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

## GRAPHS

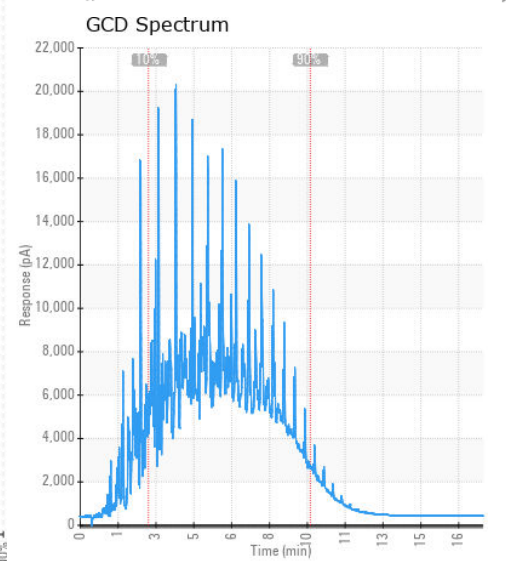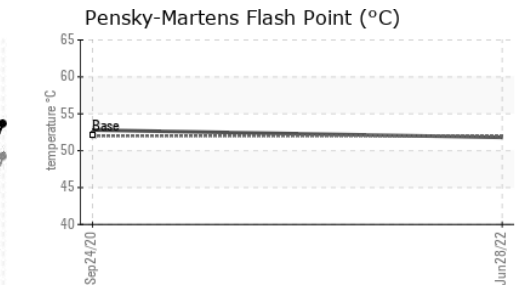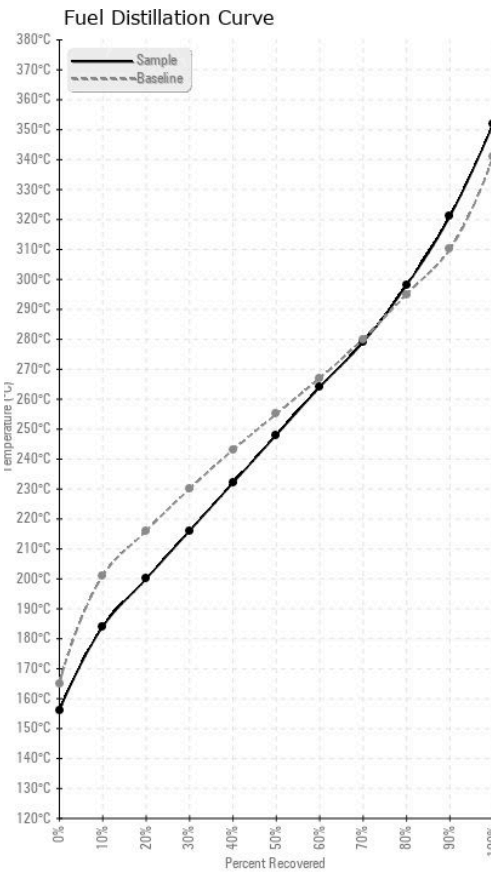

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : GD0005717  
**Lab Number** : **02502404**  
**Unique Number** : 5435365  
**Test Package** : FUEL ( Additional Tests: CC Flash, GC-PercFuel, PrtCount )

**Received** : 28 Jul 2022  
**Tested** : 31 Jul 2022  
**Diagnosed** : 02 Aug 2022 - Kevin Marson  
**Generatrice Drummond**  
 243 rue des ARTISANS  
 SAINT-GERMAIN-DE-GRANTHAM, QC  
 CA J0C 1K0  
 Contact: Valerie Poirier  
 poiirivalerie@generatricedrummond.com  
 T: (819)398-6811  
 F: (819)398-7022

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.