




OIL ANALYSIS REPORT

Sample Rating Trend

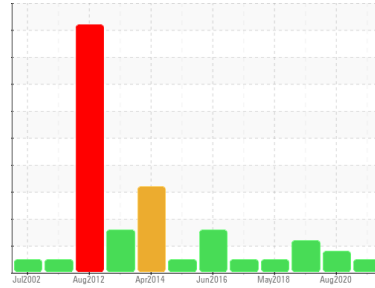

NORMAL



Machine Id
A9 - Turbine (Lower) Guide Bearing

Component
Lower Bearing

Fluid
PETRO CANADA TURBOFLO R&O 46 (350 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | WC0669283 | WC985265 | WC |
| Sample Date | Client Info | 05 Aug 2022 | 11 Aug 2020 | 09 Oct 2019 |
| Machine Age | hrs | Client Info | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | NORMAL | ABNORMAL | SEVERE |

CONTAMINATION

| method | limit/base | current | history1 | history2 |
|--------|--------------|------------|----------|----------|
| Water | WC Method >2 | NEG | NEG | NEG |

WEAR METALS

| method | limit/base | current | history1 | history2 |
|-----------|-----------------------|--------------|----------|----------|
| Iron | ppm ASTM D5185(m) >20 | <1 | <1 | <1 |
| Chromium | ppm ASTM D5185(m) >20 | 0 | 0 | 0 |
| Nickel | ppm ASTM D5185(m) >20 | 0 | 0 | 0 |
| Titanium | ppm ASTM D5185(m) | 0 | 0 | 0 |
| Silver | ppm ASTM D5185(m) | 0 | 0 | 0 |
| Aluminum | ppm ASTM D5185(m) >20 | <1 | <1 | <1 |
| Lead | ppm ASTM D5185(m) >20 | 1 | 7 | 5 |
| Copper | ppm ASTM D5185(m) >20 | <1 | <1 | <1 |
| Tin | ppm ASTM D5185(m) >20 | 0 | 0 | 0 |
| Antimony | ppm ASTM D5185(m) | 0 | <1 | <1 |
| Vanadium | ppm ASTM D5185(m) | 0 | 0 | 0 |
| Beryllium | ppm ASTM D5185(m) | 0 | 0 | 0 |
| Cadmium | ppm ASTM D5185(m) | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 |
|------------|---------------------|--------------|----------|----------|
| Boron | ppm ASTM D5185(m) | 0 | <1 | 0 |
| Barium | ppm ASTM D5185(m) | 0 | 0 | 0 |
| Molybdenum | ppm ASTM D5185(m) | 0 | 0 | 0 |
| Manganese | ppm ASTM D5185(m) | 0 | 0 | 0 |
| Magnesium | ppm ASTM D5185(m) | <1 | <1 | <1 |
| Calcium | ppm ASTM D5185(m) 0 | <1 | <1 | <1 |
| Phosphorus | ppm ASTM D5185(m) 3 | 4 | 2 | 2 |
| Zinc | ppm ASTM D5185(m) 0 | <1 | <1 | <1 |
| Sulfur | ppm ASTM D5185(m) | 143 | 66 | 45 |
| Lithium | ppm ASTM D5185(m) | <1 | <1 | <1 |

CONTAMINANTS





| method | limit/base | current | history1 | history2 |
|-----------|-----------------------|--------------|----------|----------|
| Silicon | ppm ASTM D5185(m) >15 | <1 | 2 | 2 |
| Sodium | ppm ASTM D5185(m) | <1 | 0 | 0 |
| Potassium | ppm ASTM D5185(m) >20 | 0 | <1 | <1 |

FLUID CLEANLINESS

| method | limit/base | current | history1 | history2 |
|-----------------|------------------------|----------------|------------|------------|
| Particles >4µm | ASTM D7647 >10000 | 3863 | ▲ 36094 | ▲ 101827 |
| Particles >6µm | ASTM D7647 >2500 | 257 | ● 2803 | ▲ 12138 |
| Particles >14µm | ASTM D7647 >160 | 4 | 16 | 19 |
| Particles >21µm | ASTM D7647 >40 | 1 | 4 | 4 |
| Particles >38µm | ASTM D7647 >10 | 1 | 0 | 0 |
| Particles >71µm | ASTM D7647 >3 | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) >20/18/14 | 19/15/9 | ▲ 22/19/11 | ▲ 24/21/11 |



OIL ANALYSIS REPORT

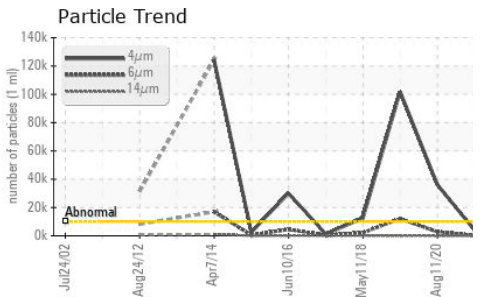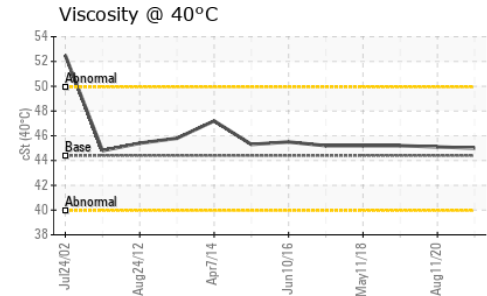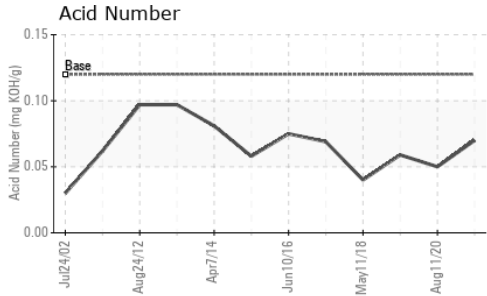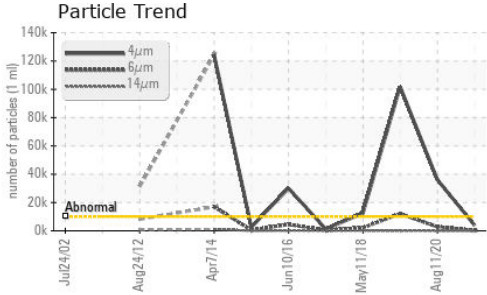



| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D974* | 0.12 | 0.07 | 0.05 | 0.059 |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Precipitate | scalar | Visual* | NONE | NONE | NONE | NONE |
| Silt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Debris | scalar | Visual* | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Appearance | scalar | Visual* | NORML | NORML | NORML | NORML |
| Odor | scalar | Visual* | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | Visual* | >2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|------------------|-----|---------------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 44.4 | 45.0 | 45.1 | 45.2 |

| SAMPLE IMAGES | | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
| Color | | | | | | |
| Bottom | | | | | | |

GRAPHS

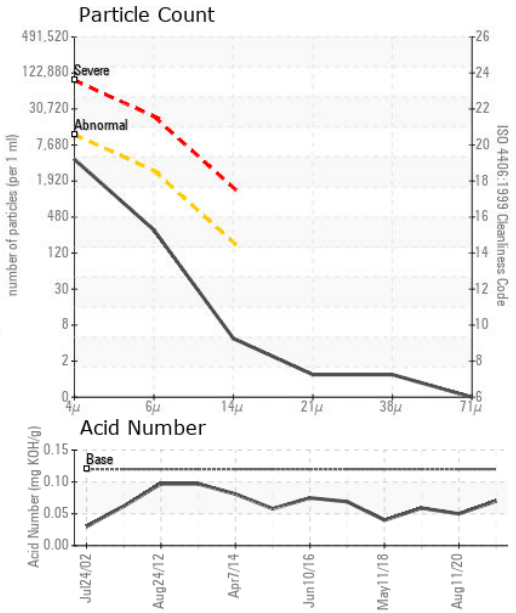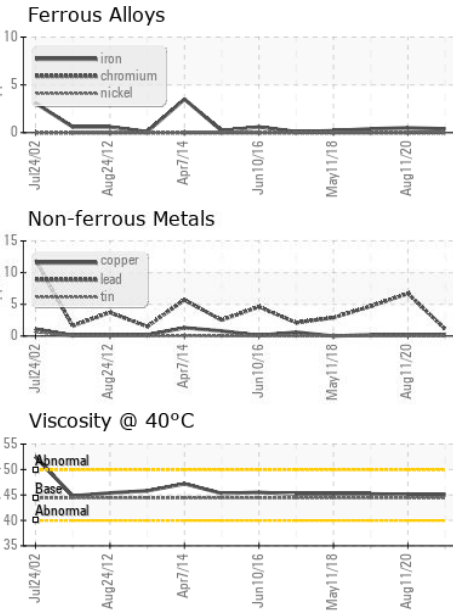

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0669283 **Received** : 31 Aug 2022
Lab Number : **02508121** **Tested** : 01 Sep 2022
Unique Number : 5449091 **Diagnosed** : 01 Sep 2022 - Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

Nalcor Energy - Churchill Falls
 PO Box 310
 Churchill Falls, NL
 CA A0R 1A0
 Contact: Robert Noel
 robertnoel@nlh.nl.ca
 T: (709)925-8294
 F: (709)925-8220

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.