




OIL ANALYSIS REPORT

Sample Rating Trend

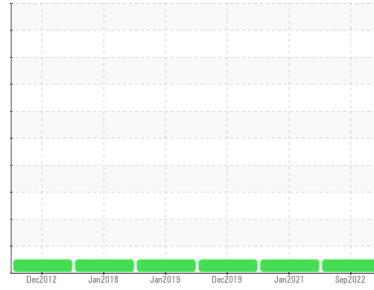

NORMAL



Area
MARS [136033]
 Machine Id
UNIT #1 (S/N 25291377)
 Component
Diesel Engine
 Fluid
VALVOLINE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		CU0019588	CU0017162	CU0015808
Sample Date	Client Info		07 Sep 2022	04 Jan 2021	23 Dec 2019
Machine Age	hrs	Client Info	355	325	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>90	2	2
Chromium	ppm	ASTM D5185(m)	>20	0	<1
Nickel	ppm	ASTM D5185(m)	>2	0	<1
Titanium	ppm	ASTM D5185(m)	>2	<1	<1
Silver	ppm	ASTM D5185(m)	>2	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1
Lead	ppm	ASTM D5185(m)	>40	1	<1
Copper	ppm	ASTM D5185(m)	>330	<1	<1
Tin	ppm	ASTM D5185(m)	>15	0	<1
Antimony	ppm	ASTM D5185(m)		0	0
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		19	58
Barium	ppm	ASTM D5185(m)		0	0
Molybdenum	ppm	ASTM D5185(m)		15	44
Manganese	ppm	ASTM D5185(m)		<1	<1
Magnesium	ppm	ASTM D5185(m)		156	606
Calcium	ppm	ASTM D5185(m)		2034	1423
Phosphorus	ppm	ASTM D5185(m)		942	989
Zinc	ppm	ASTM D5185(m)		973	1206
Sulfur	ppm	ASTM D5185(m)		2934	2699
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	3	3
Sodium	ppm	ASTM D5185(m)		3	4
Potassium	ppm	ASTM D5185(m)	>20	0	<1


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>6	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.8	6.1
Sulfation	Abs./1mm	ASTM D7415*	>30	17.5	19.3




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

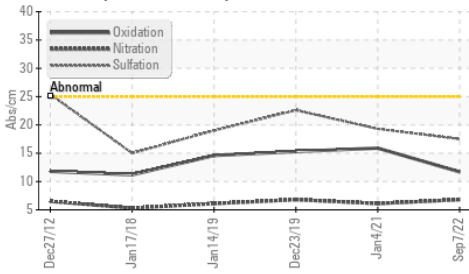

Additives

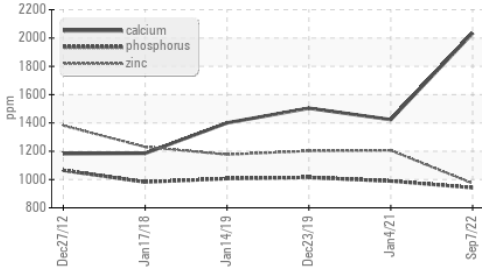

Additives

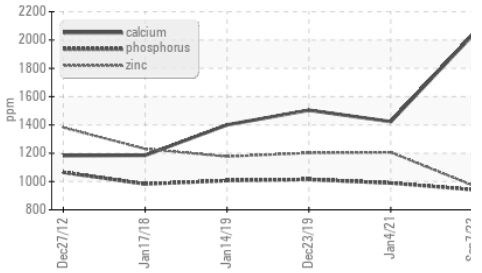

FLUID DEGRADATION method limit/base current history1 history2

Oxidation	Abs./1mm	ASTM D7414*	>25	11.7	15.9	15.3
-----------	----------	-------------	-----	-------------	------	------

VISUAL method limit/base current history1 history2

Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
------------------	--------	---------	------	------------	-----	-----


Free Water	scalar	Visual*		NEG	NEG	NEG
------------	--------	---------	--	------------	-----	-----

FLUID PROPERTIES method limit/base current history1 history2


Visc @ 100°C	cSt	ASTM D7279(m)		14.0	14.0	14.6
--------------	-----	---------------	--	-------------	------	------

GRAPHS


Iron (ppm)

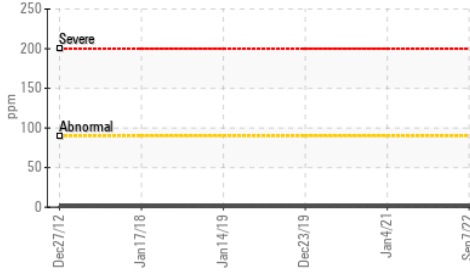


Lead (ppm)

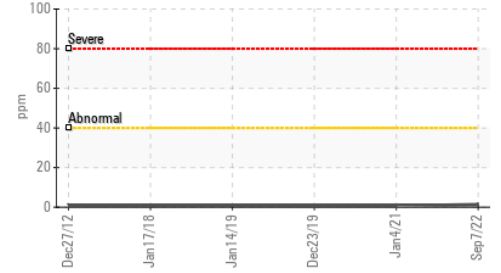


Aluminum (ppm)

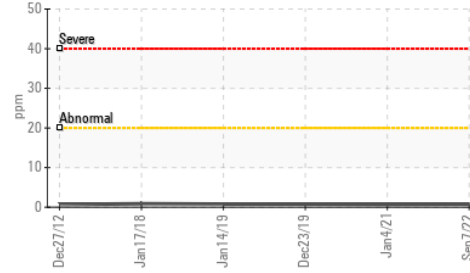


Chromium (ppm)

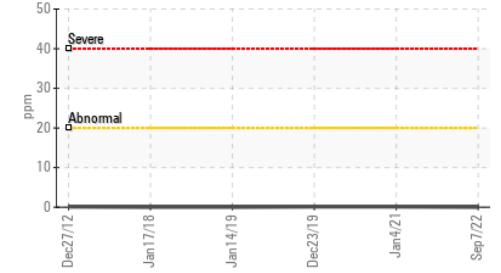


Copper (ppm)

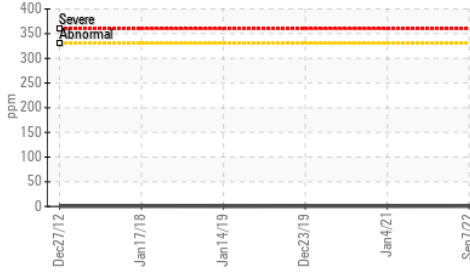


Silicon (ppm)

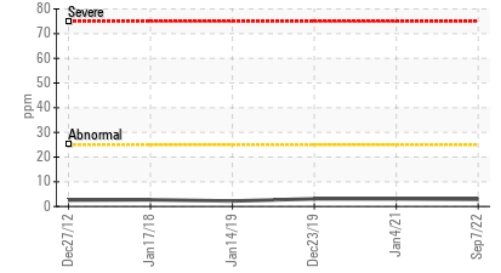

Viscosity @ 100°C

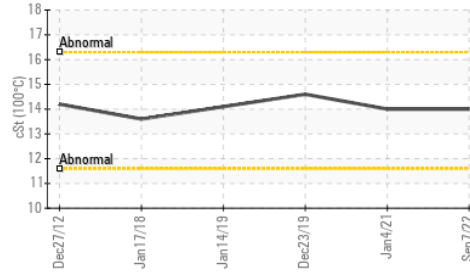

Soot %

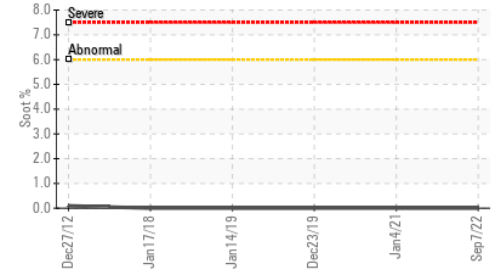

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **CUMMINS CANADA ULC - GENERATOR DIVISION**
Sample No. : CU0019588 **Received** : 14 Sep 2022 **7175 PACIFIC CIRCLE**
Lab Number : **02510463** **Tested** : 14 Sep 2022 **MISSISSAUGA, ON**
Unique Number : 5451433 **Diagnosed** : 14 Sep 2022 - Wes Davis **CA L5T 2A5**
Test Package : MOB 1 **Contact:** Elisia Johnson

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Validity of results and interpretation are based on the sample and information as supplied.

elisia.johnson@cummins.com

T: (905)795-0050

F: (905)795-9252