




PROBLEM SUMMARY


Area
[192027]
 Machine Id
MOP G GOV
 Component
Pump
 Fluid
ESSO TERESSO ISO 68 (91 LTR)

Sample Rating Trend

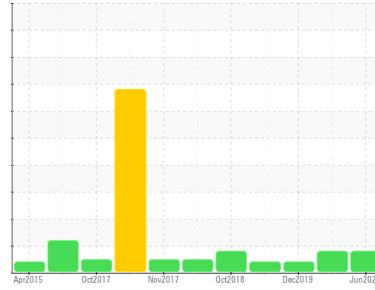

COMPONENT CONDITION SUMMARY

▲ Particle Trend

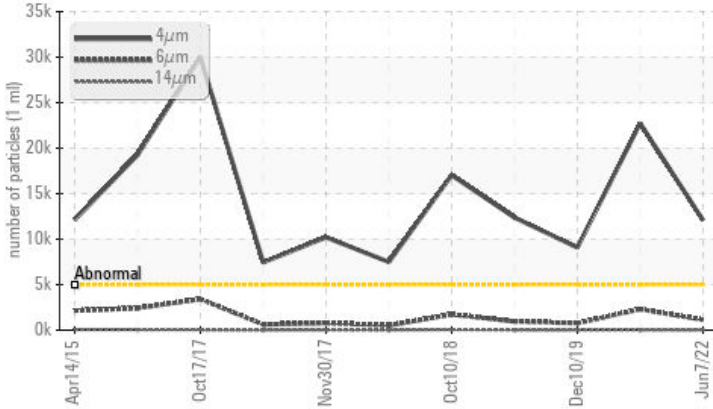

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	ATTENTION
Particles >4µm	ASTM D7647 >5000	▲ 12080	▲ 22727	▲ 9081
Oil Cleanliness	ISO 4406 (c) >19/17/14	▲ 21/17/11	▲ 22/18/12	▲ 20/17/11

Customer Id: NEWSTJ
 Sample No.: WC0445374
 Lab Number: 02517601
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

15 Apr 2021 Diag: Wes Davis

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles $>4\mu\text{m}$ are abnormally high. Particles $>6\mu\text{m}$ are notably high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



10 Dec 2019 Diag: Wes Davis

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



10 Apr 2019 Diag: Wes Davis

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles $>4\mu\text{m}$ are abnormally high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

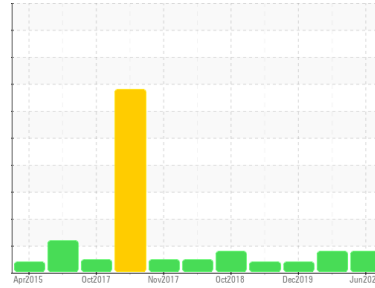

ISO



Area
[192027]
 Machine Id
MOP G GOV
 Component
Pump
 Fluid
ESSO TERESSO ISO 68 (91 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Oil Cleanliness are abnormally high. Particles >4µm are abnormally high.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0445374	WC0316794	WC0316875
Sample Date	Client Info		07 Jun 2022	15 Apr 2021	10 Dec 2019
Machine Age	days	Client Info	0	0	0
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ATTENTION

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	0	10
Iron	ppm	ASTM D5185(m) >90	3	3	2
Chromium	ppm	ASTM D5185(m) >5	0	0	<1
Nickel	ppm	ASTM D5185(m) >5	0	<1	<1
Titanium	ppm	ASTM D5185(m) >3	0	0	0
Silver	ppm	ASTM D5185(m) >3	0	0	0
Aluminum	ppm	ASTM D5185(m) >7	0	0	<1
Lead	ppm	ASTM D5185(m) >12	<1	<1	<1
Copper	ppm	ASTM D5185(m) >30	<1	<1	<1
Tin	ppm	ASTM D5185(m) >9	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES






	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 4.5	0	<1	<1
Barium	ppm	ASTM D5185(m) 0.4	0	<1	<1
Molybdenum	ppm	ASTM D5185(m) 0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m) 0	0	0	0
Calcium	ppm	ASTM D5185(m) 0	0	<1	<1
Phosphorus	ppm	ASTM D5185(m) 0.7	23	12	12
Zinc	ppm	ASTM D5185(m) 0	15	12	12
Sulfur	ppm	ASTM D5185(m) 1315	1533	1517	1540
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >60	0	0	0
Sodium	ppm	ASTM D5185(m)	0	0	0
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1



OIL ANALYSIS REPORT

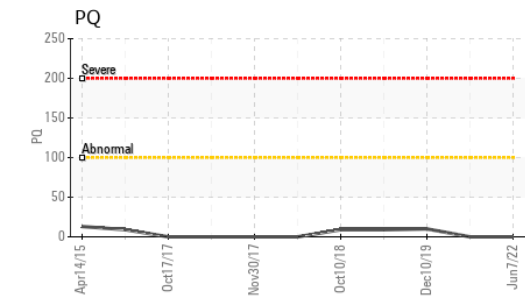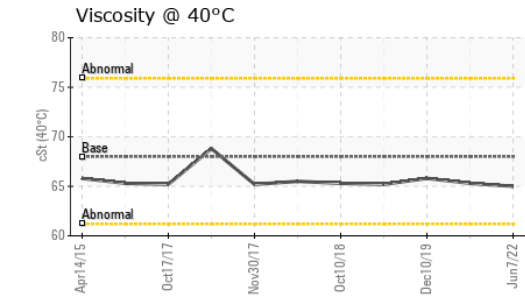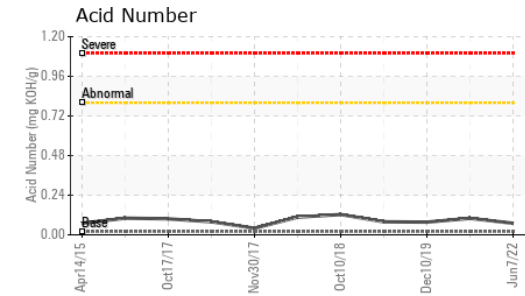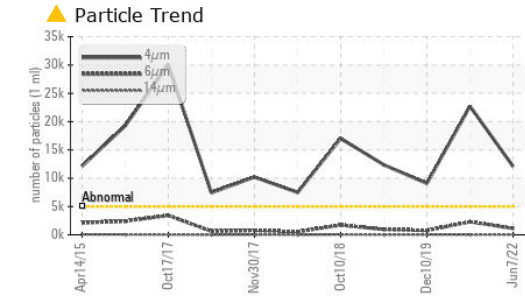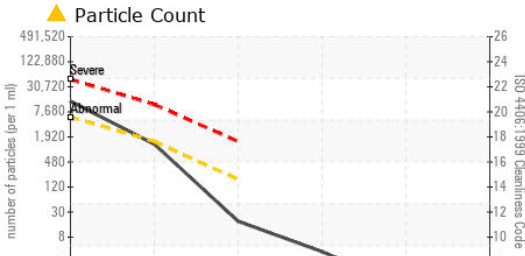

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0445374 **Received** : 20 Oct 2022
Lab Number : 02517601 **Diagnosed** : 25 Oct 2022
Unique Number : 5474581 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: PrtCount, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 12080	▲ 22727	▲ 9081
Particles >6µm	ASTM D7647	>1300	1124	▲ 2296	758
Particles >14µm	ASTM D7647	>160	16	25	14
Particles >21µm	ASTM D7647	>40	3	3	5
Particles >38µm	ASTM D7647	>10	0	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/17/11	▲ 22/18/12	▲ 20/17/11

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	0.02	0.07	0.10	0.077

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	VLITE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*		NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	68	65.0	65.3	65.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

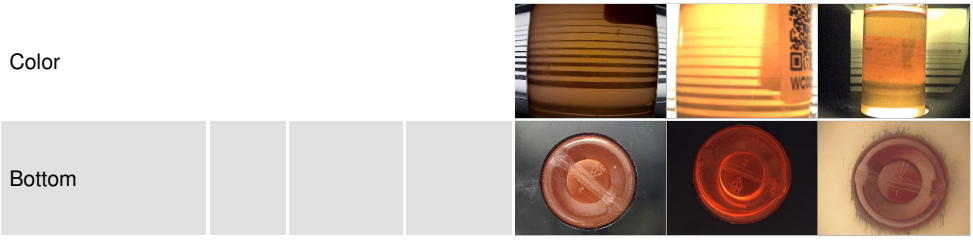

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Paul Martin
 pmartin@newfoundlandpower.com
 T:
 F: (709)737-2926