




PROBLEM SUMMARY

Sample Rating Trend


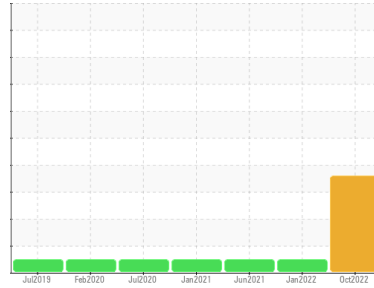


DEGRADATION



Machine Id
#3 CO2 Compressor
 Component
Reciprocating Compressor
 Fluid
PETRO CANADA COMPRO XL-R COMPRESSOR FLUID (40 LTR)

COMPONENT CONDITION SUMMARY

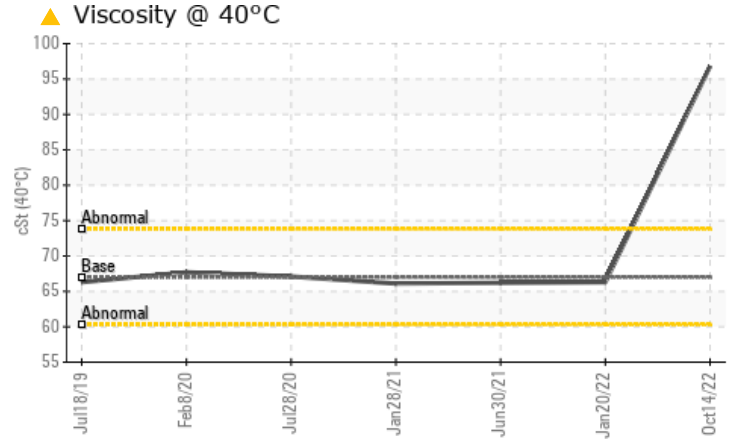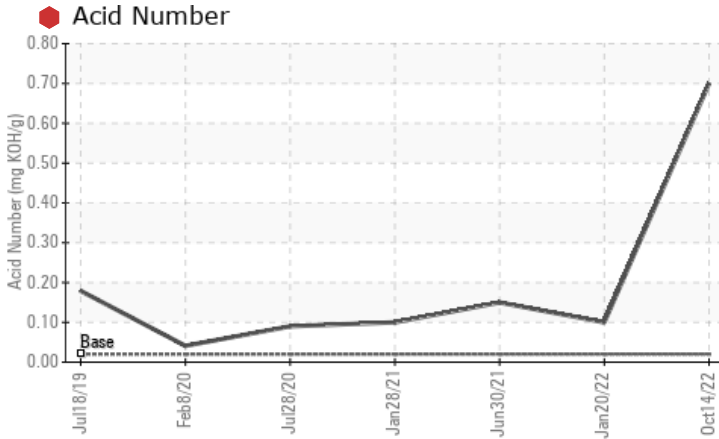

RECOMMENDATION

Due to this condition we recommend the following action... We advise an early resample to confirm this situation. NOTE: The current sample results do not match this units historical trend, indicating the sample may not be from this component/unit.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	NORMAL	NORMAL
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	0.70	0.10	0.15
Visc @ 40°C	cSt	ASTM D7279(m)	67.0	96.8	66.3	66.2

Customer Id: MOLETO
 Sample No.: PP
 Lab Number: 02518377
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We advise an early resample to confirm this situation.
Alert	---	---	?	NOTE: The current sample results do not match this units historical trend, indicating the sample may not be from this component/unit.

HISTORICAL DIAGNOSIS

20 Jan 2022 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Jun 2021 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



28 Jan 2021 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

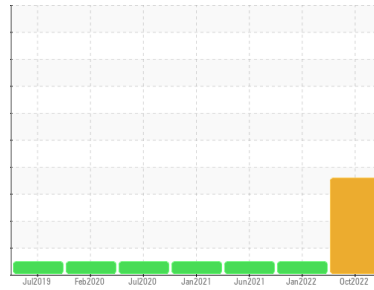

DEGRADATION



Machine Id
#3 CO2 Compressor

Component
Reciprocating Compressor

Fluid
PETRO CANADA COMPRO XL-R COMPRESSOR FLUID (40 LTR)

DIAGNOSIS

Recommendation

Due to this condition we recommend the following action... We advise an early resample to confirm this situation. NOTE: The current sample results do not match this units historical trend, indicating the sample may not be from this component/unit.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The oil viscosity is higher than normal. The high AN level of the oil indicates the presence of oxidized products. The AN level is much higher than the recommended limit. Viscosity of sample indicates oil is within ISO 100 range, advise investigate. The oil is no longer serviceable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PP	PP	PP
Sample Date	Client Info		14 Oct 2022	20 Jan 2022	30 Jun 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m) >50	2	0	0
Chromium	ppm	ASTM D5185(m) >10	0	0	0
Nickel	ppm	ASTM D5185(m)	<1	<1	0
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >25	0	0	0
Lead	ppm	ASTM D5185(m) >25	0	0	<1
Copper	ppm	ASTM D5185(m) >50	<1	<1	<1
Tin	ppm	ASTM D5185(m) >15	0	0	<1
Antimony	ppm	ASTM D5185(m)	<1	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	2	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	<1
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	<1
Calcium	ppm	ASTM D5185(m)	<1	<1	<1
Phosphorus	ppm	ASTM D5185(m) 460	381	532	543
Zinc	ppm	ASTM D5185(m)	9	<1	<1
Sulfur	ppm	ASTM D5185(m)	282	361	376
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	1	0	0
Sodium	ppm	ASTM D5185(m)	<1	0	0
Potassium	ppm	ASTM D5185(m) >20	0	<1	<1
Water	%	ASTM D6304* >0.1	0.019	---	---
ppm Water	ppm	ASTM D6304* >1000	195.8	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.02	0.70	0.10	0.15




OIL ANALYSIS REPORT

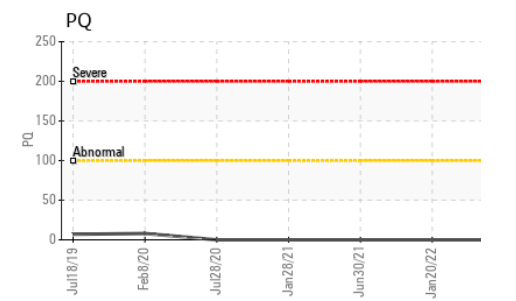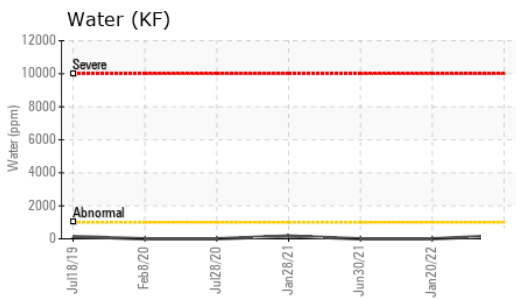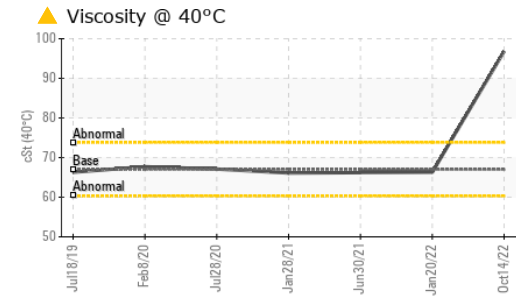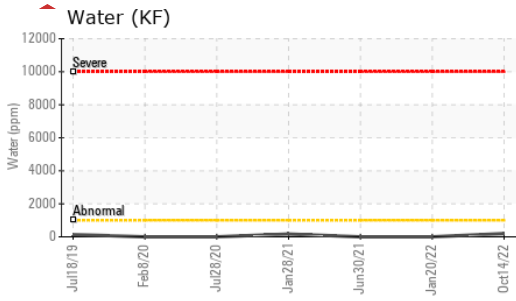






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	67.0 ▲ 96.8	66.3	66.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

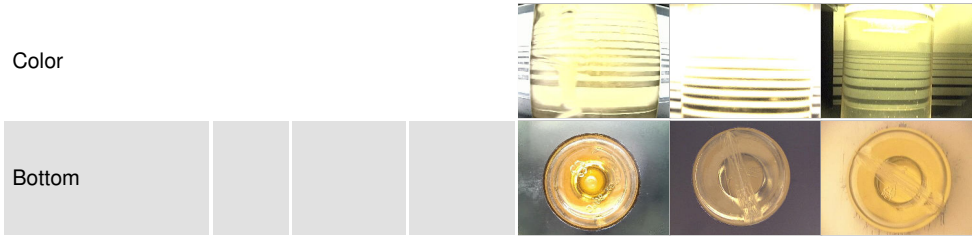

GRAPHS

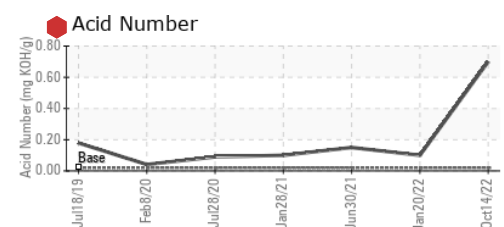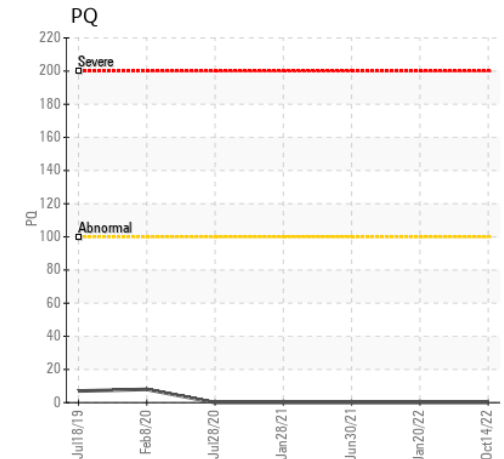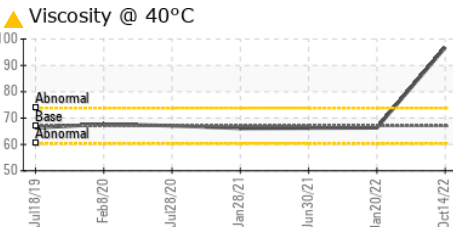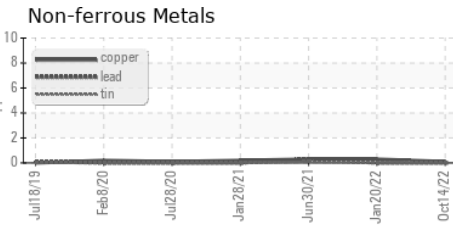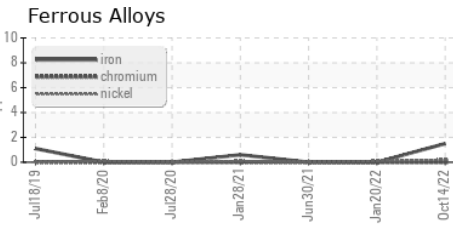

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP **Received** : 25 Oct 2022
Lab Number : 02518377 **Diagnosed** : 27 Oct 2022
Unique Number : 5475357 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: KF, TAN Man)

MOLSON TORONTO
 1 CARLINGVIEW DRIVE
 TORONTO, ON
 CA M9W 5E5
 Contact: Brian Goddard
 brian.goddard@molsoncoors.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.