




# OIL ANALYSIS REPORT

Sample Rating Trend

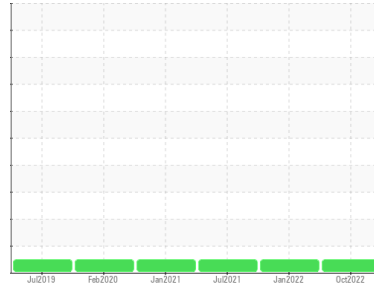

**NORMAL**



Machine Id

**#11**

Component

**Air Compressor**

Fluid

**INGERSOLL-RAND SSR ULTRA COOLANT (90 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PP</b>	PP	PP
Sample Date	Client Info		<b>14 Oct 2022</b>	20 Jan 2022	11 Jul 2021
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >4	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185(m) >10	<b>0</b>	0	0
Lead	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	8	4
Copper	ppm	ASTM D5185(m) >40	<b>&lt;1</b>	2	1
Tin	ppm	ASTM D5185(m) >5	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	1
Barium	ppm	ASTM D5185(m) 500	<b>969</b>	788	787
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185(m) 0	<b>1</b>	2	2
Phosphorus	ppm	ASTM D5185(m) 20	<b>&lt;1</b>	17	17
Zinc	ppm	ASTM D5185(m) 0	<b>2</b>	4	4
Sulfur	ppm	ASTM D5185(m) 200	<b>263</b>	228	233
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	<1

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>1</b>	<1	<1
Sodium	ppm	ASTM D5185(m)	<b>2</b>	1	<1
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	1	2
Water	%	ASTM D6304* >0.6	<b>0.098</b>	---	---
ppm Water	ppm	ASTM D6304* >6000	<b>986.9</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>0.04</b>	0.09	0.09



# OIL ANALYSIS REPORT


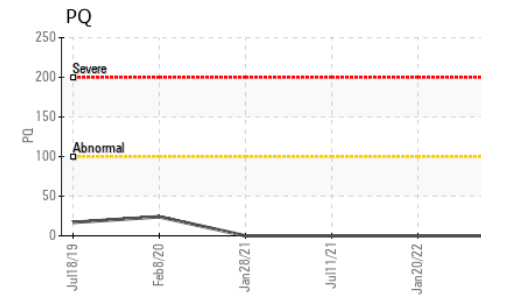
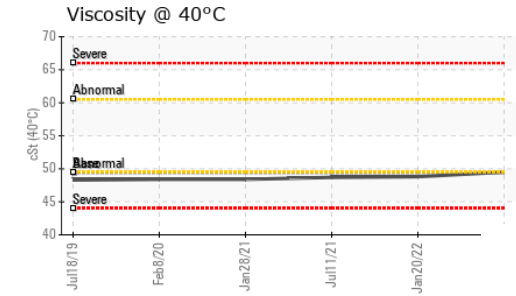
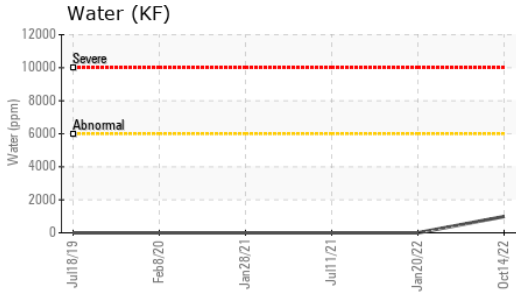
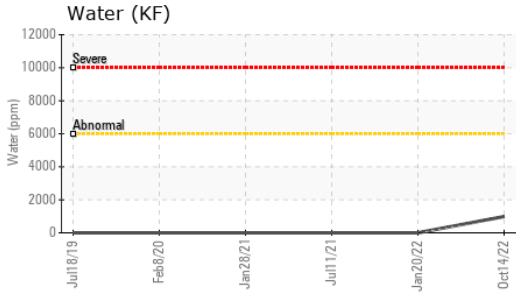


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.6	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	49.4	<b>49.5</b>	48.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

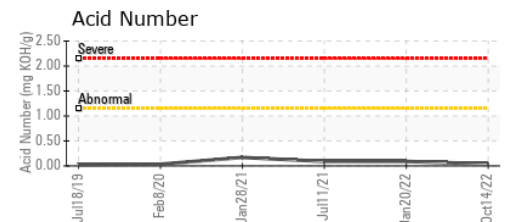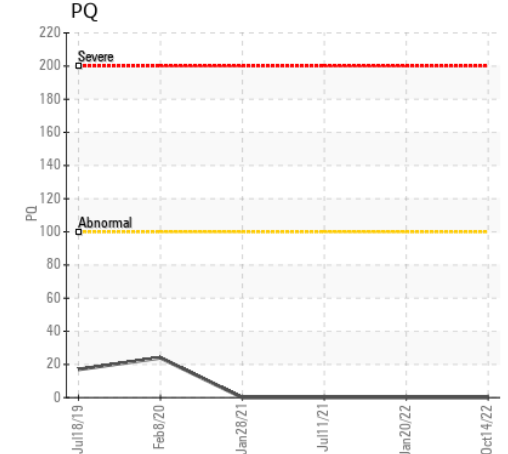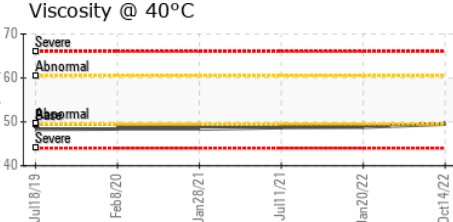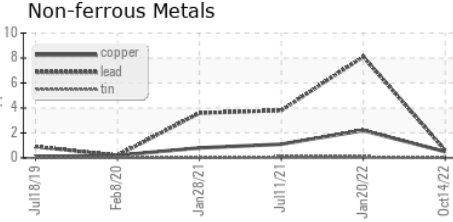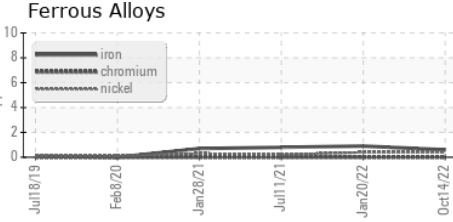

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PP **Received** : 25 Oct 2022  
**Lab Number** : 02518380 **Diagnosed** : 26 Oct 2022  
**Unique Number** : 5475360 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KF )

**MOLSON TORONTO**  
 1 CARLINGVIEW DRIVE  
 TORONTO, ON  
 CA M9W 5E5  
 Contact: Brian Goddard  
 brian.goddard@molsoncoors.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.