




OIL ANALYSIS REPORT

Sample Rating Trend

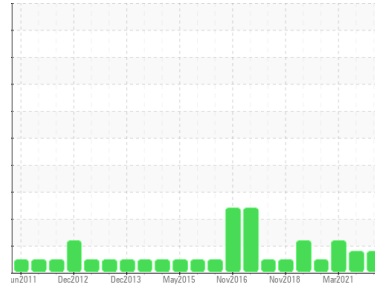

FUEL



Area
POWER PLANT-ENGINEERING DEPT
 Machine Id
Emergency Diesel Generating Set (S/N Tag No: 00XJA50AG001)
 Component
Diesel Engine
 Fluid
CAT DIESEL ENGINE OIL 15W40 (390 LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

Contaminants

Light fuel dilution occurring. The water content is negligible. No other contaminants were detected in the oil.

Oil Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | WC | WC | WC |
| Sample Date | Client Info | 26 Oct 2022 | 29 Aug 2021 | 22 Mar 2021 |
| Machine Age | hrs | Client Info | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | MARGINAL | MARGINAL | MARGINAL |

WEAR METALS

| method | limit/base | current | history1 | history2 | |
|-----------|------------|--------------------|--------------|----------|----|
| Iron | ppm | ASTM D5185(m) >100 | 7 | 8 | 8 |
| Chromium | ppm | ASTM D5185(m) >20 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185(m) >4 | <1 | <1 | <1 |
| Titanium | ppm | ASTM D5185(m) | <1 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) >3 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185(m) >20 | 1 | 1 | 1 |
| Lead | ppm | ASTM D5185(m) >40 | 1 | 1 | 1 |
| Copper | ppm | ASTM D5185(m) >330 | 25 | 32 | 24 |
| Tin | ppm | ASTM D5185(m) >15 | <1 | 1 | <1 |
| Antimony | ppm | ASTM D5185(m) | <1 | <1 | <1 |
| Vanadium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 | |
|------------|------------|--------------------|--------------|----------|------|
| Boron | ppm | ASTM D5185(m) | 4 | 4 | 4 |
| Barium | ppm | ASTM D5185(m) | 3 | 3 | 3 |
| Molybdenum | ppm | ASTM D5185(m) | 25 | 24 | 25 |
| Manganese | ppm | ASTM D5185(m) | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185(m) | 427 | 394 | 441 |
| Calcium | ppm | ASTM D5185(m) | 2405 | 2438 | 2293 |
| Phosphorus | ppm | ASTM D5185(m) | 1265 | 1205 | 1189 |
| Zinc | ppm | ASTM D5185(m) 1460 | 1358 | 1357 | 1379 |
| Sulfur | ppm | ASTM D5185(m) | 5653 | 5956 | 5581 |
| Lithium | ppm | ASTM D5185(m) | <1 | <1 | <1 |

CONTAMINANTS






| method | limit/base | current | history1 | history2 | |
|-----------|------------|-------------------|--------------|----------|-------|
| Silicon | ppm | ASTM D5185(m) >25 | 4 | 4 | 5 |
| Sodium | ppm | ASTM D5185(m) | 6 | 5 | 6 |
| Potassium | ppm | ASTM D5185(m) >20 | 1 | 1 | <1 |
| Fuel | % | ASTM D7593* >5 | ▲ 3.3 | ▲ 2.2 | 2.5 |
| Water | % | ASTM D6304* >0.2 | 0.068 | 0.080 | 0.052 |
| ppm Water | ppm | ASTM D6304* >2000 | 681.9 | 807.2 | 527.6 |
| Glycol | % | ASTM D7922* | 0.0 | 0.0 | 0.0 |

INFRA-RED

| method | limit/base | current | history1 | history2 | |
|-----------|------------|-----------------|-------------|----------|------|
| Soot % | % | ASTM D7844* >3 | 0 | 0 | 0 |
| Nitration | Abs/cm | ASTM D7624* >20 | 7.0 | 3.5 | 6.8 |
| Sulfation | Abs/.1mm | ASTM D7415* >30 | 17.7 | 12.9 | 18.4 |



OIL ANALYSIS REPORT

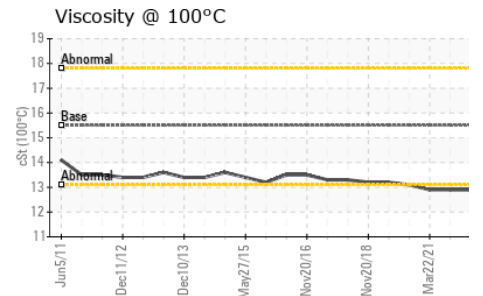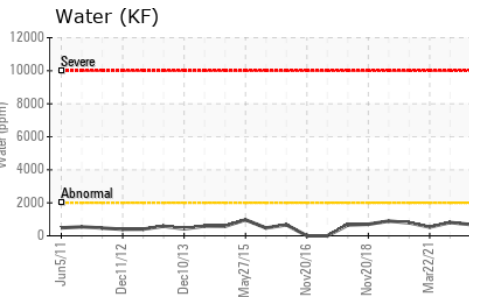
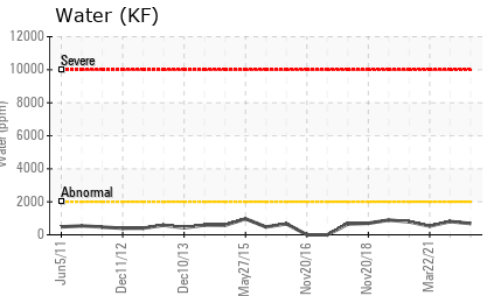
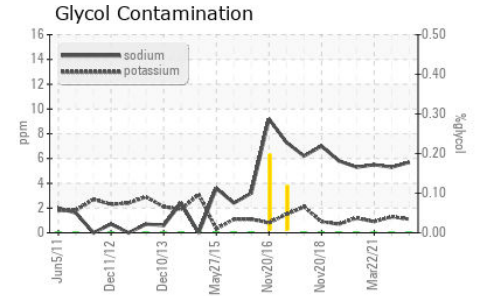
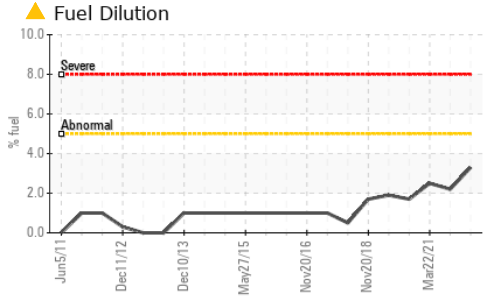


| FLUID DEGRADATION | method | limit/base | current | history1 | history2 | |
|-------------------|----------|-------------|---------|--------------|----------|------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 11.2 | 5.3 | 11.0 |
| Base Number (BN) | mg KOH/g | ASTM D2896* | 11.3 | 10.11 | 10.23 | 9.26 |

| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|------------|----------|-----|
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|---------------|---------|-------------|----------|------|
| Visc @ 100°C | cSt | ASTM D7279(m) | 15.5 | 12.9 | 12.9 | 12.9 |

GRAPHS

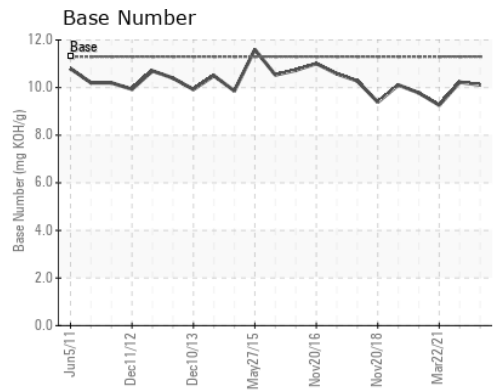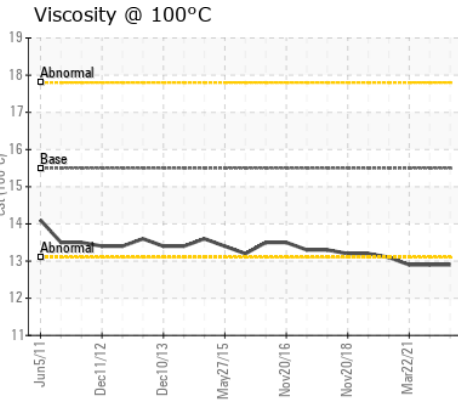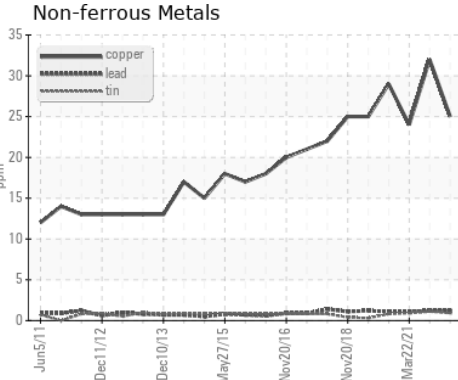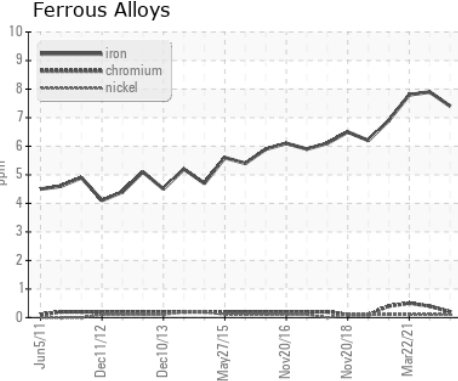

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC
Lab Number : **02521019**
Unique Number : 5486000
Test Package : DE TP (Additional Tests: FT-IR, PercentFuel, Spat)
Received : 07 Nov 2022
Tested : 08 Nov 2022
Diagnosed : 11 Nov 2022 - Bill Quesnel




Qatar Aluminium - Qatalum
 C Ring Road
 Doha, ZZ
 QA 23086
 Contact: Elmer Magadia
 Elmer.Magadia@qatalum.com
 T: 9(744)403-1718
 F: 9(743)319-2163

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.



FERROGRAPHY REPORT

Area
POWER PLANT-ENGINEERING DEPT
 Machine Id
Emergency Diesel Generating Set (S/N Tag No: 00XJA50AG001)
 Component
Diesel Engine
 Fluid
CAT DIESEL ENGINE OIL 15W40 (390 LTR)

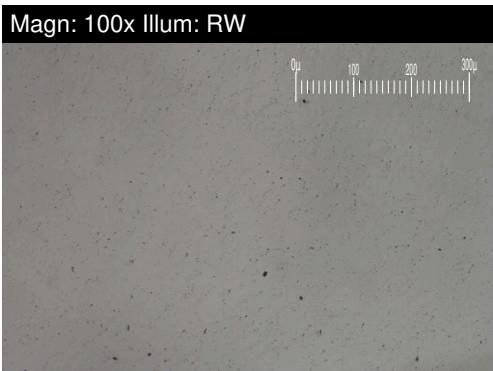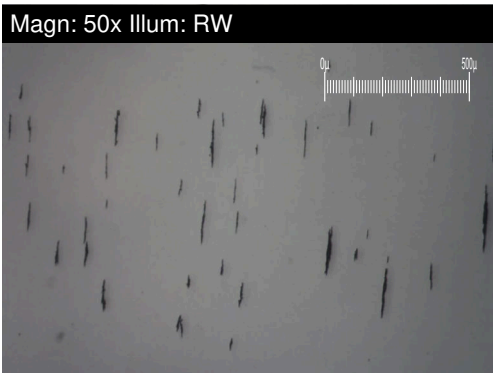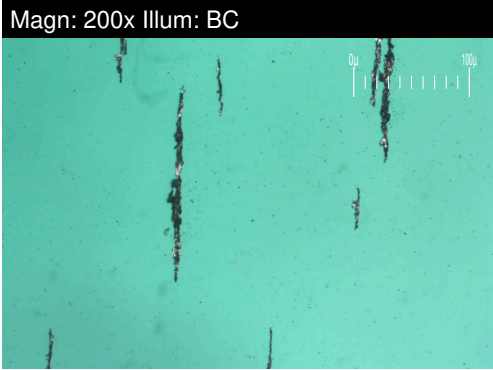


| DR-FERROGRAPHY | | method | limit/base | current | history1 | history2 |
|----------------------------|---|----------|------------|-------------|----------|----------|
| Large Particles | | DR-Ferr* | | 7.3 | 6.9 | 27.3 |
| Small Particles | | DR-Ferr* | | 5.2 | 3.9 | 6.4 |
| Total Particles | | DR-Ferr* | >--- | 12.5 | 10.8 | 33.7 |
| Large Particles Percentage | % | DR-Ferr* | | 16.8 | 27.8 | 62 |
| Severity Index | | DR-Ferr* | | 15 | 20.7 | 571 |

| FERROGRAPHY | | method | limit/base | current | history1 | history2 |
|-----------------------|------------|-------------|------------|----------|----------|----------|
| Ferrous Rubbing | Scale 0-10 | ASTM D7684* | | 2 | 2 | 2 |
| Ferrous Sliding | Scale 0-10 | ASTM D7684* | | | ▲ 2 | 2 |
| Ferrous Cutting | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Rolling | Scale 0-10 | ASTM D7684* | | 1 | 1 | 1 |
| Ferrous Break-in | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Spheres | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Black Oxides | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Red Oxides | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Corrosive | Scale 0-10 | ASTM D7684* | | 1 | | |
| Ferrous Other | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Rubbing | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Sliding | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Cutting | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Rolling | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Other | Scale 0-10 | ASTM D7684* | | | | |
| Carbonaceous Material | Scale 0-10 | ASTM D7684* | | | | |
| Lubricant Degradation | Scale 0-10 | ASTM D7684* | | | | |
| Sand/Dirt | Scale 0-10 | ASTM D7684* | | 1 | 1 | 1 |
| Fibres | Scale 0-10 | ASTM D7684* | | | | |
| Spheres | Scale 0-10 | ASTM D7684* | | | | |
| Other | Scale 0-10 | ASTM D7684* | | 1 | 1 | 1 |

WEAR

All component wear rates are normal.
 The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

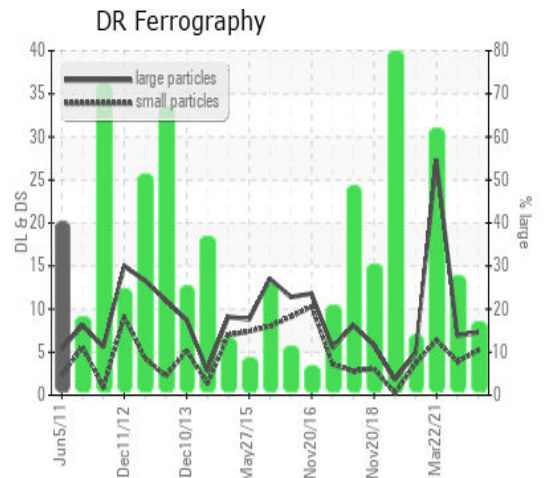

This page left intentionally blank