




# OIL ANALYSIS REPORT

Sample Rating Trend

OFF SPEC



Area  
**M13**  
 Machine Id  
**71-G-3300A MAIN POWER GENERATOR A (71-T-3580A) (S/N Maint Plan 22480)**  
 Component  
**Turbine**  
 Fluid  
**MOBIL DTE 846 (11708 LTR)**

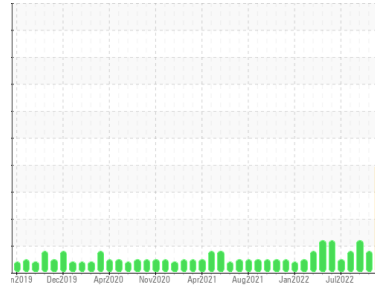

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. No other corrective action is recommended at this time.

### Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

### Contaminants

There is a light amount of silt (particulates < 14 microns in size) present in the oil. MPC (Membrane Patch Colorimetry) test indicates a light concentration of varnish present. The water content is negligible. The foaming tendency (Stage 1 and 2) are slightly higher than the limit (450 ml).

### Oil Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PP</b>	PP	PP
Sample Date	Client Info	<b>07 Nov 2022</b>	21 Oct 2022	23 Sep 2022
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ATTENTION</b>	ATTENTION	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >15	<b>0</b>	0
Chromium	ppm	ASTM D5185(m) >4	<b>0</b>	0
Nickel	ppm	ASTM D5185(m) >2	<b>0</b>	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0
Aluminum	ppm	ASTM D5185(m) >10	<b>&lt;1</b>	<1
Lead	ppm	ASTM D5185(m)	<b>0</b>	0
Copper	ppm	ASTM D5185(m) >5	<b>0</b>	0
Tin	ppm	ASTM D5185(m) >5	<b>0</b>	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1
Barium	ppm	ASTM D5185(m)	<b>0</b>	0
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0
Magnesium	ppm	ASTM D5185(m)	<b>0</b>	0
Calcium	ppm	ASTM D5185(m)	<b>0</b>	<1
Phosphorus	ppm	ASTM D5185(m)	<b>1239</b>	1229
Zinc	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1
Sulfur	ppm	ASTM D5185(m)	<b>21</b>	21
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>&lt;1</b>	0
Sodium	ppm	ASTM D5185(m)	<b>0</b>	<1
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	<1
Water	%	ASTM D6304* >0.06	<b>0.001</b>	0.001
ppm Water	ppm	ASTM D6304* >600	<b>4.2</b>	10.6


## INFRA-RED

method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	<b>0</b>	---
Nitration	Abs/cm	ASTM D7624*	<b>3.4</b>	---
Sulfation	Abs/.1mm	ASTM D7415*	<b>16.0</b>	---




# OIL ANALYSIS REPORT


● Foaming SEQ I/II/III

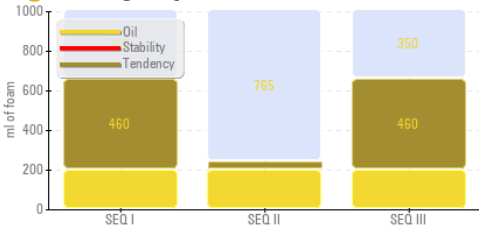


● Particle Count

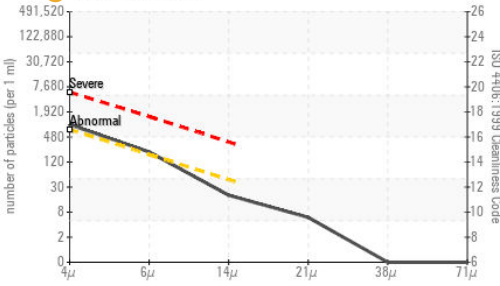


● Particle Trend

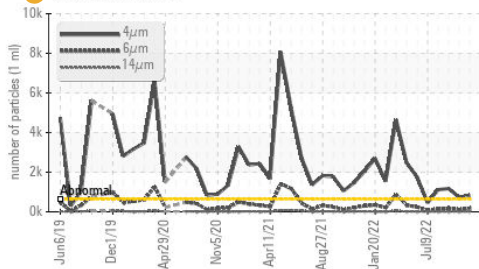

▲ Varnish Potential

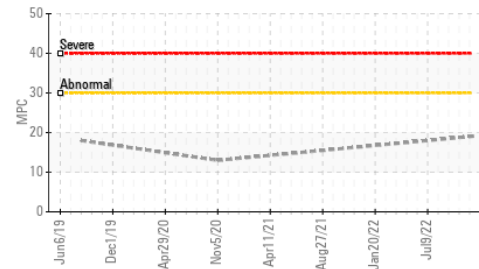

RPVOT

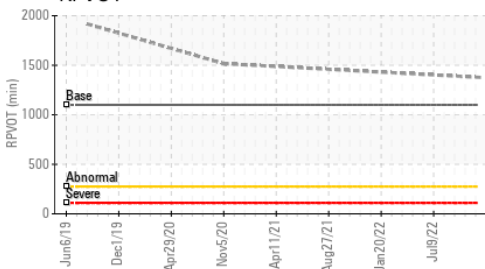

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>640	837	729	1176
Particles >6µm	ASTM D7647	>160	185	116	177
Particles >14µm	ASTM D7647	>40	17	16	13
Particles >21µm	ASTM D7647	>10	5	4	5
Particles >38µm	ASTM D7647	>3	0	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>16/14/12	17/15/11	17/14/11	17/15/11


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	4.3	---	---
Acid Number (AN)	mg KOH/g	ASTM D974*	0.06	0.06	0.12
Anti-Oxidant 1	%	ASTM D6971*	100	---	---
Anti-Oxidant 2	%	ASTM D6971*	31	---	---
MPC Varnish Potential	Scale	ASTM D7843(m)*	19	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.06	NEG	NEG
Free Water	scalar	Visual*	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	42.4	42.9	43.1
Visc @ 100°C	cSt	ASTM D7279(m)	6.2	7.2	7.2
Viscosity Index (VI)	Scale	ASTM D2270*	106	130	129
Separability	oil/h2o/em	ASTM D1401*	40/40/0	40/40/0 (17)	---
Air Release Time	min	ASTM D3427*	2	4.50	---
Foam Tendency	I/II/III	ASTM D892*	20	460/45/460	---
Foam Stability	I/II/III	ASTM D892*	0	0/0/0	---
COC Flash Point	°C	ASTM D92*	244	250	---
ASTM Color	scalar	ASTM D1500*	<3.5	---	---
Rust Prevention	PASS/FAIL	ASTM D665*	PASS	PASS	---
Oxidation Test (RPVOT)	minutes	ASTM D2272*	1100	1379	---

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	%	ASTM D893(m)*	0.028	---	---
Toluene Insolubles	%	ASTM D893(m)*	0.015	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

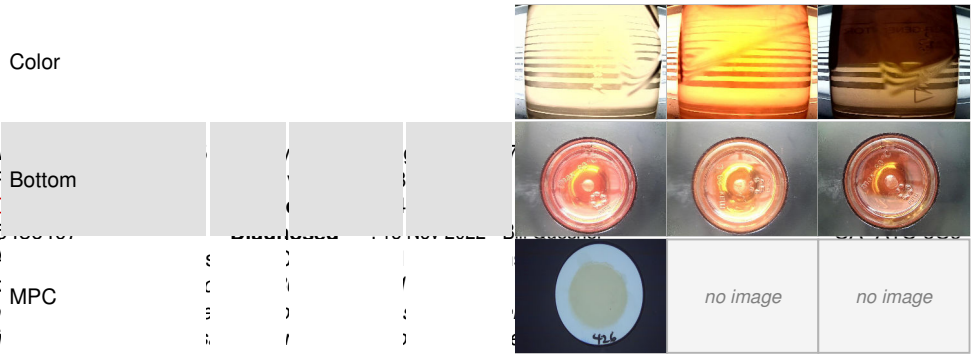




Laboratory Sample No. : V  
 Lab Number : C  
 Unique Number : 5  
 Test Package : /

To discuss this sample report, cc  
 Test denoted (\*) outside scope o  
 Validity of results and interpretati



# FERROGRAPHY REPORT

Area  
**M13**  
 Machine Id  
**71-G-3300A MAIN POWER GENERATOR A (71-T-3580A) (S/N Maint Plan 22480)**  
 Component  
**Turbine**  
 Fluid  
**MOBIL DTE 846 (11708 LTR)**

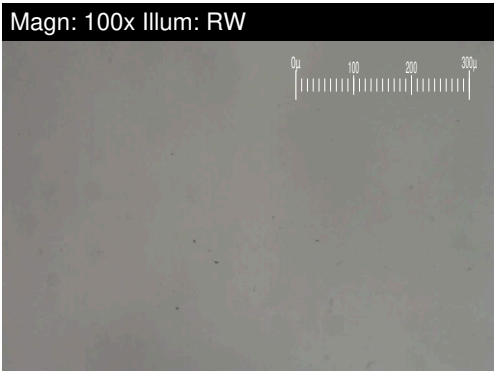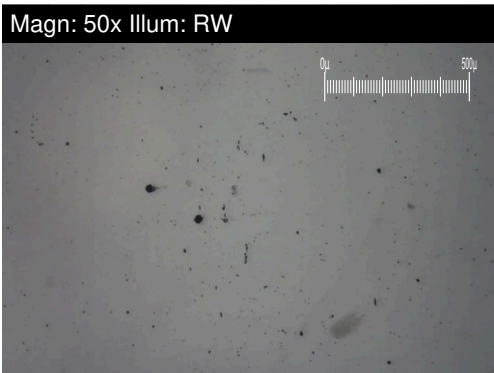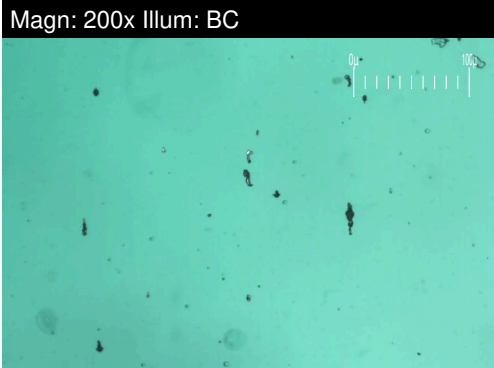


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>0.1</b>	---	---
Small Particles		DR-Ferr*		<b>0.5</b>	---	---
Total Particles		DR-Ferr*	>---	<b>0.6</b>	---	---
Large Particles Percentage	%	DR-Ferr*		<b>0</b>	---	---
Severity Index		DR-Ferr*		<b>0</b>	---	---


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		1		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1		
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		2		

### WEAR


All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

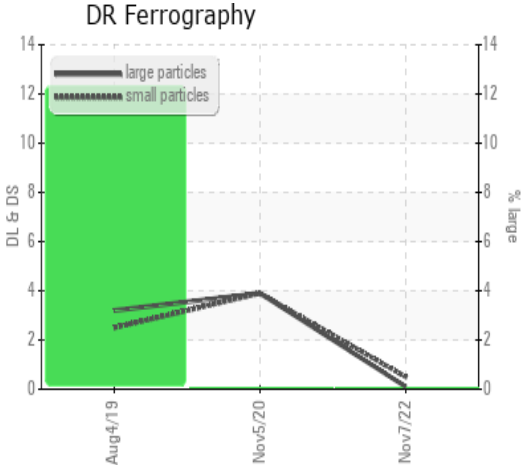


### Rotating Pressure Vessel Oxidation Test

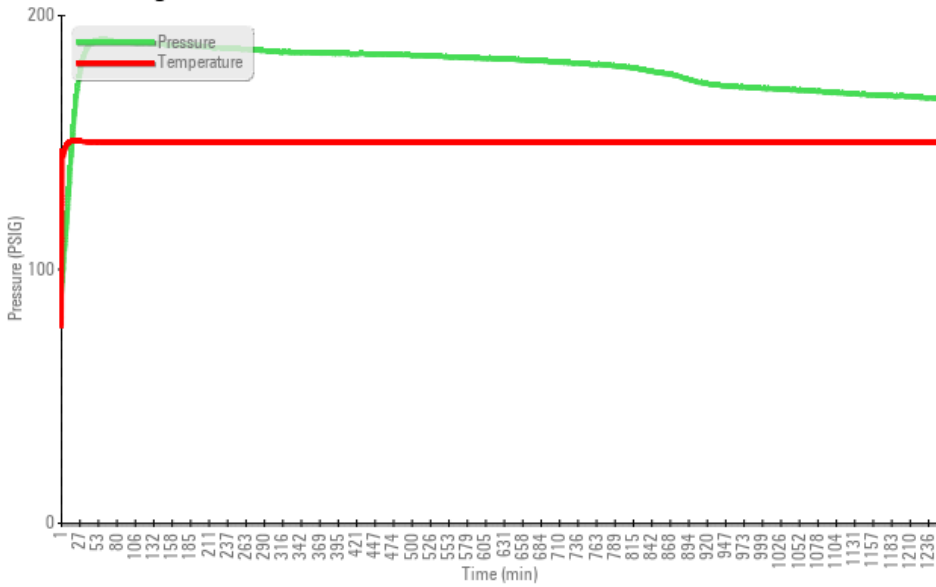


### Foaming SEQ I/II/III

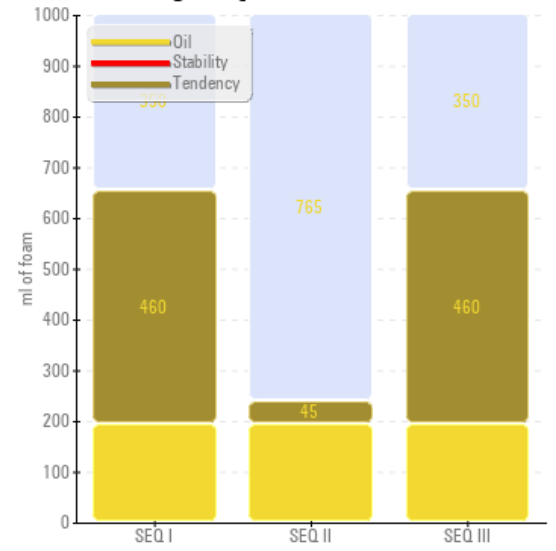

### Remaining Useful Life (RULER)

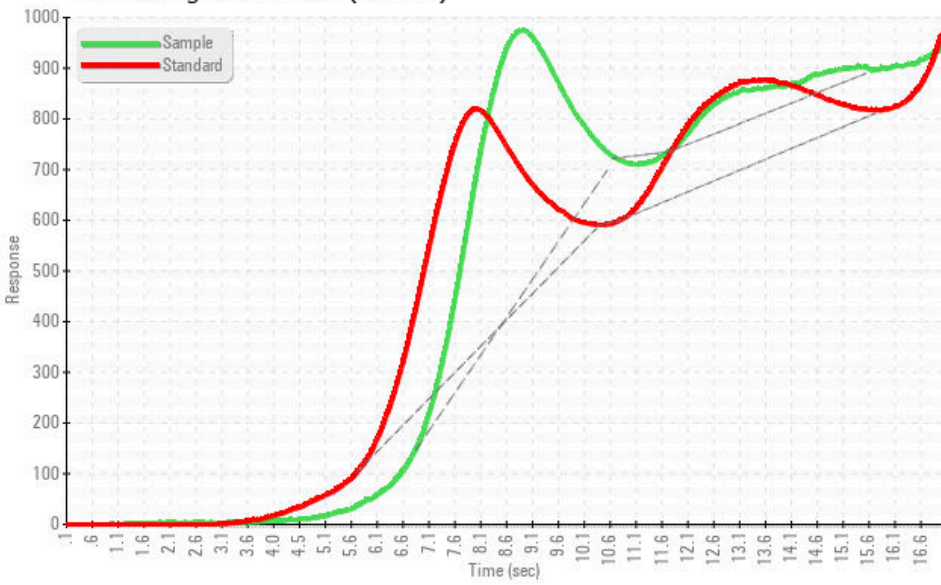

### Water Separability

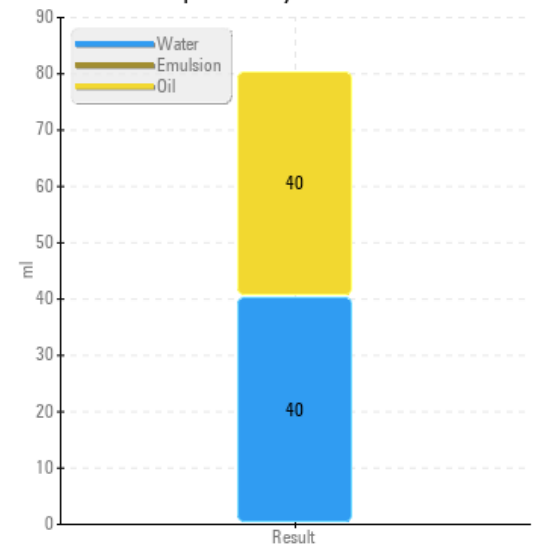

### MPC (Varnish Test)



### Sample Color & Clarity

