




OIL ANALYSIS REPORT

Sample Rating Trend

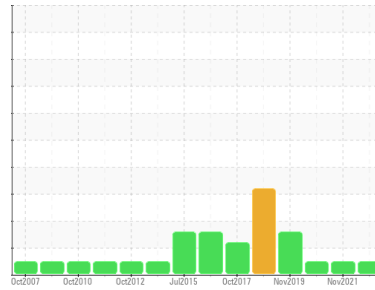

NORMAL



Machine Id
RAYTHEON YYR 1

Component
Hydraulic System

Fluid
PETRO CANADA SYNDURO SHB ISO 220 (83 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0479282	WC	WC965256
Sample Date	Client Info	12 Nov 2022	09 Nov 2021	23 Oct 2020
Machine Age	yrs Client Info	30	0	0
Oil Age	yrs Client Info	3	0	1
Oil Changed	Client Info	Changed	N/A	Not Chngd
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >20	<1	4	4
Chromium	ppm ASTM D5185(m) >20	0	<1	<1
Nickel	ppm ASTM D5185(m) >20	0	<1	<1
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	0	0	<1
Aluminum	ppm ASTM D5185(m) >20	<1	0	<1
Lead	ppm ASTM D5185(m) >20	<1	2	2
Copper	ppm ASTM D5185(m) >20	<1	<1	<1
Tin	ppm ASTM D5185(m) >20	0	0	<1
Antimony	ppm ASTM D5185(m)	0	<1	<1
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	<1	<1

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<1	7	7
Barium	ppm ASTM D5185(m) 5.0	0	0	<1
Molybdenum	ppm ASTM D5185(m)	<1	4	4
Manganese	ppm ASTM D5185(m)	0	0	<1
Magnesium	ppm ASTM D5185(m) 5.0	0	<1	2
Calcium	ppm ASTM D5185(m) 5.0	<1	4	6
Phosphorus	ppm ASTM D5185(m) 100	128	386	355
Zinc	ppm ASTM D5185(m) 5.0	3	26	28
Sulfur	ppm ASTM D5185(m) 1900	2136	4291	4297
Lithium	ppm ASTM D5185(m)	<1	2	3

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >15	1	4	6
Sodium	ppm ASTM D5185(m)	<1	2	3
Potassium	ppm ASTM D5185(m) >20	0	<1	<1


FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	2865	1244	2964
Particles >6µm	ASTM D7647 >1300	838	387	906
Particles >14µm	ASTM D7647 >160	81	26	70
Particles >21µm	ASTM D7647 >40	30	5	18
Particles >38µm	ASTM D7647 >10	8	0	2
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	19/17/14	17/16/12	19/17/13


FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974* 0.3	0.04	0.73	0.56


Particle Trend

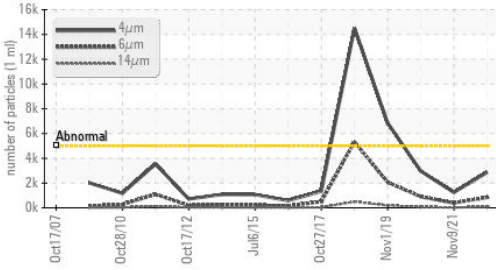


Acid Number

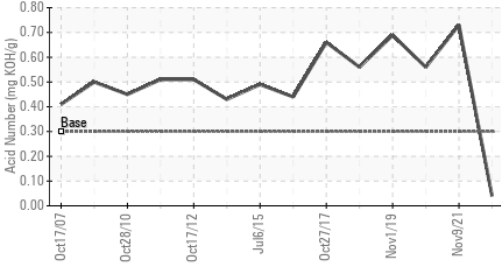

Viscosity @ 40°C

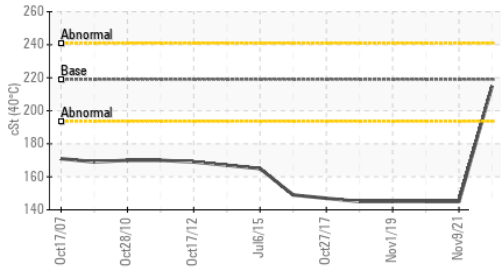

Particle Trend

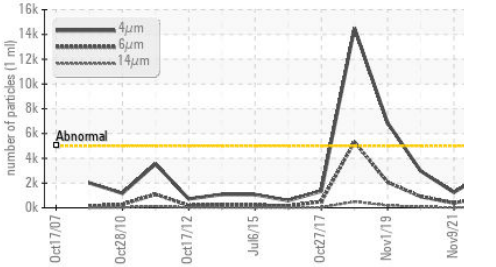

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	219	215	145

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

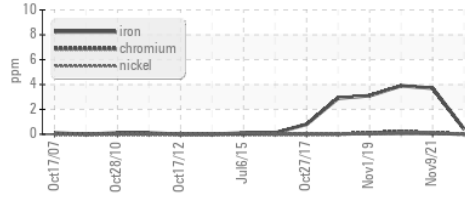


Non-ferrous Metals

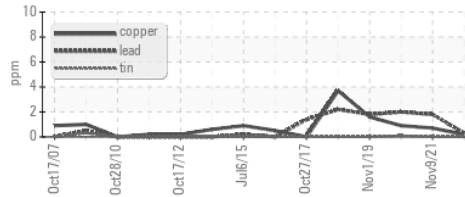


Viscosity @ 40°C

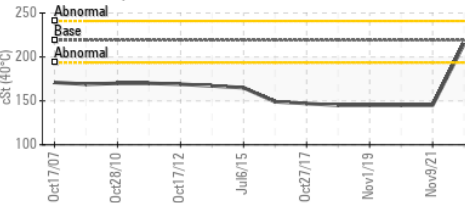

Particle Count

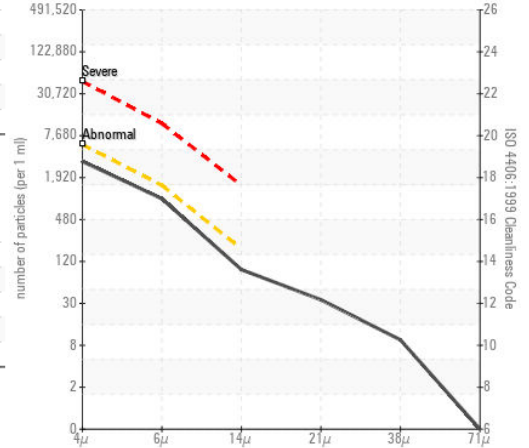

Acid Number

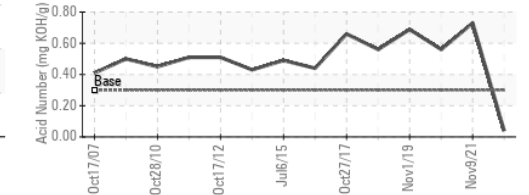

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 Sample No. : WC0479282
 Lab Number : 02525798
 Unique Number : 5490779
 Test Package : IND 2

Received : 30 Nov 2022
 Diagnosed : 01 Dec 2022
 Diagnostician : Kevin Marson

NAV CANADA
 P.O. BOX 250 STN C
 GOOSE BAY, NL
 CA A0P 1C0
 Contact: C Sintra

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (709)896-5482
 F: (709)896-0147