




OIL ANALYSIS REPORT

Sample Rating Trend

OFF SPEC

Area
M13
 Machine Id
71-G-3300C MAIN POWER GENERATOR C (71-T-3580C) (S/N Maint Plan 22480)
 Component
Turbine
 Fluid
MOBIL DTE 846 (11708 LTR)

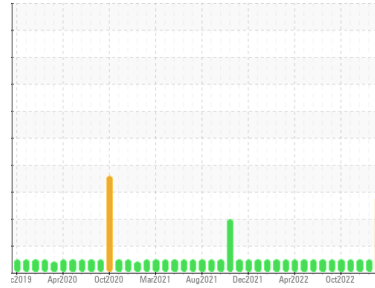

DIAGNOSIS

Recommendation

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend that you use electrostatic filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

Contaminants

MPC (Membrane Patch Colorimetry) test indicates a moderate concentration of varnish present. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible.

Oil Condition

Foaming Tendency (ASTM D892) results are abnormal indicating a tendency for oil foaming. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PP	PP	PP
Sample Date	Client Info	28 Dec 2022	17 Dec 2022	16 Nov 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	---	---
Iron	ppm	ASTM D5185(m) >15	0	0
Chromium	ppm	ASTM D5185(m) >4	0	0
Nickel	ppm	ASTM D5185(m) >2	0	<1
Titanium	ppm	ASTM D5185(m)	0	0
Silver	ppm	ASTM D5185(m)	0	0
Aluminum	ppm	ASTM D5185(m) >10	0	<1
Lead	ppm	ASTM D5185(m)	0	0
Copper	ppm	ASTM D5185(m) >5	0	0
Tin	ppm	ASTM D5185(m) >5	0	0
Antimony	ppm	ASTM D5185(m)	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0
Beryllium	ppm	ASTM D5185(m)	0	0
Cadmium	ppm	ASTM D5185(m)	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<1	<1
Barium	ppm	ASTM D5185(m)	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0
Manganese	ppm	ASTM D5185(m)	0	0
Magnesium	ppm	ASTM D5185(m)	0	0
Calcium	ppm	ASTM D5185(m)	0	0
Phosphorus	ppm	ASTM D5185(m)	1161	1183
Zinc	ppm	ASTM D5185(m)	<1	<1
Sulfur	ppm	ASTM D5185(m)	56	57
Lithium	ppm	ASTM D5185(m)	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<1	<1
Sodium	ppm	ASTM D5185(m)	0	0
Potassium	ppm	ASTM D5185(m) >20	<1	0
Water	%	ASTM D6304* >0.06	0.001	0.001
ppm Water	ppm	ASTM D6304* >600	12.7	9.9



INFRA-RED

method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	---
Nitration	Abs/cm	ASTM D7624*	3.3	---
Sulfation	Abs/.1mm	ASTM D7415*	16.0	---



FERROGRAPHY REPORT

Area
M13
 Machine Id
71-G-3300C MAIN POWER GENERATOR C (71-T-3580C) (S/N Maint Plan 22480)
 Component
Turbine
 Fluid
MOBIL DTE 846 (11708 LTR)

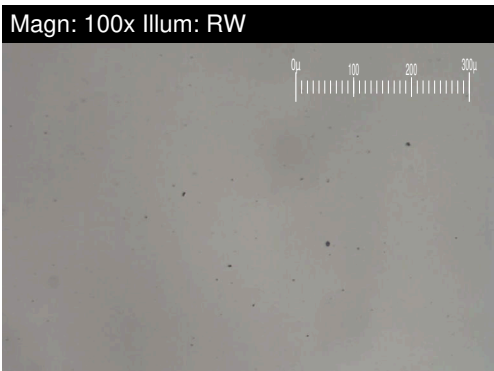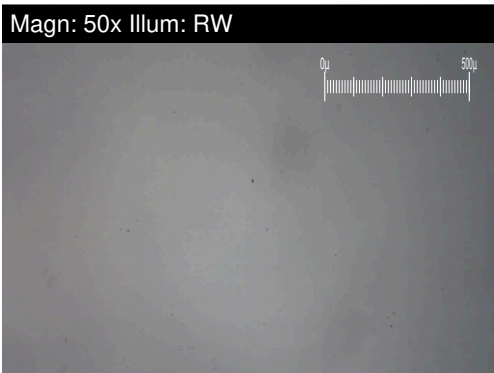


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		3.1	---	---
Small Particles		DR-Ferr*		0.7	---	---
Total Particles		DR-Ferr*	>---	3.8	---	---
Large Particles Percentage	%	DR-Ferr*		63.2	---	---
Severity Index		DR-Ferr*		7	---	---


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		1		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1		
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*				
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1		

WEAR


All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

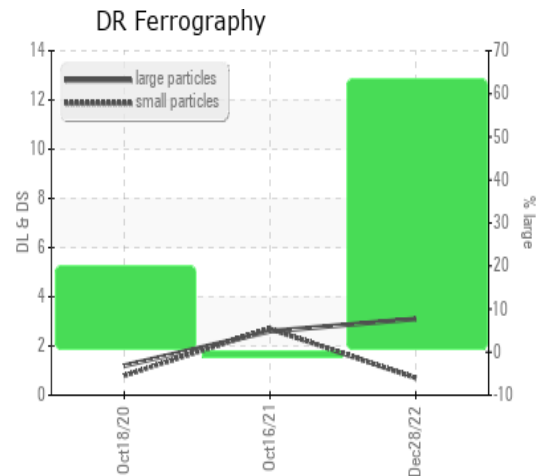


Rotating Pressure Vessel Oxidation Test

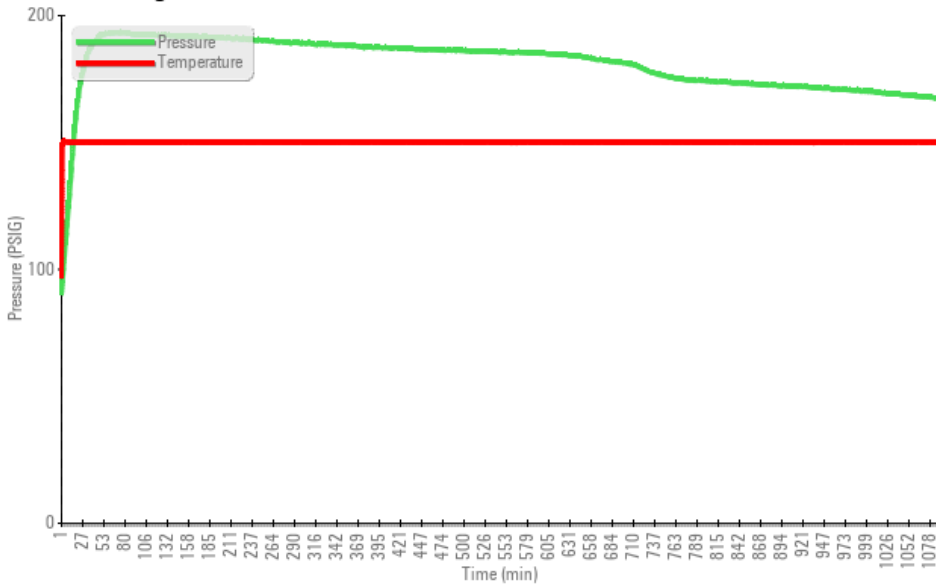


Foaming SEQ I/II/III

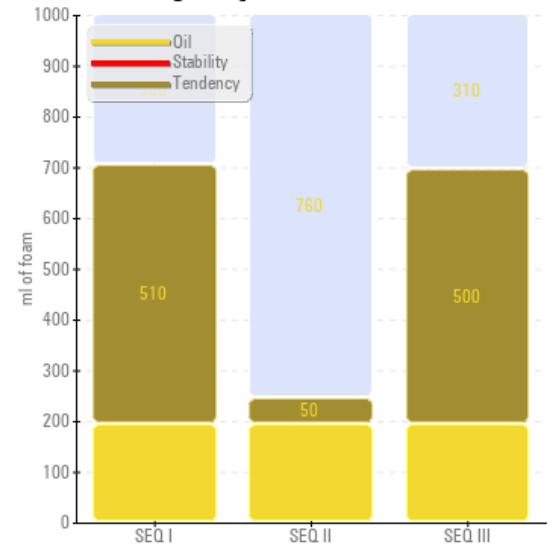

Remaining Useful Life (RULER)

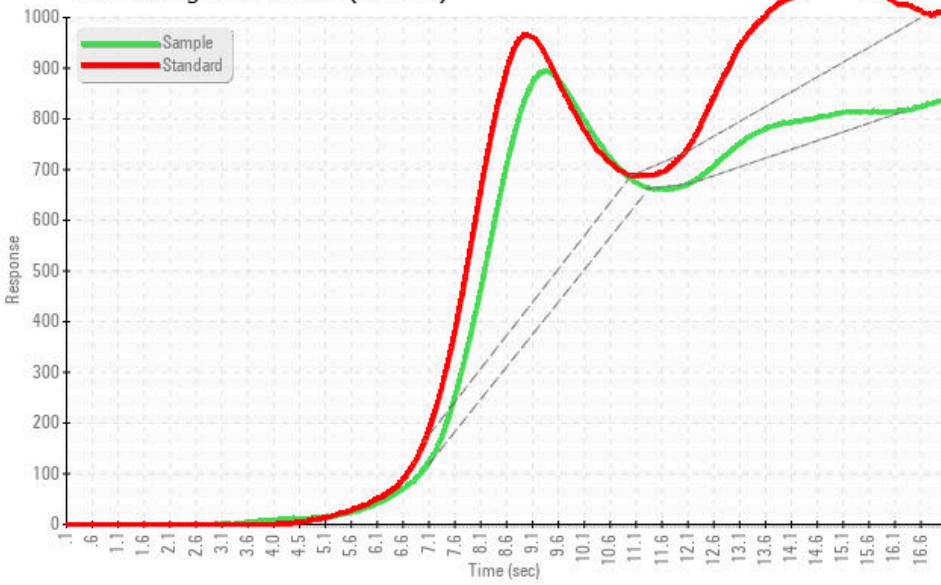

Water Separability

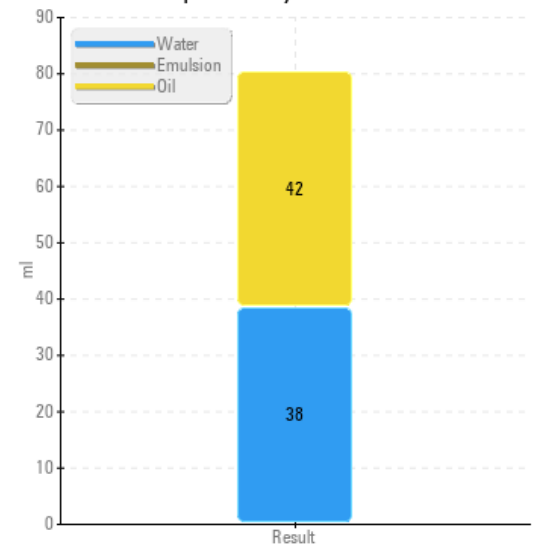

MPC (Varnish Test)



Sample Color & Clarity

