




# OIL ANALYSIS REPORT

Sample Rating Trend

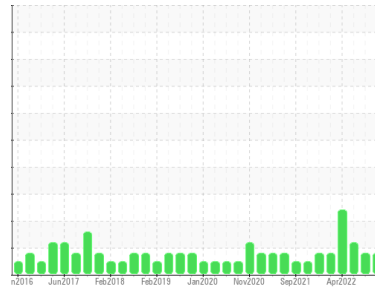

FUEL



Machine Id  
**Emergency Generator (S/N 40601268)**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON HP 15W40 (30 LTR)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

### Contaminants

Light fuel dilution occurring. No other contaminants were detected in the oil.

### Oil Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0700698</b>	WC0603809	WC0603812
Sample Date	Client Info		<b>04 Jan 2023</b>	14 Nov 2022	19 Jul 2022
Machine Age	hrs	Client Info	<b>1586</b>	1574	1546
Oil Age	hrs	Client Info	<b>11</b>	0	3
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Changed
Sample Status			<b>MARGINAL</b>	MARGINAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >80	<b>1</b>	1	<1
Chromium	ppm	ASTM D5185(m) >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >4	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185(m) >2	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m) >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >15	<b>0</b>	0	0
Copper	ppm	ASTM D5185(m) >230	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >4	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>1</b>	1	1
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 60	<b>56</b>	56	54
Manganese	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185(m) 1010	<b>955</b>	959	894
Calcium	ppm	ASTM D5185(m) 1070	<b>1055</b>	1048	991
Phosphorus	ppm	ASTM D5185(m) 1150	<b>1061</b>	1065	976
Zinc	ppm	ASTM D5185(m) 1270	<b>1163</b>	1165	1112
Sulfur	ppm	ASTM D5185(m) 2060	<b>2667</b>	2670	2589
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>2</b>	2	3
Sodium	ppm	ASTM D5185(m)	<b>1</b>	2	1
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Fuel	%	ASTM D7593* >5	<b>▲ 2.9</b>	▲ 3.4	▲ 7.8

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624* >20	<b>4.5</b>	4.9	4.7
Sulfation	Abs./1mm	ASTM D7415* >30	<b>17.5</b>	19.0	17.8



# OIL ANALYSIS REPORT

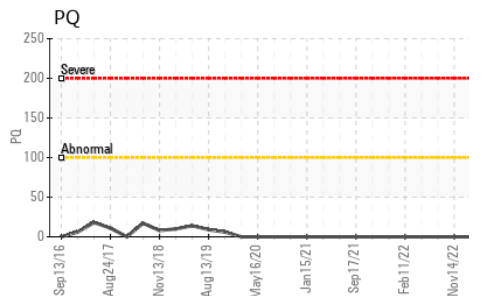
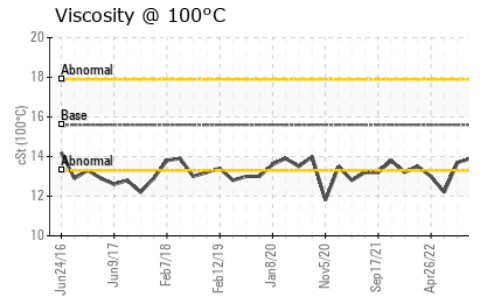
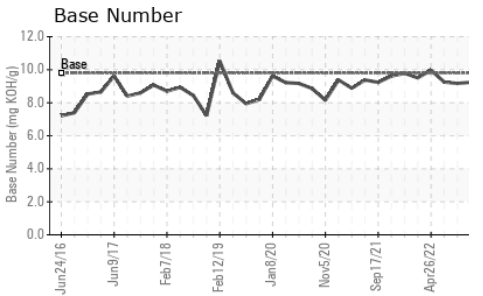
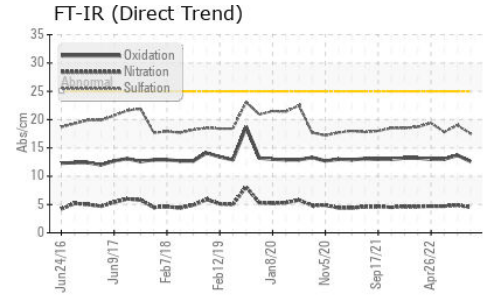
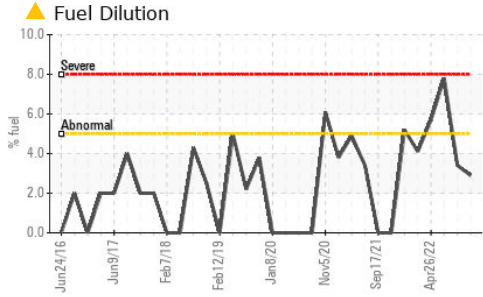


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>12.6</b>	13.7	13.0
Base Number (BN)	mg KOH/g	ASTM D2896*	9.8	<b>9.24</b>	9.17	9.25

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	<b>13.9</b>	13.7	▲ 12.2

## GRAPHS

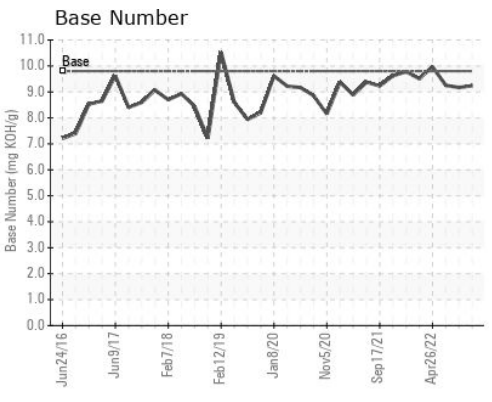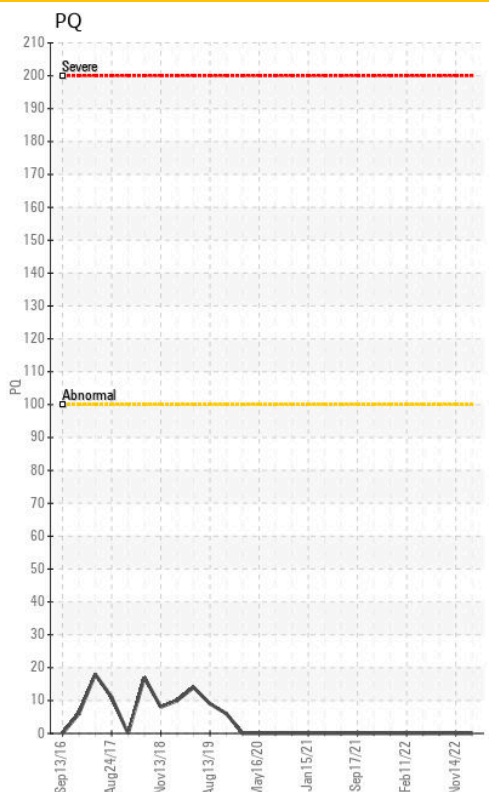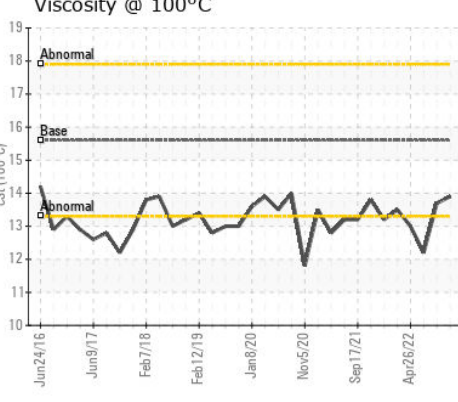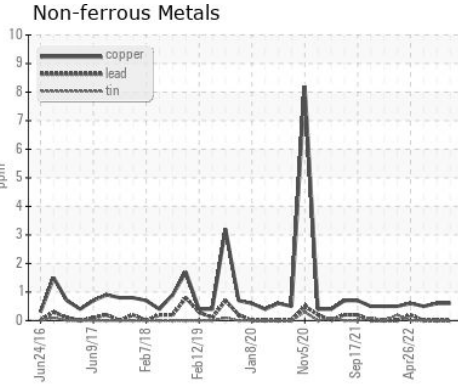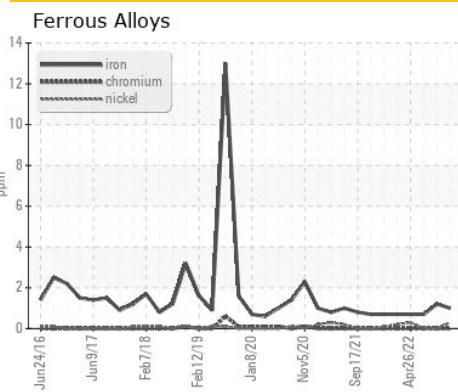

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0700698  
**Lab Number** : 02531440  
**Unique Number** : 5512439  
**Test Package** : MAR 3 ( Additional Tests: FUELDILUTION, PercentFuel )  
**Received** : 05 Jan 2023  
**Tested** : 09 Jan 2023  
**Diagnosed** : 09 Jan 2023 - Kevin Marson




**CANADIAN COAST GUARD**  
 CCGS GRIFFON, PO BOX 1000, 401 KING ST.W  
 Prescott, ON  
 CA K6V 5T3  
 Contact: Laurie Bosley  
 Laurie.Bosley@dfo-mpo.gc.ca

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
 F: (519)383-1994

# FERROGRAPHY REPORT

Machine Id  
**Emergency Generator (S/N 40601268)**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON HP 15W40 (30 LTR)**

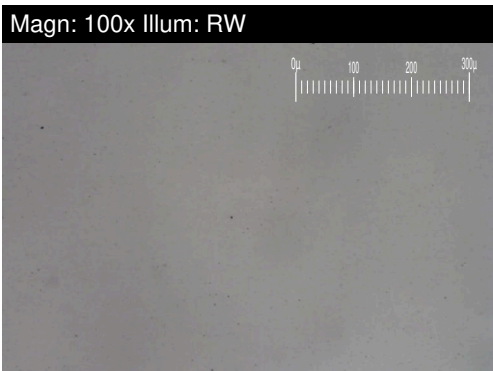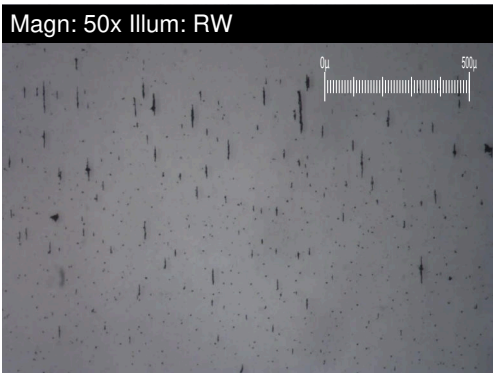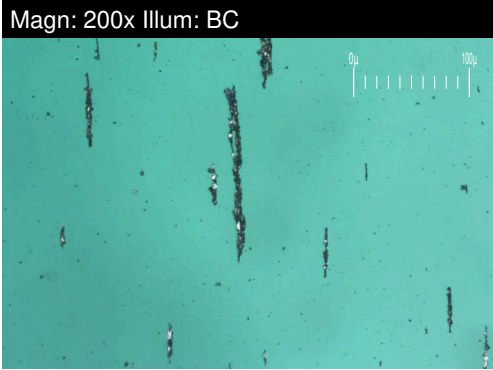


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>4.1</b>	8.4	7.0
Small Particles		DR-Ferr*		<b>3.2</b>	6.3	4.2
Total Particles		DR-Ferr*	>---	<b>7.3</b>	14.7	11.2
Large Particles Percentage	%	DR-Ferr*		<b>12.3</b>	14.3	25
Severity Index		DR-Ferr*		<b>4</b>	18	20

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>	2	2
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>1</b>	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*			1	
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>		1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		<b>1</b>	1	1

### WEAR

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

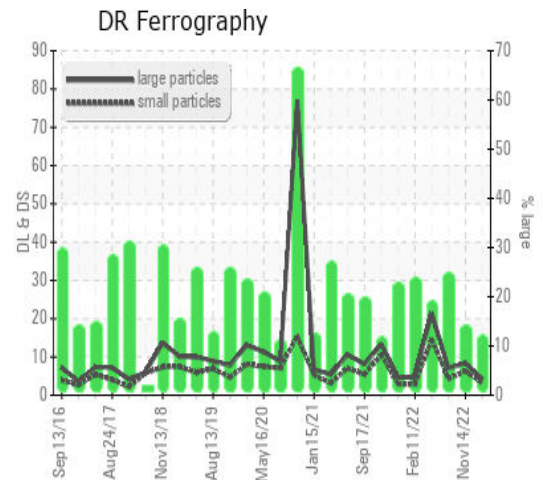

*This page left intentionally blank*