



PROBLEM SUMMARY

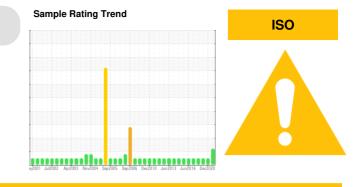

SBK G1 TUBR (S/N 920)

Bearing Fluid ESSO TERESSO ISO 68 (6 GAL)

COMPONENT CONDITION SUMMARY

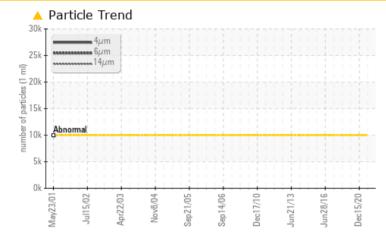

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS								
Sample Status		ABNORMAL	NORMAL	NORMAL				
Particles >4µm	ASTM D7647	>10000 🔺 25228						
Particles >6µm	ASTM D7647	>2500 🔺 3508						
Oil Cleanliness	ISO 4406 (c)	>20/18/14 🔺 22/19/14						

Customer Id: NEWSTJ Sample No.: WC0445345 Lab Number: 02535346 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1 (289)291-4641 x4641 Bill.Quesnel@wearcheck.com

To change component or sample information: Gloria Gonzalez +1 (289)291-4643 x4643 gloria.gonzalez@wearcheck.com

RECOMMENDED	ACTIONS			
Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.
Resample			?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS



15 Dec 2020 Diag: Kevin Marson

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report



15 Jun 2020 Diag: Kevin Marson



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



24 Jul 2017 Diag: Wes Davis

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







OIL ANALYSIS REPORT

Sample Rating Trend

SBK G1 TUBR (S/N 920)

Bearing Fluid ESSO TERESSO ISO 68 (6 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination


Particles $>4\mu$ m and oil cleanliness are abnormally high. Particles $>6\mu$ m are notably high.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.




ISO

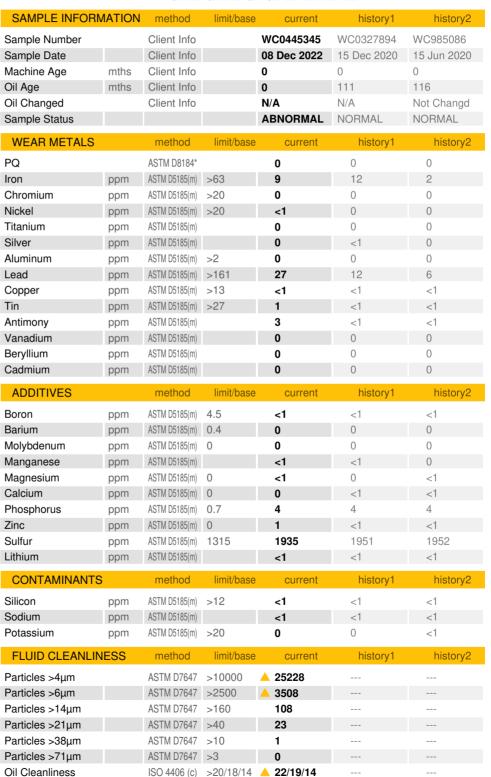





OIL ANALYSIS REPORT

0k	Abnom 25k (E) 20k 25k 20k 30k 25k 400 15k 400 400 400 400 400 400 400 40	cle Tro 4μm 6μm 14μn								
אין איז	Ok UV52/04	Jul15/02	Aprzz/U3	Nov8/04	Sep21/05	Sep 14/06	Dec17/10	Jun21/13	Jun28/16	Dec15/20





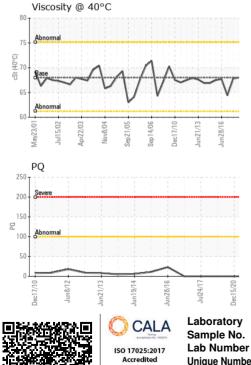


FLUID DEGRADATION		method	limit/base currer		history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	TM D974* 0.02 0.58		0.48	0.23
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	LTMOD	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	68.3	68.1	68.0
SAMPLE IMAGES		method	limit/base	current	history1	history2
					and another	



Bottom



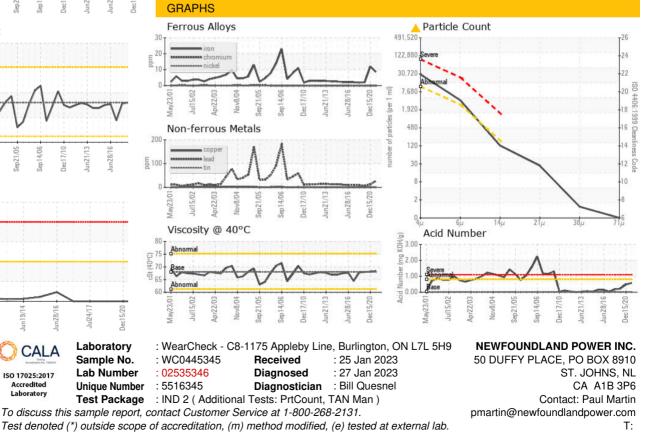

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Laboratory

Submitted By: Paul Martin Page 4 of 4

F: (709)737-2926