




PROBLEM SUMMARY

Sample Rating Trend

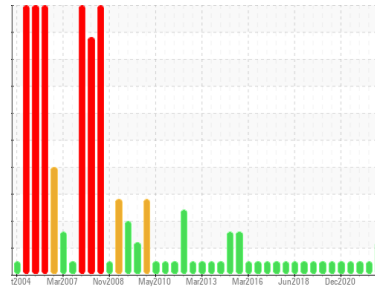

ISO




Machine Id
PUN G1 GEBR

Component
Bearing

Fluid
ESSO TERESSO ISO 68 (5 LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

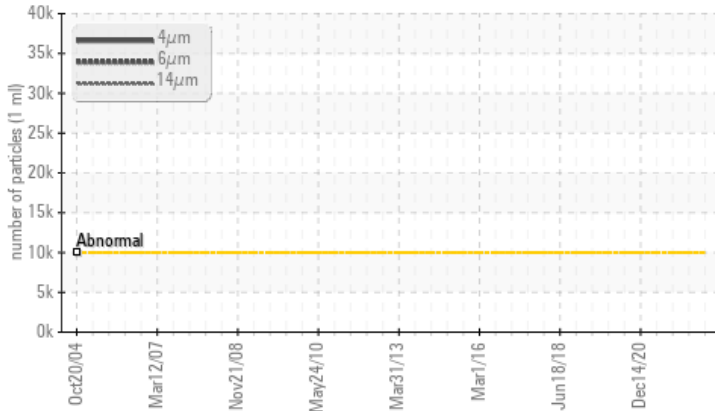

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	NORMAL
Particles >4µm	ASTM D7647	>10000	▲ 36708	---	---
Particles >6µm	ASTM D7647	>2500	▲ 5828	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 22/20/14	---	---

Customer Id: NEWSTJ
Sample No.: WC0455763
Lab Number: 02535350
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

29 Jun 2022 Diag: Kevin Marson

NORMAL



No corrective action is recommended at this time. Resample at the next service interval to monitor. An increase in the lead level is noted. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



30 Dec 2021 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



08 Oct 2021 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

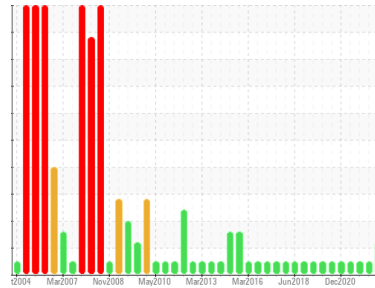

ISO



Machine Id
PUN G1 GEBR
 Component
Bearing
 Fluid
ESSO TERESSO ISO 68 (5 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Particles >4µm are abnormally high. Particles >6µm and oil cleanliness are abnormally high.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0455763	WC0445169	WC0445291
Sample Date	Client Info	22 Dec 2022	29 Jun 2022	30 Dec 2021
Machine Age	yrs Client Info	0	1	1
Oil Age	yrs Client Info	0	1	1
Oil Changed	Client Info	N/A	N/A	Not Changd
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	0	0
Iron	ppm ASTM D5185(m) >63	<1	<1	<1
Chromium	ppm ASTM D5185(m) >20	0	0	0
Nickel	ppm ASTM D5185(m) >20	<1	0	0
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	0	0	0
Aluminum	ppm ASTM D5185(m) >2	<1	<1	<1
Lead	ppm ASTM D5185(m) >161	76	71	52
Copper	ppm ASTM D5185(m) >13	1	1	2
Tin	ppm ASTM D5185(m) >27	1	2	2
Antimony	ppm ASTM D5185(m)	2	2	3
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 4.5	<1	0	<1
Barium	ppm ASTM D5185(m) 0.4	0	0	0
Molybdenum	ppm ASTM D5185(m) 0	0	0	0
Manganese	ppm ASTM D5185(m)	0	0	0
Magnesium	ppm ASTM D5185(m) 0	0	0	0
Calcium	ppm ASTM D5185(m) 0	0	0	<1
Phosphorus	ppm ASTM D5185(m) 0.7	21	18	14
Zinc	ppm ASTM D5185(m) 0	8	6	5
Sulfur	ppm ASTM D5185(m) 1315	2284	2289	2240
Lithium	ppm ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >12	7	8	7
Sodium	ppm ASTM D5185(m)	<1	<1	<1
Potassium	ppm ASTM D5185(m) >20	0	<1	<1

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 36708	---	---
Particles >6µm	ASTM D7647 >2500	▲ 5828	---	---
Particles >14µm	ASTM D7647 >160	144	---	---
Particles >21µm	ASTM D7647 >40	18	---	---
Particles >38µm	ASTM D7647 >10	0	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >20/18/14	▲ 22/20/14	---	---



OIL ANALYSIS REPORT

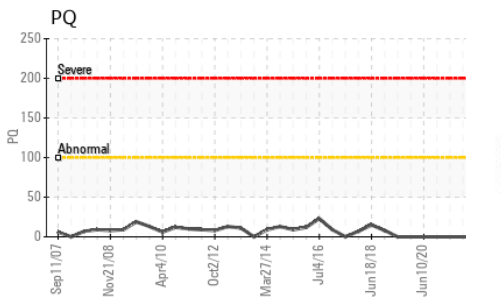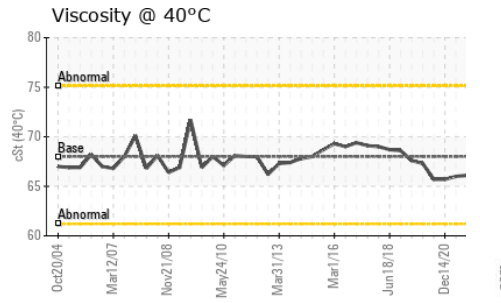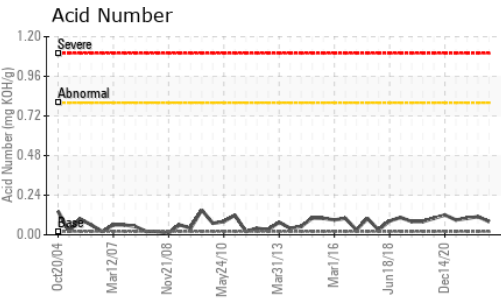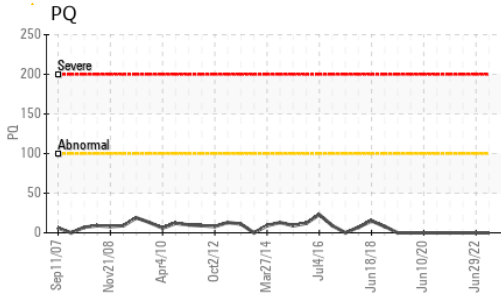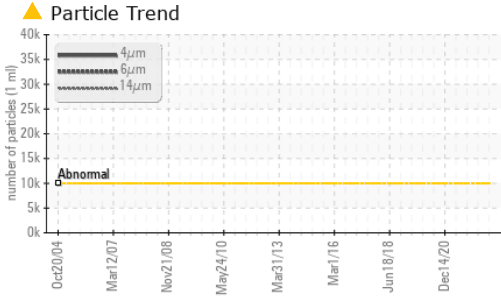

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	0.08	0.11	0.10






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	66.2	65.8	66.1

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------



GRAPHS

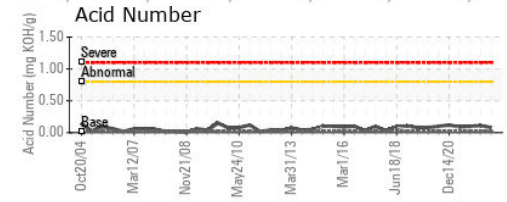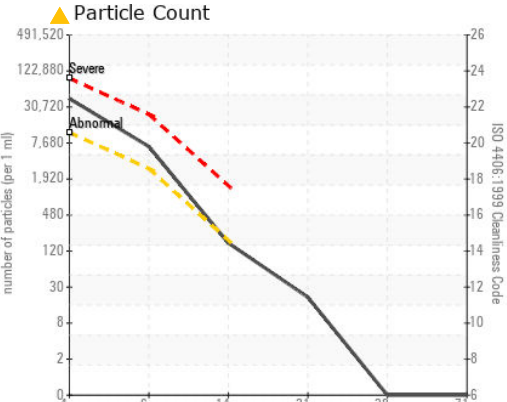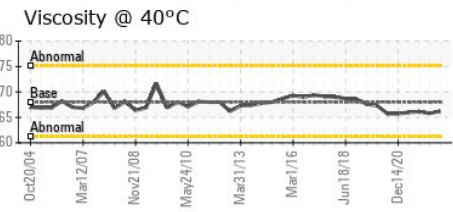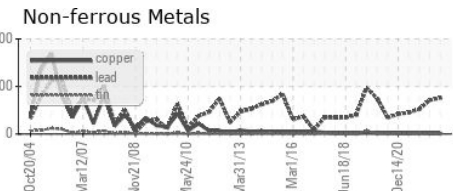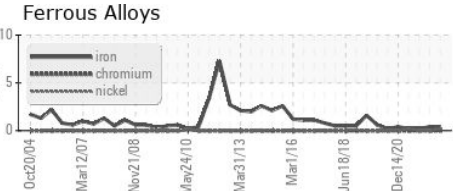

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0455763
Lab Number : **02535350** **Received** : 25 Jan 2023
Unique Number : 5516349 **Diagnosed** : 31 Jan 2023
Test Package : IND 2 (Additional Tests: PrtCount, TAN Man) **Diagnostician** : Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Paul Martin
 pmartin@newfoundlandpower.com
 T:
 F: (709)737-2926