




PROBLEM SUMMARY

Sample Rating Trend


ISO

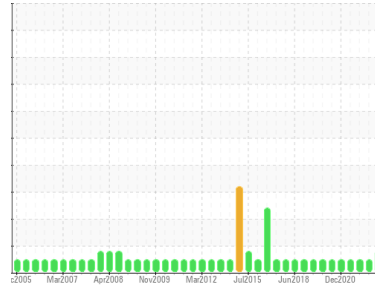

Area
[197132]
 Machine Id
LOK-G2-GEBR
 Component
Bearing
 Fluid
ESSO TERESSO ISO 68 (27 LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

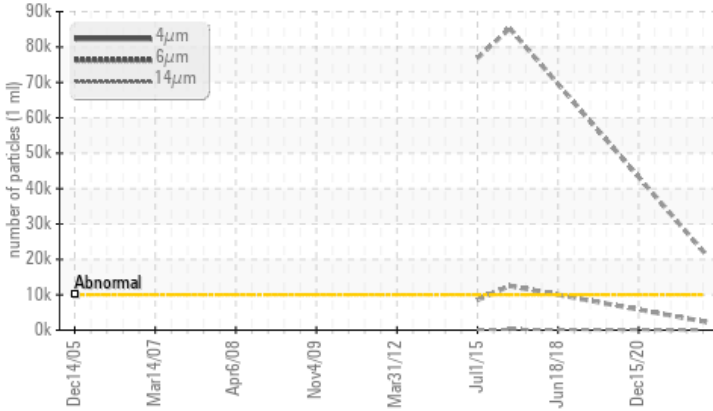

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	NORMAL	NORMAL
Particles >4µm	ASTM D7647 >10000	▲ 22315	---	---
Oil Cleanliness	ISO 4406 (c) >20/18/14	▲ 22/18/12	---	---

Customer Id: NEWSTJ
 Sample No.: WC0455756
 Lab Number: 02535480
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

22 Jun 2022 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Dec 2021 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



17 Jun 2021 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

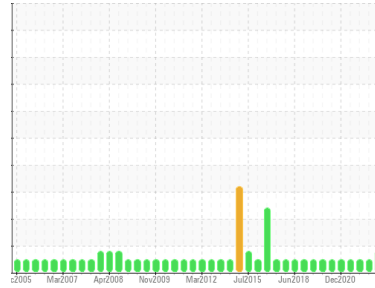

ISO



Area
[197132]
 Machine Id
LOK-G2-GEBR
 Component
Bearing
 Fluid
ESSO TERESSO ISO 68 (27 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Particles >4µm and oil cleanliness are abnormally high.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0455756	WC0445160	WC0445296
Sample Date	Client Info	15 Dec 2022	22 Jun 2022	15 Dec 2021
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	Not Changed	Not Changed	Not Changed
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	0	0
Iron	ppm	ASTM D5185(m) >63	<1	<1
Chromium	ppm	ASTM D5185(m) >20	0	0
Nickel	ppm	ASTM D5185(m) >20	<1	0
Titanium	ppm	ASTM D5185(m)	0	0
Silver	ppm	ASTM D5185(m)	0	0
Aluminum	ppm	ASTM D5185(m) >2	<1	0
Lead	ppm	ASTM D5185(m) >161	13	13
Copper	ppm	ASTM D5185(m) >13	<1	<1
Tin	ppm	ASTM D5185(m) >27	<1	<1
Antimony	ppm	ASTM D5185(m)	2	2
Vanadium	ppm	ASTM D5185(m)	0	0
Beryllium	ppm	ASTM D5185(m)	0	0
Cadmium	ppm	ASTM D5185(m)	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 4.5	<1	0
Barium	ppm	ASTM D5185(m) 0.4	0	0
Molybdenum	ppm	ASTM D5185(m) 0	0	0
Manganese	ppm	ASTM D5185(m)	0	0
Magnesium	ppm	ASTM D5185(m) 0	0	0
Calcium	ppm	ASTM D5185(m) 0	0	<1
Phosphorus	ppm	ASTM D5185(m) 0.7	2	<1
Zinc	ppm	ASTM D5185(m) 0	2	2
Sulfur	ppm	ASTM D5185(m) 1315	2262	2229
Lithium	ppm	ASTM D5185(m)	<1	<1

CONTAMINANTS






method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >12	<1	<1
Sodium	ppm	ASTM D5185(m)	0	0
Potassium	ppm	ASTM D5185(m) >20	<1	<1

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 22315	---
Particles >6µm	ASTM D7647	>2500	2472	---
Particles >14µm	ASTM D7647	>160	35	---
Particles >21µm	ASTM D7647	>40	4	---
Particles >38µm	ASTM D7647	>10	0	---
Particles >71µm	ASTM D7647	>3	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 22/18/12	---



OIL ANALYSIS REPORT

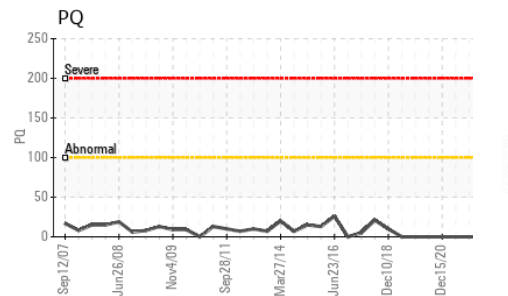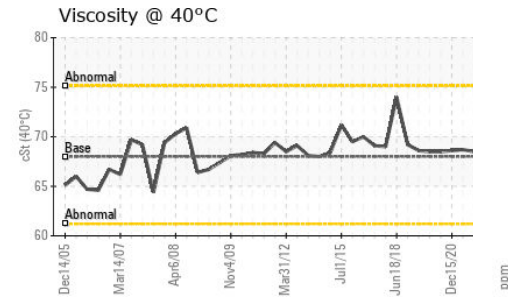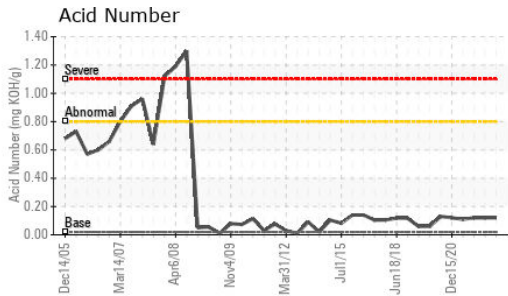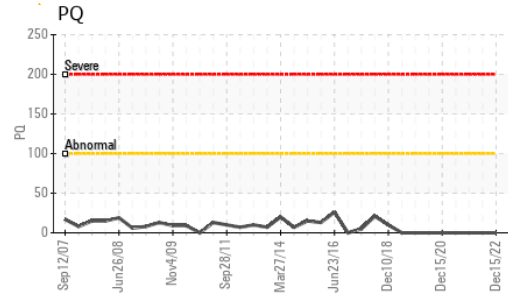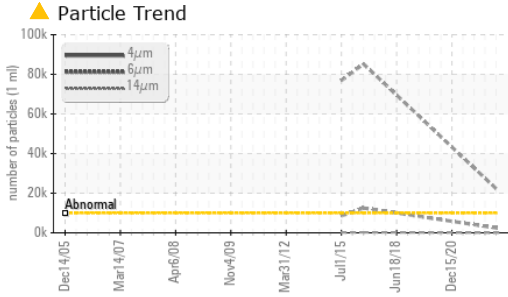






FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	0.12	0.12	0.12

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	68.3	68.3	68.5

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

GRAPHS

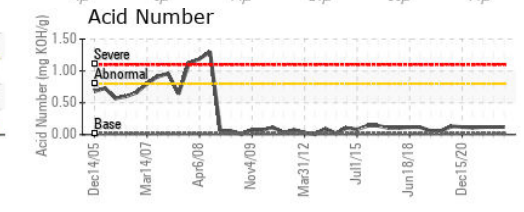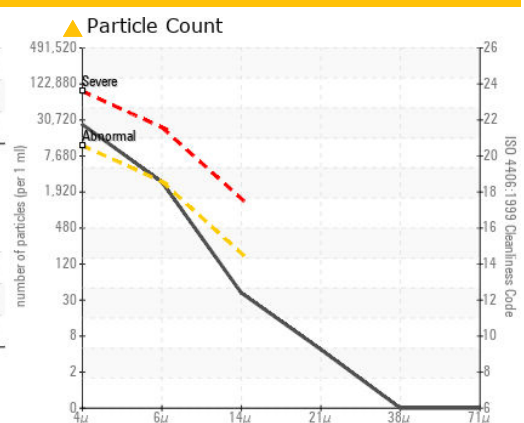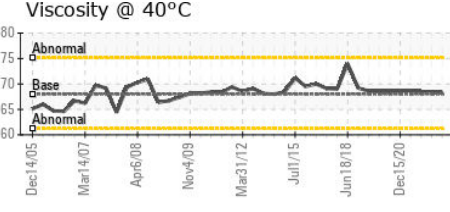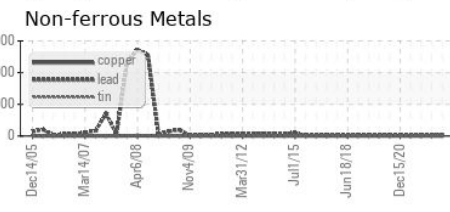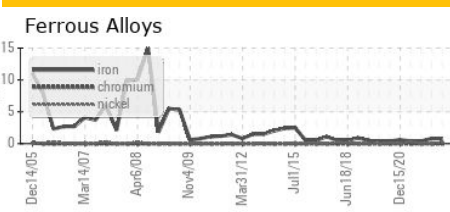

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0455756 **Received** : 25 Jan 2023
Lab Number : 02535480 **Diagnosed** : 31 Jan 2023
Unique Number : 5516479 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: PRTCOUNT, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Paul Martin
 pmartin@newfoundlandpower.com
 T:
 F: (709)737-2926