

OIL ANALYSIS REPORT

Sample Rating Trend



Area UNILEVER Machine Id VILTER 5269345

Component
Screw Compressor

VILTER 717 COMPRESSOR OIL ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0778467		
Sample Date		Client Info		28 Sep 2022		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		302		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0		
Iron	ppm	ASTM D5185(m)	>60	<1		
Chromium	ppm	ASTM D5185(m)	>4	0		
Nickel	ppm	ASTM D5185(m)		0		
Titanium	ppm	ASTM D5185(m)		0		
Silver	ppm	ASTM D5185(m)		0		
Aluminum	ppm	ASTM D5185(m)	>5	0		
Lead	ppm	ASTM D5185(m)	>10	0		
Copper	ppm	ASTM D5185(m)	>30	0		
Tin	ppm	ASTM D5185(m)	>15	0		
Antimony	ppm	ASTM D5185(m)		0		
Vanadium	ppm	ASTM D5185(m)		0		
Beryllium	ppm	ASTM D5185(m)		0		
Cadmium	ppm	ASTM D5185(m)		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1		
Barium	ppm	ASTM D5185(m)	0	<1		
Molybdenum	ppm	ASTM D5185(m)	0	0		
Manganese	ppm	ASTM D5185(m)		0		
Magnesium	ppm	ASTM D5185(m)	0	0		
Calcium	ppm	ASTM D5185(m)	0	0		
Phosphorus	ppm	ASTM D5185(m)	0	0		
Zinc	ppm	ASTM D5185(m)	0	<1		
Sulfur	ppm	ASTM D5185(m)		8		
Lithium	ppm	ASTM D5185(m)		<1		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	<1		
Sodium	ppm	ASTM D5185(m)		0		
Potassium	ppm	ASTM D5185(m)	>20	<1		
Water	%	ASTM D6304*	>0.1	0.00		
ppm Water	ppm	ASTM D6304*	>1000	0.00		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.2	0.01		



OIL ANALYSIS REPORT

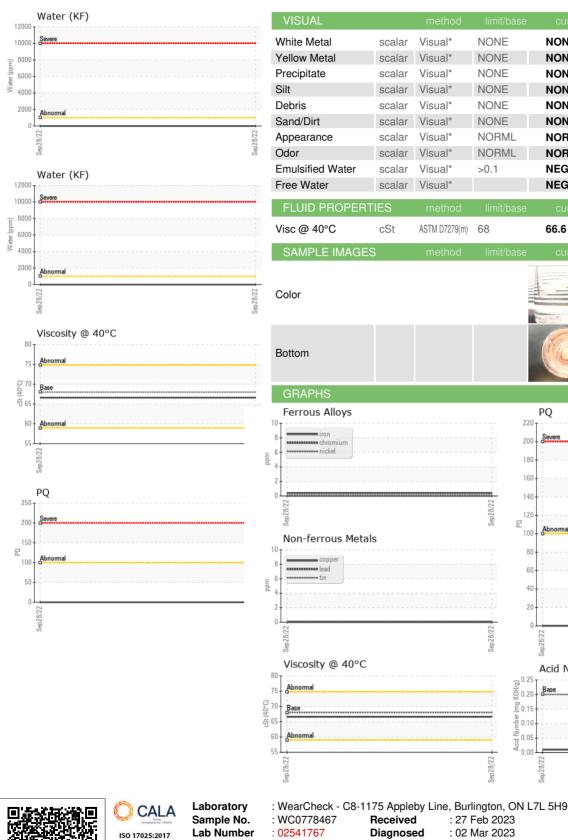

no image no image no image no image PQ 220 200 180 160 140 120 g 100 80 60 40 20 Acid Number (B) } 풍 0.20 Ê 0.15 e 0.10 0.05 Acid 0.00 **CIMCO** Refrigeration : 27 Feb 2023 1551 Corporate Drive : 02 Mar 2023 Burlington, ON Diagnostician : Bill Quesnel CA L7L 6M3 Contact: DAVID PARISE To discuss this sample report, contact Customer Service at 1-800-268-2131. DPARISE@ToROMONT.COM Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (416)465-7581 Validity of results and interpretation are based on the sample and information as supplied. F: (416)465-8815 Contact/Location: DAVID PARISE - CIMTOR

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

66.6

Unique Number

: 5538772 Test Package : IND 2 (Additional Tests: KF)

Accredited Laboratory