




# OIL ANALYSIS REPORT

Sample Rating Trend

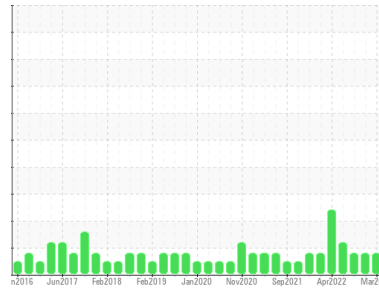

FUEL



Machine Id  
**Emergency Generator (S/N 40601268)**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON HP 15W40 (30 LTR)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

### Contaminants

Light fuel dilution occurring. No other contaminants were detected in the oil.

### Oil Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0772114</b>	WC0700698	WC0603809
Sample Date	Client Info		<b>14 Mar 2023</b>	04 Jan 2023	14 Nov 2022
Machine Age	hrs	Client Info	<b>1601</b>	1586	1574
Oil Age	hrs	Client Info	<b>13</b>	11	0
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>MARGINAL</b>	MARGINAL	MARGINAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >80	<b>1</b>	1	1
Chromium	ppm	ASTM D5185(m) >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >4	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185(m) >2	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m) >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >10	<b>1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >15	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185(m) >230	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >4	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	1	1
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 60	<b>55</b>	56	56
Manganese	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185(m) 1010	<b>934</b>	955	959
Calcium	ppm	ASTM D5185(m) 1070	<b>1043</b>	1055	1048
Phosphorus	ppm	ASTM D5185(m) 1150	<b>1065</b>	1061	1065
Zinc	ppm	ASTM D5185(m) 1270	<b>1121</b>	1163	1165
Sulfur	ppm	ASTM D5185(m) 2060	<b>2606</b>	2667	2670
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>3</b>	2	2
Sodium	ppm	ASTM D5185(m)	<b>1</b>	1	2
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Fuel	%	ASTM D7593* >5	<b>▲ 3.1</b>	▲ 2.9	▲ 3.4

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624* >20	<b>4.9</b>	4.5	4.9
Sulfation	Abs./1mm	ASTM D7415* >30	<b>20.3</b>	17.5	19.0



# OIL ANALYSIS REPORT

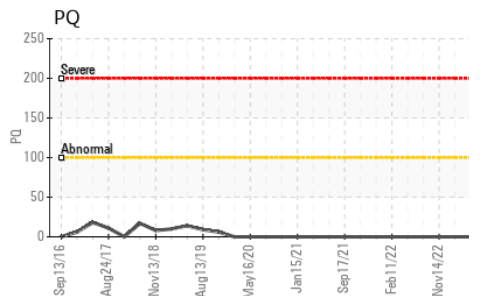
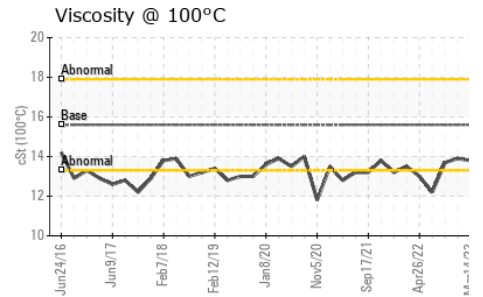
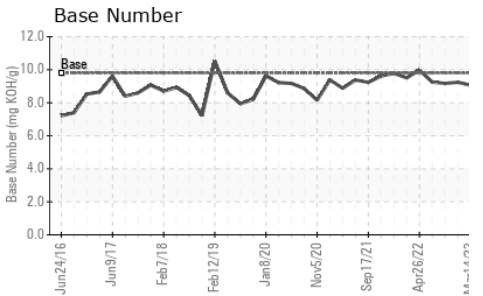
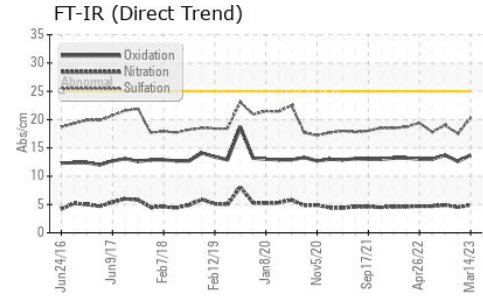
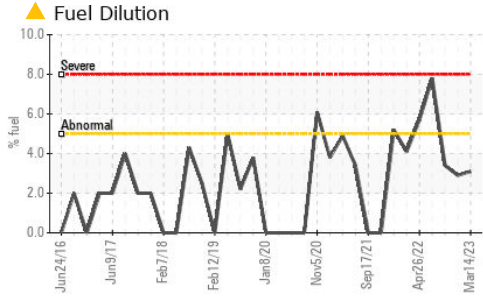


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>13.7</b>	12.6	13.7
Base Number (BN)	mg KOH/g	ASTM D2896*	9.8	<b>9.06</b>	9.24	9.17

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	<b>13.8</b>	13.9	13.7

## GRAPHS

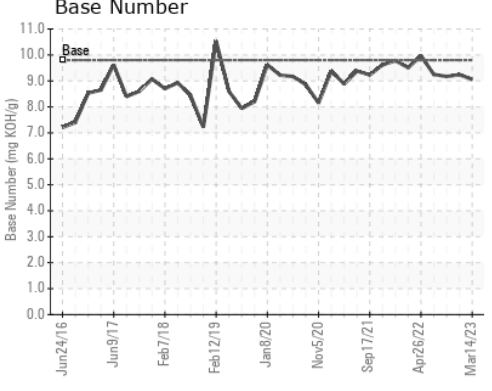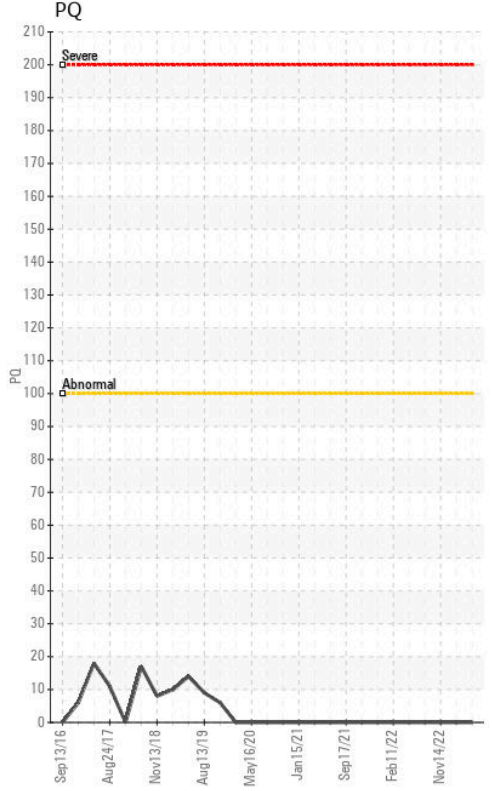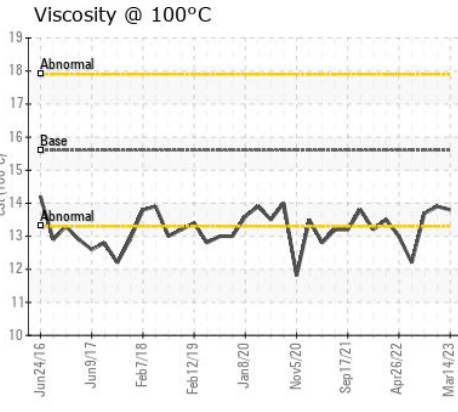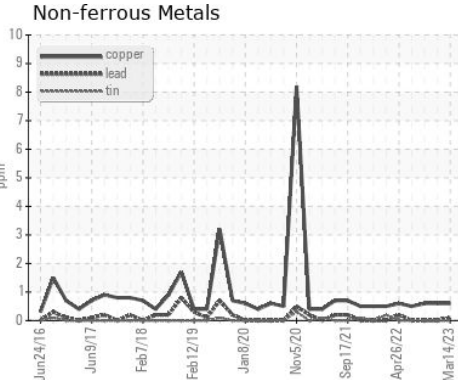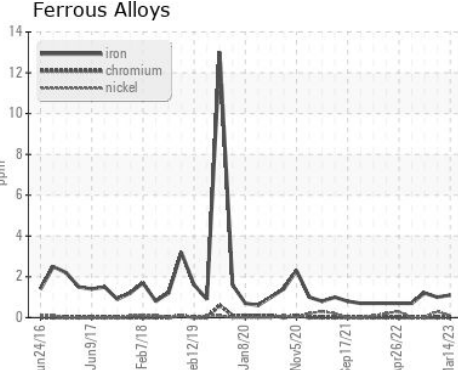

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0772114  
**Lab Number** : 02545374  
**Unique Number** : 5542379  
**Test Package** : MAR 3 ( Additional Tests: FUELDILUTION, PercentFuel )




**Received** : 15 Mar 2023  
**Tested** : 22 Mar 2023  
**Diagnosed** : 22 Mar 2023 - Kevin Marson

**CANADIAN COAST GUARD**  
 CCGS GRIFFON, PO BOX 1000, 401 KING ST.W  
 Prescott, ON  
 CA K6V 5T3  
 Contact: Laurie Bosley  
 Laurie.Bosley@dfo-mpo.gc.ca  
 T:  
 F: (519)383-1994

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

# FERROGRAPHY REPORT

Machine Id  
**Emergency Generator (S/N 40601268)**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON HP 15W40 (30 LTR)**

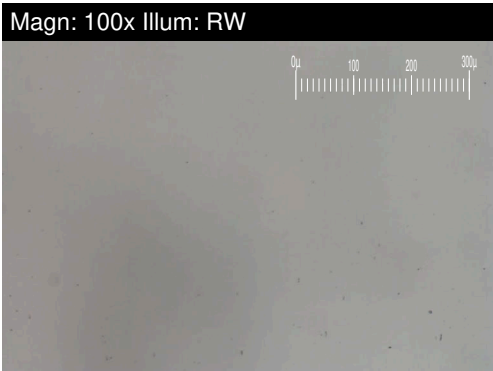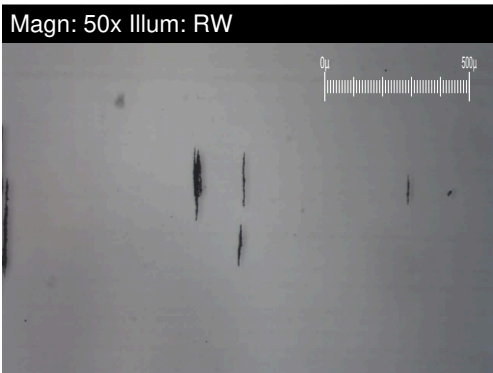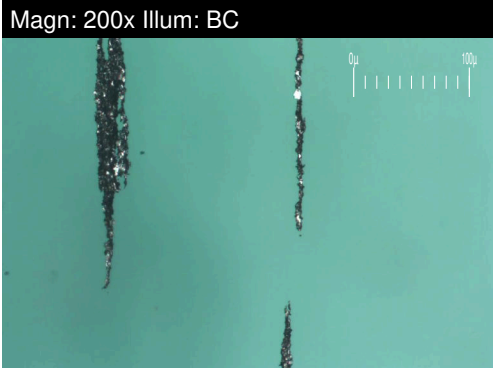


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>7.5</b>	4.1	8.4
Small Particles		DR-Ferr*		<b>4.8</b>	3.2	6.3
Total Particles		DR-Ferr*	>---	<b>12.3</b>	7.3	14.7
Large Particles Percentage	%	DR-Ferr*		<b>22</b>	12.3	14.3
Severity Index		DR-Ferr*		<b>20</b>	4	18

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>	2	2
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>1</b>	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		<b>1</b>		1
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>	1	
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		<b>1</b>	1	1

### WEAR

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

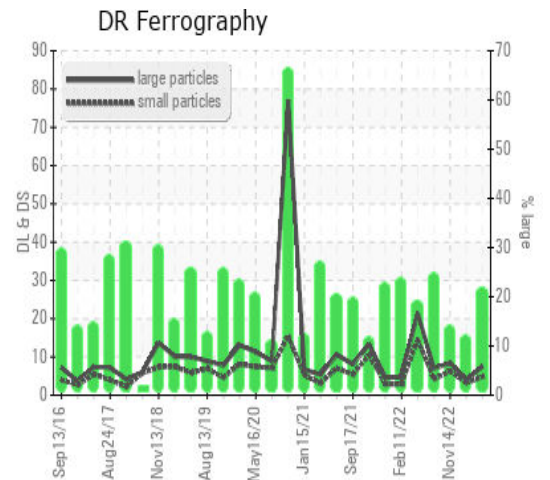

*This page left intentionally blank*