




# PROBLEM SUMMARY

Area  
**TEAM 1**  
 Machine Id  
**122553 Turbo Generator**  
 Component  
**Hydraulic System**  
 Fluid  
**PETRO CANADA TURBOFLO R&O 32 (1250 GAL)**

Sample Rating Trend

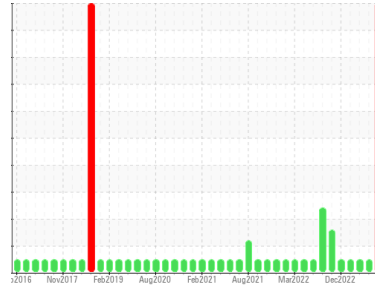


CONTAMINANT



## COMPONENT CONDITION SUMMARY

### Water Separability

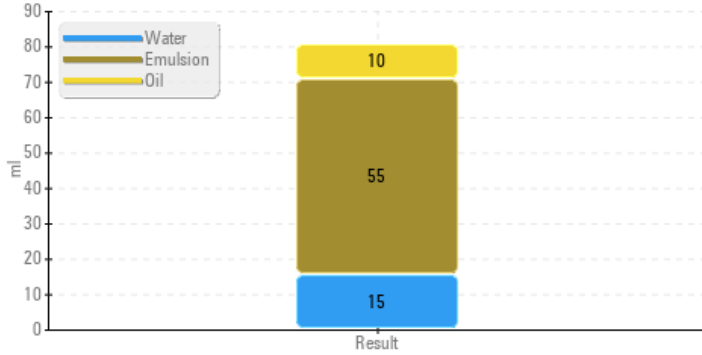

## RECOMMENDATION

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	NORMAL	NORMAL
Separability	oil/h2o/em	ASTM D1401*	41/39/0	<b>10/15/55 (30)</b>	---	---

Customer Id: CANDRY  
 Sample No.: WC0801832  
 Lab Number: 02548343  
 Test Package: AOM 3



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1  
 (289)291-4641 x4641  
[Bill.Quesnel@wearcheck.com](mailto:Bill.Quesnel@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	MISSED	Apr 13 2023	?	We recommend an early resample to monitor this condition.
Filter Fluid	MISSED	Apr 13 2023	?	We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability.

## HISTORICAL DIAGNOSIS

### 31 Jan 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 12 Jan 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 05 Jan 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

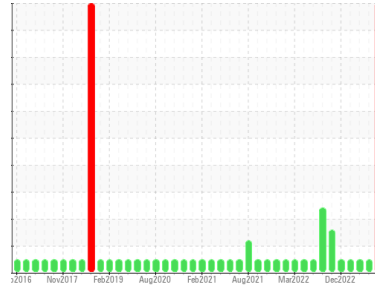

CONTAMINANT



Area  
**TEAM 1**  
Machine Id  
**122553 Turbo Generator**  
Component  
**Hydraulic System**  
Fluid  
**PETRO CANADA TURBOFLO R&O 32 (1250 GAL)**

## DIAGNOSIS

### Recommendation

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

### Contaminants

Water Separability results (ASTM D1401) are poor and indicate that the oil will form emulsions with water. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible.

### Oil Condition

The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0801832</b>	PC0070308	PC0061939
Sample Date	Client Info	<b>23 Mar 2023</b>	31 Jan 2023	12 Jan 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>SEVERE</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >20	<b>1</b>	1
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	0
Nickel	ppm	ASTM D5185(m) >20	<b>0</b>	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0
Aluminum	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	0
Lead	ppm	ASTM D5185(m) >20	<b>1</b>	0
Copper	ppm	ASTM D5185(m) >20	<b>0</b>	0
Tin	ppm	ASTM D5185(m) >20	<b>0</b>	<1
Antimony	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1
Barium	ppm	ASTM D5185(m)	<b>0</b>	0
Molybdenum	ppm	ASTM D5185(m)	<b>&lt;1</b>	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0
Magnesium	ppm	ASTM D5185(m)	<b>12</b>	0
Calcium	ppm	ASTM D5185(m) 0	<b>12</b>	0
Phosphorus	ppm	ASTM D5185(m) 4	<b>26</b>	14
Zinc	ppm	ASTM D5185(m) 0	<b>16</b>	4
Sulfur	ppm	ASTM D5185(m)	<b>1247</b>	1262
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>&lt;1</b>	<1
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	0
Water	%	ASTM D6304* >0.05	<b>0.001</b>	---
ppm Water	ppm	ASTM D6304* >500	<b>8.7</b>	---

## INFRA-RED

method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	<b>0</b>	---
Nitration	Abs/cm	ASTM D7624*	<b>2.6</b>	---
Sulfation	Abs/.1mm	ASTM D7415*	<b>14.9</b>	---




# OIL ANALYSIS REPORT


## Water Separability




## Remaining Life (RULER)

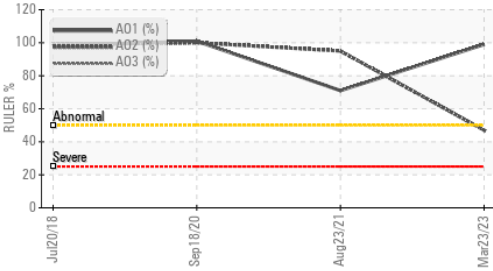


## Foaming SEQ I/II/III

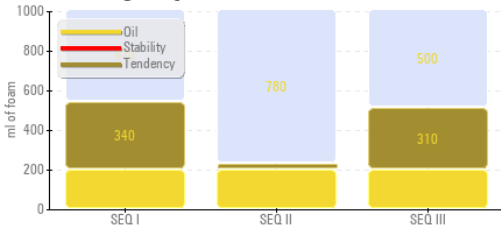

## Varnish Potential

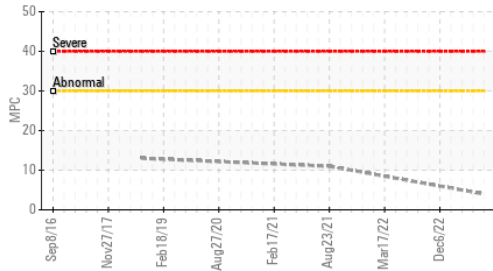

## Particle Count

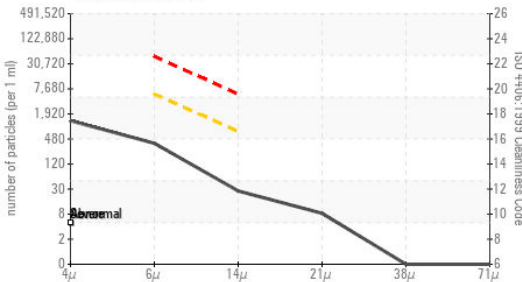

ISO 17025:2017  
Accredited  
Laboratory

Laboratory  
Sample No.  
Lab Number  
Unique Number  
Test Package

To discuss this sample report, cc  
Test denoted (\*) outside scope o  
Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1156</b>	715	1309
Particles >6µm	ASTM D7647	>5000	<b>333</b>	187	341
Particles >14µm	ASTM D7647	>640	<b>24</b>	18	16
Particles >21µm	ASTM D7647	>160	<b>7</b>	6	3
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	<b>17/16/12</b>	17/15/11	18/16/11

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		<b>4.1</b>	---	---
Acid Number (AN)	mg KOH/g ASTM D974*	0.15	<b>0.09</b>	0.06	0.07
Anti-Oxidant 1	% ASTM D6971*	<25	<b>99</b>	---	---
Anti-Oxidant 2	% ASTM D6971*	<25	<b>47</b>	---	---
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	<b>4</b>	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar Visual*	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	32.0	<b>32.6</b>	32.8	32.7
Visc @ 100°C	cSt ASTM D7279(m)	5.42	<b>5.5</b>	5.4	5.4
Viscosity Index (VI)	Scale ASTM D2270*	103	<b>104</b>	97	97
Separability	oil/h2o/em ASTM D1401*	41/39/0	<b>10/15/55 (30)</b>	---	---
Air Release Time	min ASTM D3427*	2.5	<b>3.70</b>	---	---
Foam Tendency	I/II/III ASTM D892*	50	<b>340/30/310</b>	---	---
Foam Stability	I/II/III ASTM D892*	0	<b>0/0/0</b>	---	---
ASTM Color	scalar ASTM D1500*	0.5	<b>&lt;4.0</b>	---	---
Rust Prevention	PASS/FAIL ASTM D665*	PASS	<b>PASS</b>	---	---
Oxidation Test (RPVOT)	minutes ASTM D2272*	400	<b>143</b>	---	---

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		<b>0.053</b>	---	---
Toluene Insolubles	% ASTM D893(m)*		<b>0.011</b>	---	---




## SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				
MPC			no image	no image

F: (807)223-9176

# FERROGRAPHY REPORT

Area  
**TEAM 1**  
 Machine Id  
**122553 Turbo Generator**  
 Component  
**Hydraulic System**  
 Fluid  
**PETRO CANADA TURBOFLO R&O 32 (1250 GAL)**

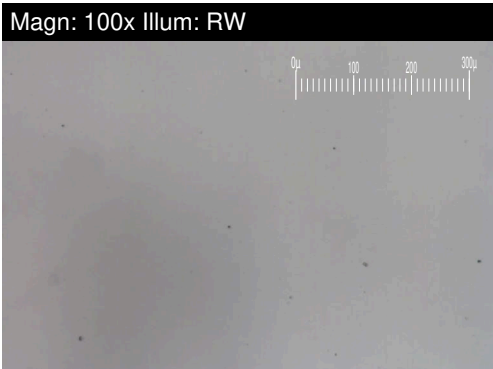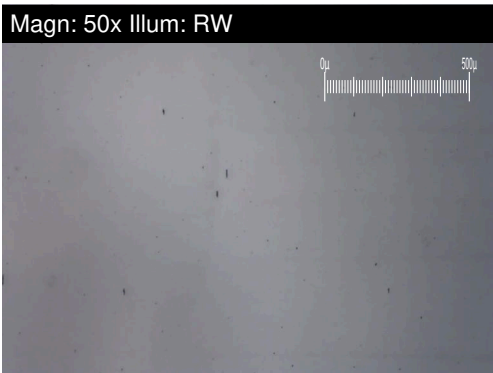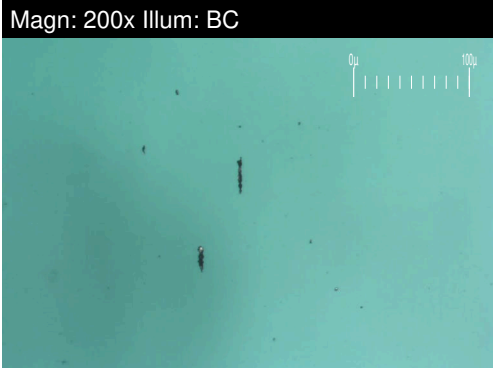


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>2.8</b>	---	---
Small Particles		DR-Ferr*		<b>1.0</b>	---	---
Total Particles		DR-Ferr*	>---	<b>3.8</b>	---	---
Large Particles Percentage	%	DR-Ferr*		<b>47.4</b>	---	---
Severity Index		DR-Ferr*		<b>5</b>	---	---


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*				
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*		<b>1</b>		
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>2</b>		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*				

### WEAR


All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

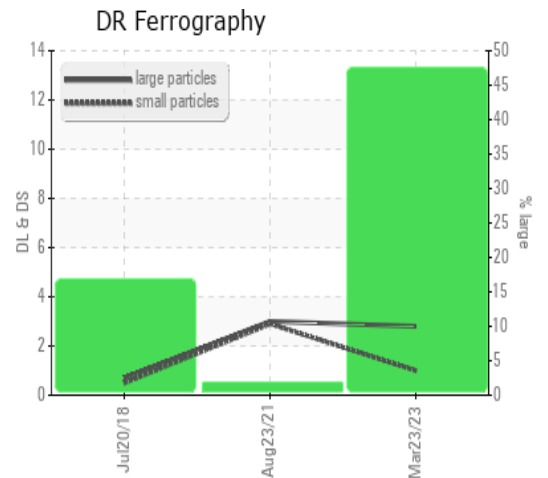


### Rotating Pressure Vessel Oxidation Test

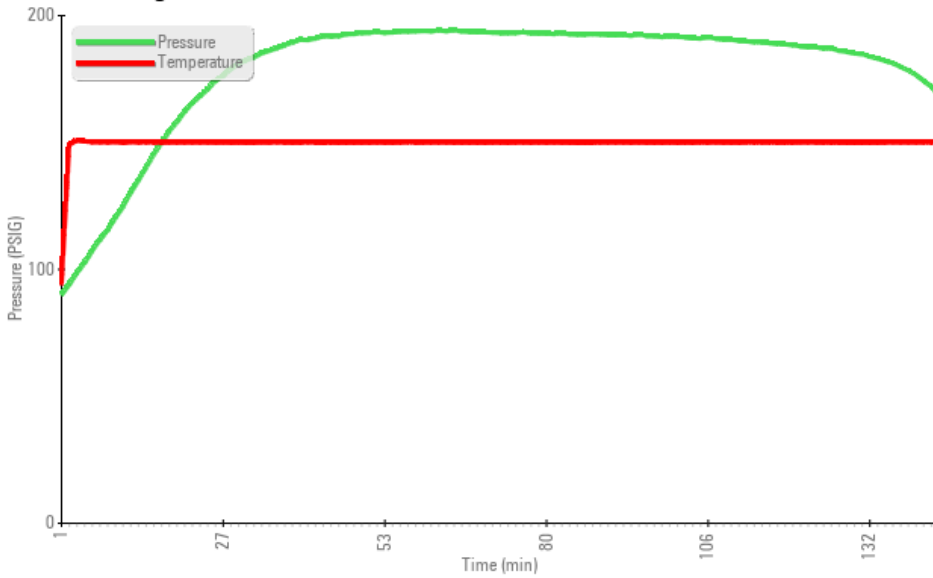


### Foaming SEQ I/II/III

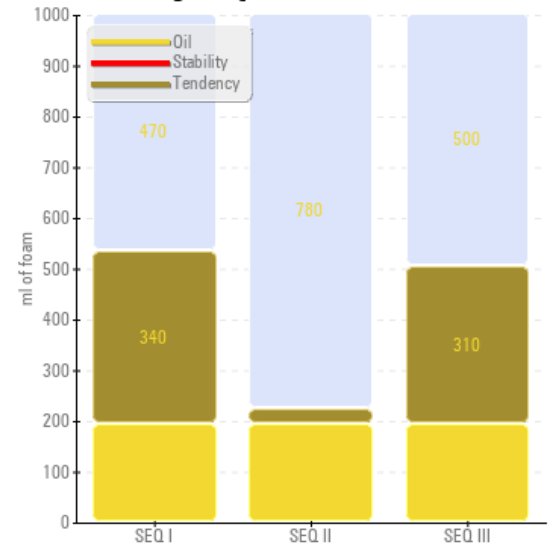


### Remaining Useful Life (RULER)

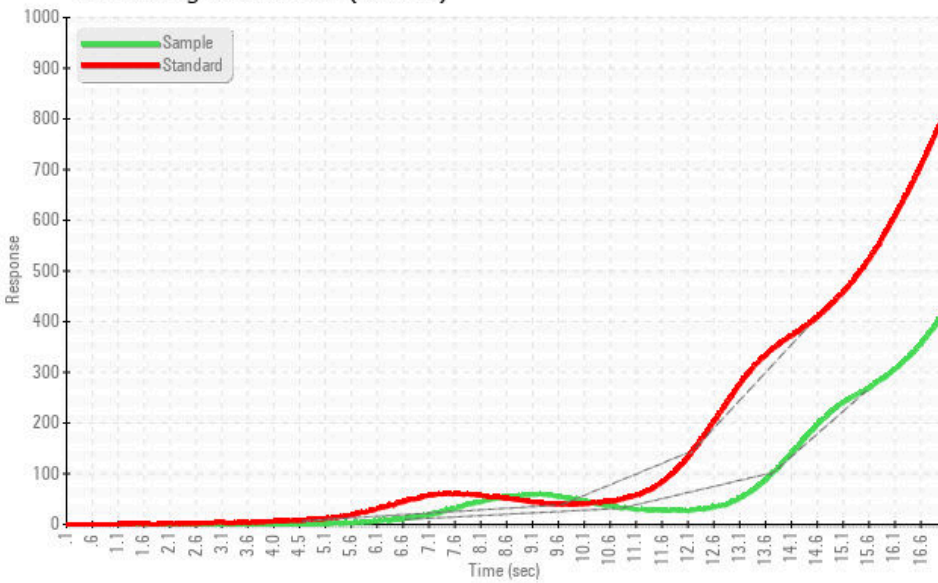

### Water Separability

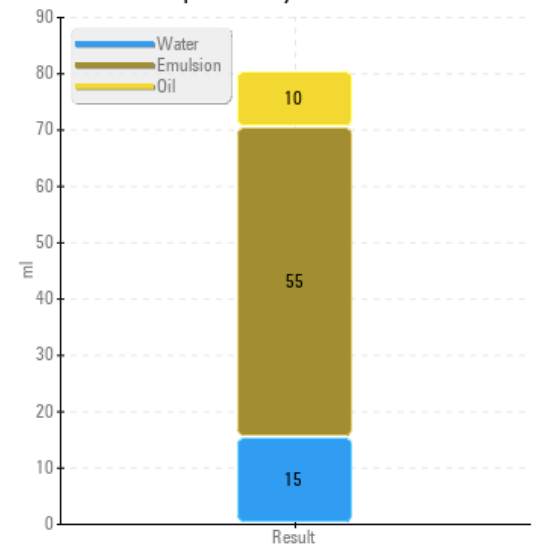

### MPC (Varnish Test)

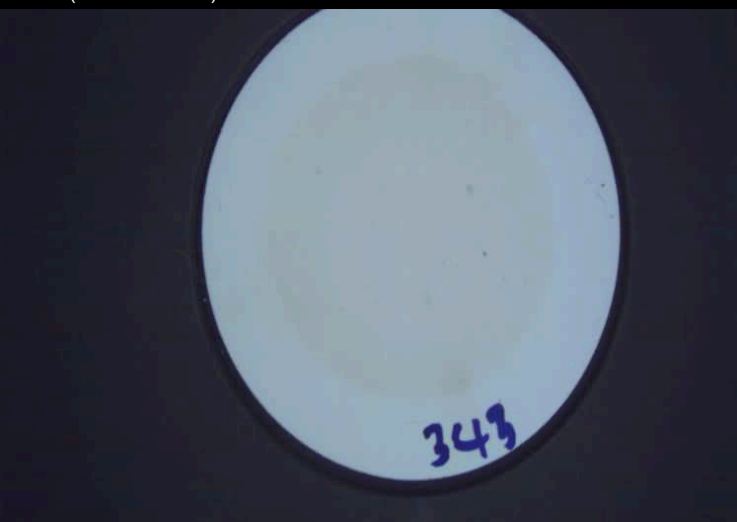

### Sample Color & Clarity

