




PROBLEM SUMMARY

Sample Rating Trend

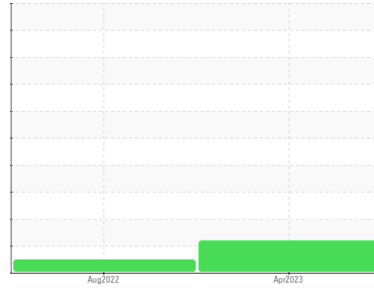

ISO



Machine Id

MAIN HPU

Component


Hydraulic System

Fluid

CHEVRON RANDO HD 46 (--- LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

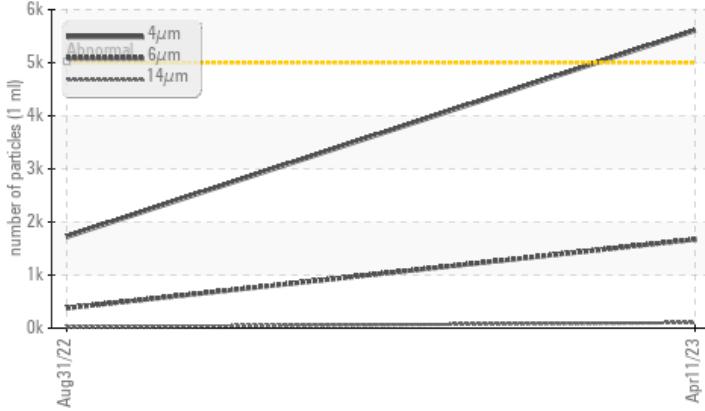

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	---
Particles >4µm	ASTM D7647	>5000	▲ 5608	1720	---
Particles >6µm	ASTM D7647	>1300	▲ 1672	378	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 20/18/14	18/16/12	---

Customer Id: BREABB
 Sample No.: WC0732081
 Lab Number: 02551419
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

HISTORICAL DIAGNOSIS

31 Aug 2022 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

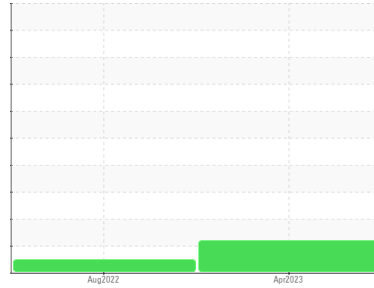

ISO



Machine Id
MAIN HPU

Component
Hydraulic System

Fluid
CHEVRON RANDO HD 46 (--- LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

There is a light amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0732081	WC0732077	---
Sample Date	Client Info			11 Apr 2023	31 Aug 2022	---
Machine Age	hrs	Client Info		5434	1	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			Not Changed	N/A	---
Sample Status				ATTENTION	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>30	<1	<1	---
Chromium	ppm	ASTM D5185(m)	>2	0	0	---
Nickel	ppm	ASTM D5185(m)	>2	2	1	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	0	---
Aluminum	ppm	ASTM D5185(m)	>2	0	<1	---
Lead	ppm	ASTM D5185(m)	>10	0	<1	---
Copper	ppm	ASTM D5185(m)	>25	<1	<1	---
Tin	ppm	ASTM D5185(m)	>20	0	0	---
Antimony	ppm	ASTM D5185(m)		0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
Beryllium	ppm	ASTM D5185(m)		0	0	---
Cadmium	ppm	ASTM D5185(m)		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		2	2	---
Barium	ppm	ASTM D5185(m)		0	0	---
Molybdenum	ppm	ASTM D5185(m)		0	0	---
Manganese	ppm	ASTM D5185(m)		0	0	---
Magnesium	ppm	ASTM D5185(m)		<1	<1	---
Calcium	ppm	ASTM D5185(m)		103	95	---
Phosphorus	ppm	ASTM D5185(m)		364	355	---
Zinc	ppm	ASTM D5185(m)		369	336	---
Sulfur	ppm	ASTM D5185(m)		701	657	---
Lithium	ppm	ASTM D5185(m)		<1	<1	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<1	<1	---
Sodium	ppm	ASTM D5185(m)		<1	<1	---
Potassium	ppm	ASTM D5185(m)	>20	0	<1	---


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ 5608	1720	---
Particles >6µm		ASTM D7647	>1300	▲ 1672	378	---
Particles >14µm		ASTM D7647	>160	104	21	---
Particles >21µm		ASTM D7647	>40	21	5	---
Particles >38µm		ASTM D7647	>10	0	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 20/18/14	18/16/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.50	0.49	---




OIL ANALYSIS REPORT


▲ Particle Trend

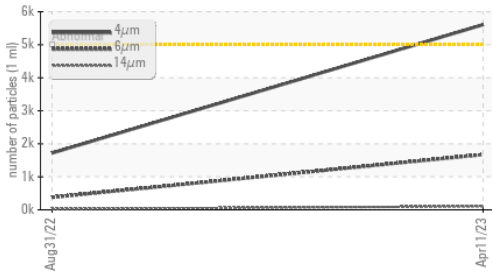


▲ Particle Trend

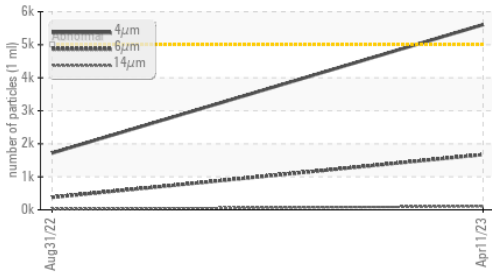

Acid Number

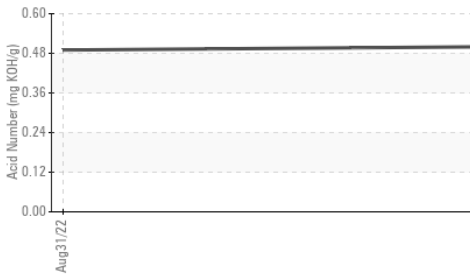


Viscosity @ 40°C

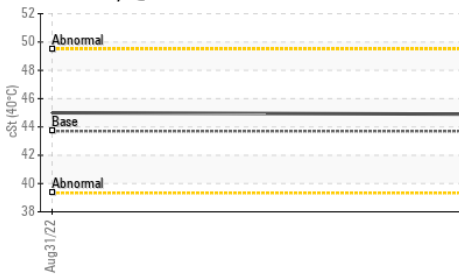





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.05	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	43.7	44.9	45.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

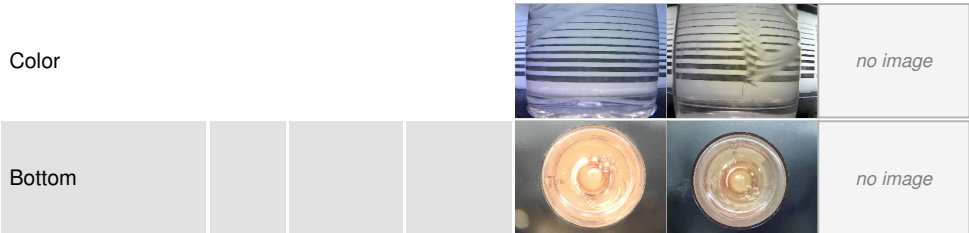

GRAPHS

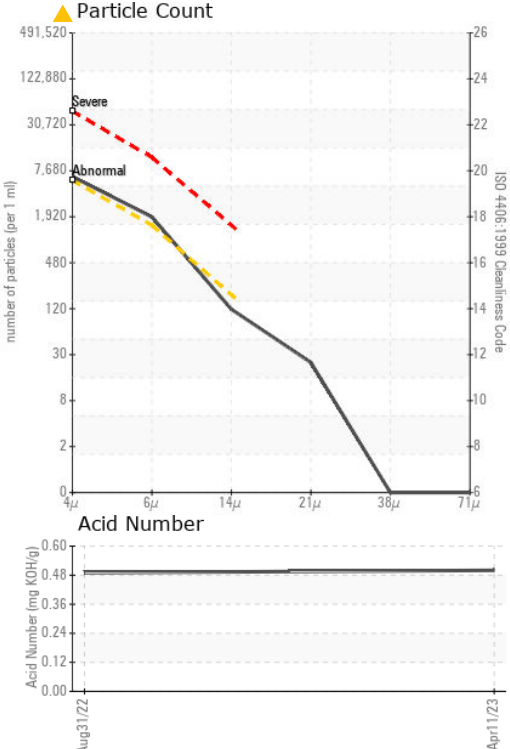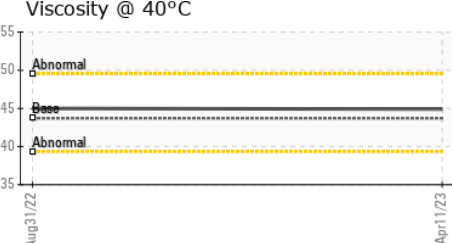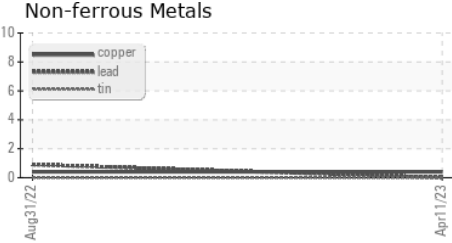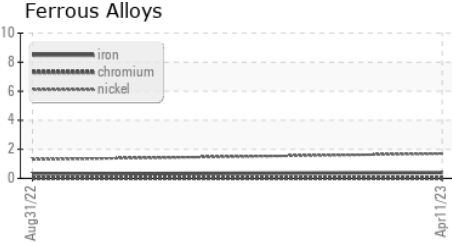

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0732081 **Received** : 14 Apr 2023
Lab Number : **02551419** **Diagnosed** : 17 Apr 2023
Unique Number : 5564434 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: TAN Man)

Bremner Trio Hydro Corp. (BTHC)
 32125 Sorrento Avenue
 Abbotsford, BC
 CA V2T 5B7
 Contact: Ryan Jones
 rjones@cclinfrastucture.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
F: