




OIL ANALYSIS REPORT

Sample Rating Trend

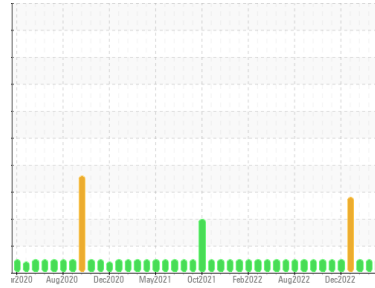

NORMAL



Area
M13
 Machine Id
71-G-3300C MAIN POWER GENERATOR C (71-T-3580C) (S/N Maint Plan 22480)
 Component
Turbine
 Fluid
MOBIL DTE 846 (11708 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

Wear

Component wear rates appear to be normal (unconfirmed).

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PP	PP	PP
Sample Date	Client Info	24 Apr 2023	14 Feb 2023	29 Jan 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >15	0	0	0
Chromium	ppm	ASTM D5185(m) >4	0	0	0
Nickel	ppm	ASTM D5185(m) >2	0	0	0
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >10	0	0	<1
Lead	ppm	ASTM D5185(m)	0	0	0
Copper	ppm	ASTM D5185(m) >5	0	0	0
Tin	ppm	ASTM D5185(m) >5	0	0	0
Antimony	ppm	ASTM D5185(m)	<1	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	<1	0
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	<1	0	0
Calcium	ppm	ASTM D5185(m)	0	0	0
Phosphorus	ppm	ASTM D5185(m)	1199	1183	1143
Zinc	ppm	ASTM D5185(m)	<1	<1	<1
Sulfur	ppm	ASTM D5185(m)	59	55	58
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >15	<1	<1	<1
Sodium	ppm	ASTM D5185(m)	0	0	0
Potassium	ppm	ASTM D5185(m) >20	<1	0	0
Water	%	ASTM D6304* >0.06	0.003	0.002	0.002
ppm Water	ppm	ASTM D6304* >600	26.2	17.9	15.1

FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>40000	967	1885	1068
Particles >6µm	ASTM D7647	>10000	212	411	286
Particles >14µm	ASTM D7647	>640	18	26	17
Particles >21µm	ASTM D7647	>160	7	7	3
Particles >38µm	ASTM D7647	>40	0	0	0
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>22/20/16	17/15/11	18/16/12	17/15/11



OIL ANALYSIS REPORT

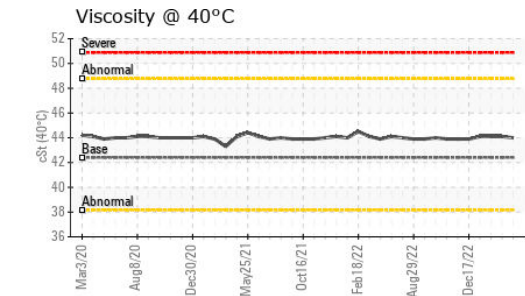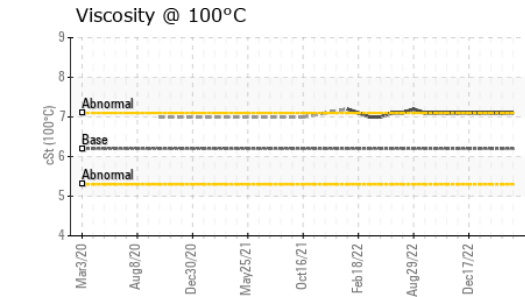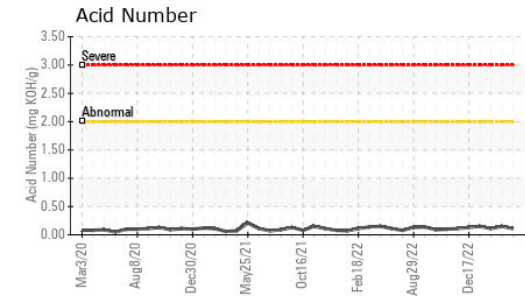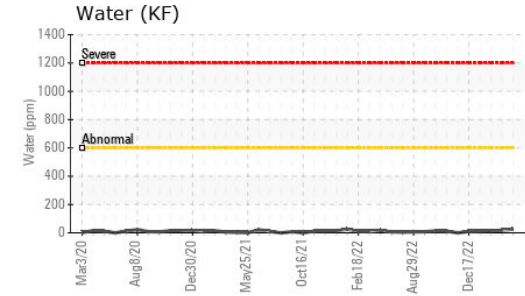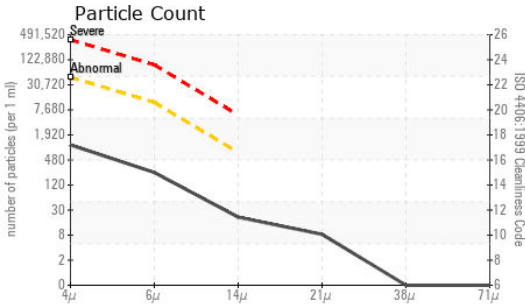







Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **HUSKY SEA ROSE /AKER SOLUTIONS**
Sample No. : PP **Received** : 25 Apr 2023 **PO BOX 20**
Lab Number : 02553399 **Diagnosed** : 26 Apr 2023 **ST. JOHN'S, NL**
Unique Number : 5566414 **Diagnostician** : Kevin Marson **CA A1C 6C9**
Test Package : IND 2 (Additional Tests: COC Flash, KV100, TAN Auto, VI) **Contact: Maintenance Supervisor**
maintsuper.searose@huskyenergy.ca

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.11	0.15	0.11

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.06	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	42.4	44.0	44.1	44.1
Visc @ 100°C	cSt	ASTM D7279(m)	6.2	7.1	7.1	7.1
Viscosity Index (VI)	Scale	ASTM D2270*	106	121	120	120
COC Flash Point	°C	ASTM D92*	244	---	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						
MPC				no image	no image	no image