




OIL ANALYSIS REPORT

Sample Rating Trend

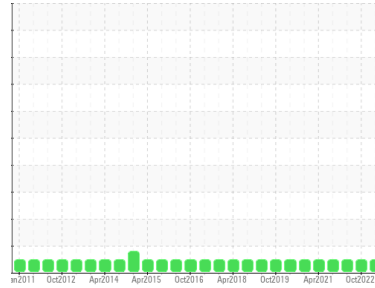

NORMAL



Machine Id
GENERAL ELECTRIC SLSMC G2

Component
Circulating Turbine

Fluid
ESSO NUTO H ISO 68 (450 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0690614	WC0690612	WC0690610
Sample Date	Client Info	26 Apr 2023	26 Oct 2022	30 Jun 2022
Machine Age	mths Client Info	0	0	0
Oil Age	mths Client Info	186	179	175
Oil Changed	Client Info	Not Chngd	Not Chngd	Not Chngd
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >15	2	2	2
Chromium	ppm ASTM D5185(m) >4	0	0	0
Nickel	ppm ASTM D5185(m) >2	<1	0	0
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	0	<1	0
Aluminum	ppm ASTM D5185(m) >10	0	0	0
Lead	ppm ASTM D5185(m)	6	6	7
Copper	ppm ASTM D5185(m) >5	86	87	86
Tin	ppm ASTM D5185(m) >5	<1	<1	<1
Antimony	ppm ASTM D5185(m)	<1	0	0
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 0	<1	0	0
Barium	ppm ASTM D5185(m) 0	0	0	0
Molybdenum	ppm ASTM D5185(m) 0	0	0	0
Manganese	ppm ASTM D5185(m)	<1	<1	<1
Magnesium	ppm ASTM D5185(m) 5	<1	0	<1
Calcium	ppm ASTM D5185(m) 50	41	42	41
Phosphorus	ppm ASTM D5185(m) 330	376	376	340
Zinc	ppm ASTM D5185(m) 420	416	417	421
Sulfur	ppm ASTM D5185(m) 3100	3801	3835	3805
Lithium	ppm ASTM D5185(m)	<1	<1	<1

CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >15	<1	<1	<1
Sodium	ppm ASTM D5185(m)	<1	<1	<1
Potassium	ppm ASTM D5185(m) >20	0	<1	<1
Water	% ASTM D6304* >0.03	0.002	0.002	0.002
ppm Water	ppm ASTM D6304* >300	17.8	21.6	16.8

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >2500	335	174	197
Particles >6µm	ASTM D7647 >640	127	65	56
Particles >14µm	ASTM D7647 >80	15	8	8
Particles >21µm	ASTM D7647 >20	6	2	2
Particles >38µm	ASTM D7647 >4	1	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >18/16/13	16/14/11	15/13/10	15/13/10





OIL ANALYSIS REPORT

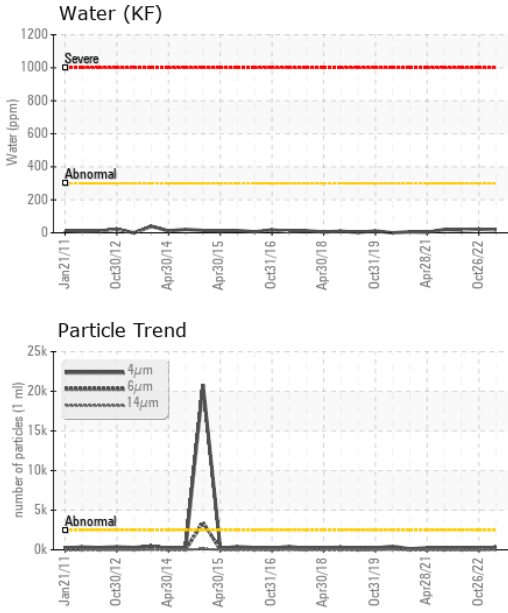




FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	.40	0.46	0.41	0.43
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.03	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68.8	67.2	67.2	66.6

SAMPLE IMAGES

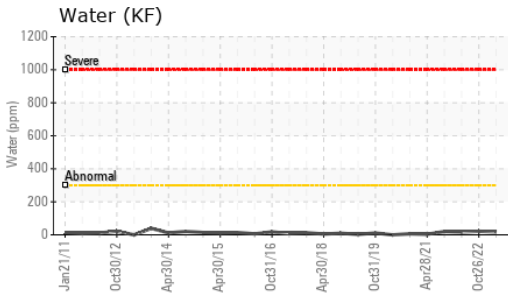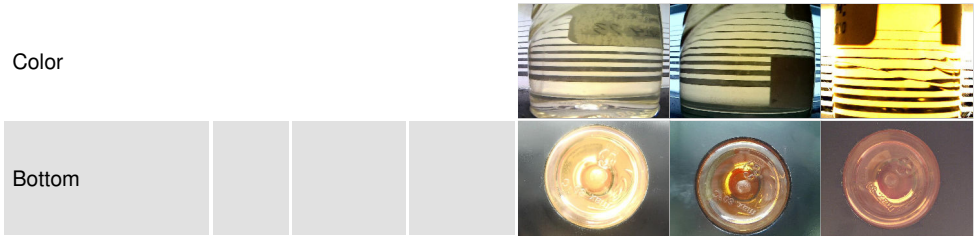

GRAPHS

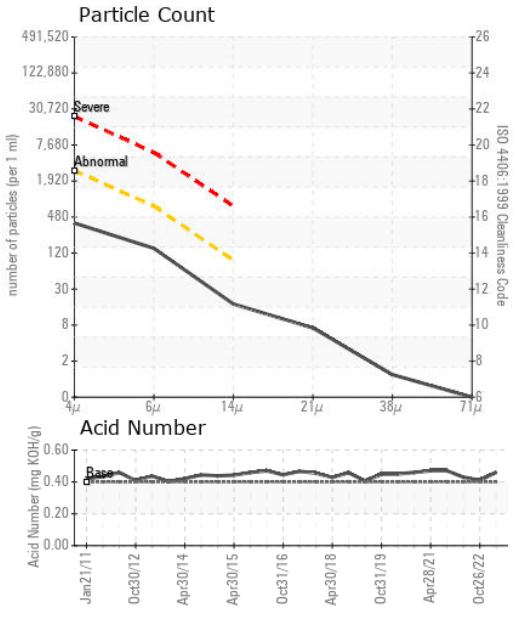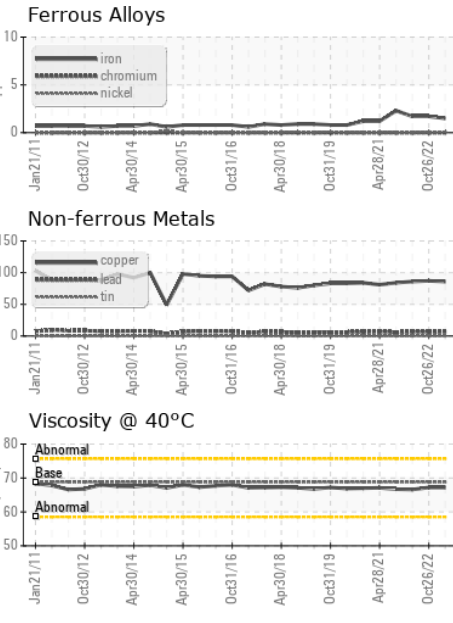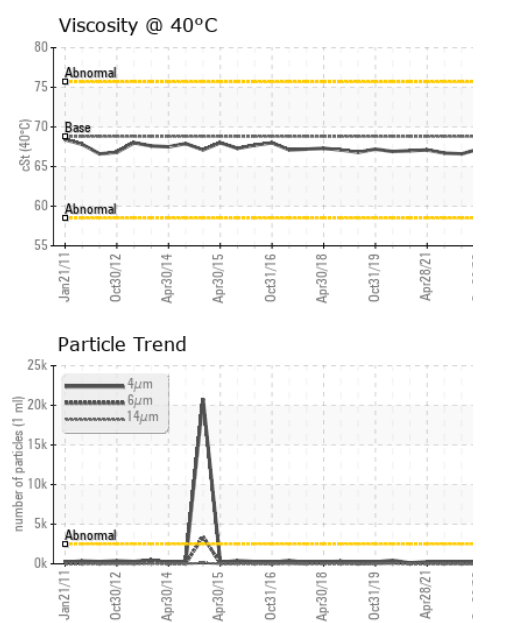

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **ST. LAWRENCE SEAWAY AUTHORITY**
Sample No. : WC0690614 **Received** : 28 Apr 2023 508 GLENDALE AVENUE, P.O. BOX 370
Lab Number : 02554130 **Diagnosed** : 01 May 2023 ST. CATHARINES, ON
Unique Number : 5567145 **Diagnostician** : Kevin Marson CA L2R 6V8
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.
 Contact: Scott Frick
 sfrick@seaway.ca
 T: (905)641-1932
 F: (905)641-1745