




PROBLEM SUMMARY

Sample Rating Trend

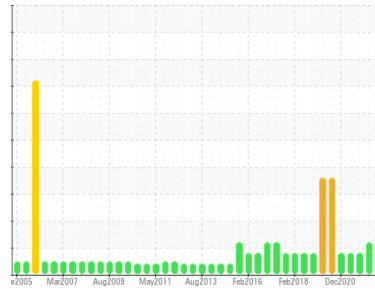


ISO



Machine Id
RBK-G1-UGBR/THBR
 Component
Bearing
 Fluid
MOBIL DTE OIL HVY MEDIUM (55 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

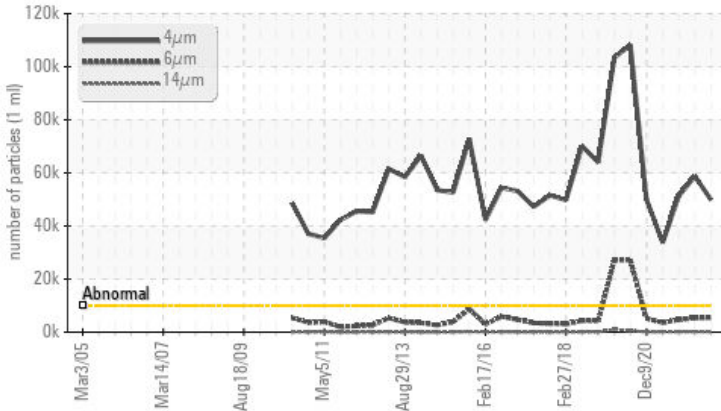

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>10000	▲ 49890	▲ 58736	▲ 51279
Particles >6µm	ASTM D7647	>2500	▲ 5499	▲ 5317	▲ 4689
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 23/20/14	▲ 23/20/15	▲ 23/19/14

Customer Id: NEWSTJ
 Sample No.: WC0445340
 Lab Number: 02554181
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Bill Quesnel CLS, OMA II, MLA-III, LLA-I +1
 (289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

03 Mar 2022 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >4µm are abnormally high. Particles >6µm are abnormally high. Particles >14µm are notably high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



17 Jan 2022 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >4µm are abnormally high. Particles >6µm are notably high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Feb 2021 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >4µm are abnormally high. Particles >6µm are notably high. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

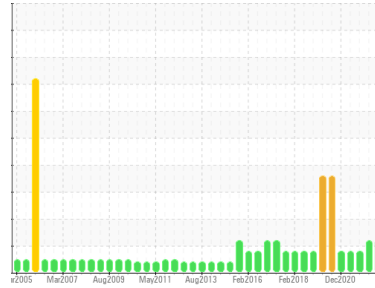

ISO



Machine Id
RBK-G1-UGBR/THBR
 Component
Bearing
 Fluid
MOBIL DTE OIL HVY MEDIUM (55 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0445340	WC0445221	WC0327899
Sample Date	Client Info		26 Apr 2023	03 Mar 2022	17 Jan 2022
Machine Age	mths	Client Info	55	0	55
Oil Age	mths	Client Info	0	0	55
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >63	6	5	4
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	<1
Aluminum	ppm	ASTM D5185(m) >2	<1	<1	<1
Lead	ppm	ASTM D5185(m) >161	17	16	15
Copper	ppm	ASTM D5185(m) >13	1	1	1
Tin	ppm	ASTM D5185(m) >27	0	<1	0
Antimony	ppm	ASTM D5185(m)	<1	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<1	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0
Calcium	ppm	ASTM D5185(m)	0	<1	<1
Phosphorus	ppm	ASTM D5185(m)	130	127	131
Zinc	ppm	ASTM D5185(m)	60	64	65
Sulfur	ppm	ASTM D5185(m)	2138	2099	2138
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >12	1	1	1
Sodium	ppm	ASTM D5185(m)	<1	<1	<1
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1





FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 49890	▲ 58736	▲ 51279
Particles >6µm	ASTM D7647	>2500	▲ 5499	▲ 5317	▲ 4689
Particles >14µm	ASTM D7647	>160	150	▲ 177	150
Particles >21µm	ASTM D7647	>40	45	42	34
Particles >38µm	ASTM D7647	>10	2	4	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 23/20/14	▲ 23/20/15	▲ 23/19/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.14	0.13	0.11

OIL ANALYSIS REPORT


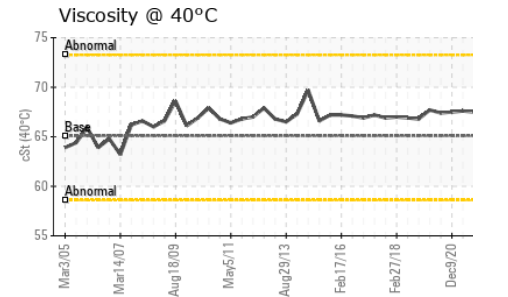
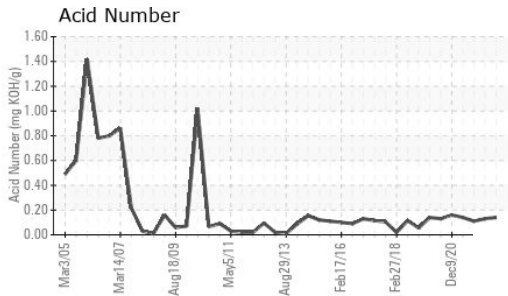
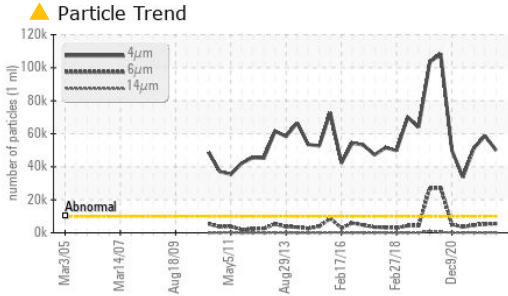
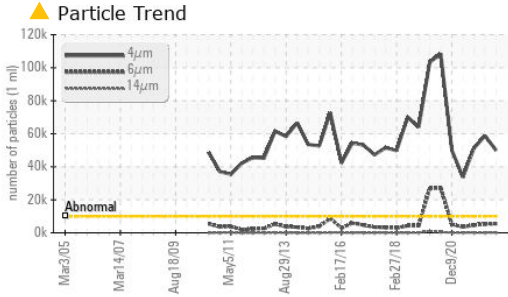


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D2729(m)	65.1	67.4	67.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

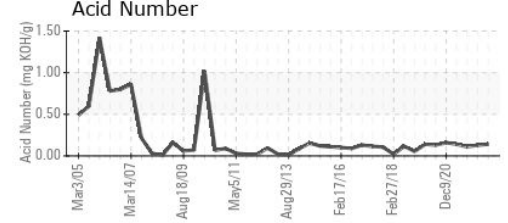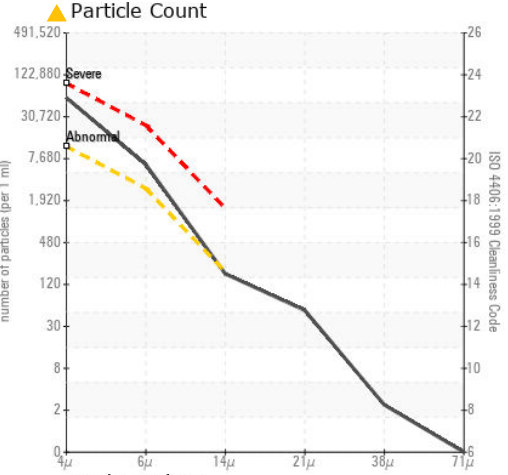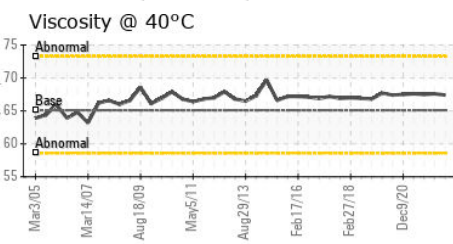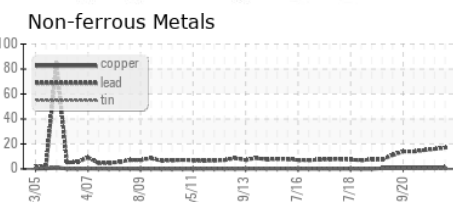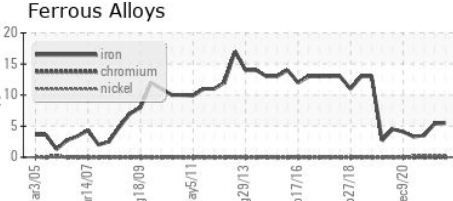

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0445340 **Received** : 28 Apr 2023
Lab Number : 02554181 **Diagnosed** : 01 May 2023
Unique Number : 5567196 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: TAN Man)

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Paul Martin
 pmartin@newfoundlandpower.com
 T:
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.